


Installation Instructions

Wall Speed Control

Ordering numbers: X13651617-02 SWT03834

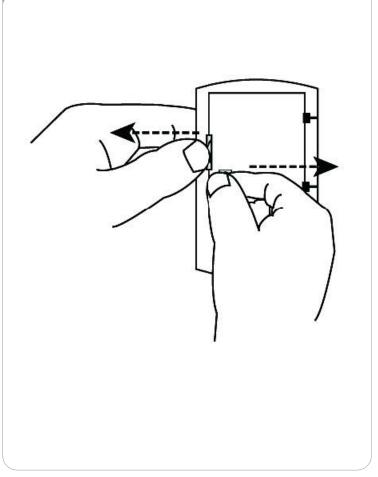

X39641255-01


TRANE


A SAFETY WARNING


Only qualified personnel should install and service the equipment. The installation, starting up, and servicing of heating, ventilating, and air-conditioning equipment can be hazardous and requires specific knowledge and training. Improperly installed, adjusted or altered equipment by an unqualified person could result in death or serious injury. When working on the equipment, observe all precautions in the literature and on the tags, stickers, and labels that are attached to the equipment.

June 2020

BAS-SVN205D-EN © 2020 Trane

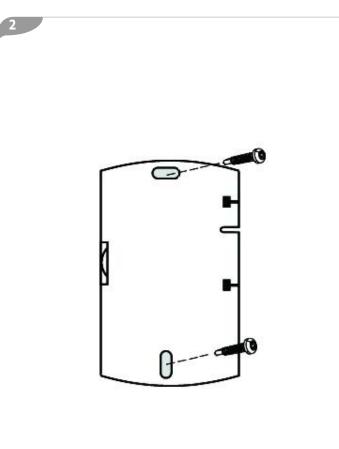

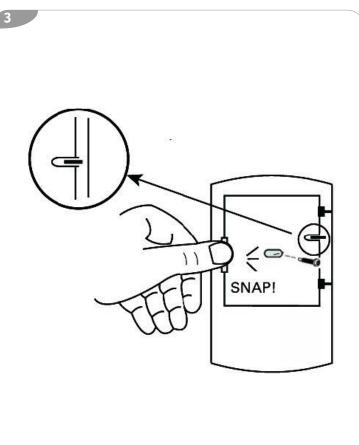

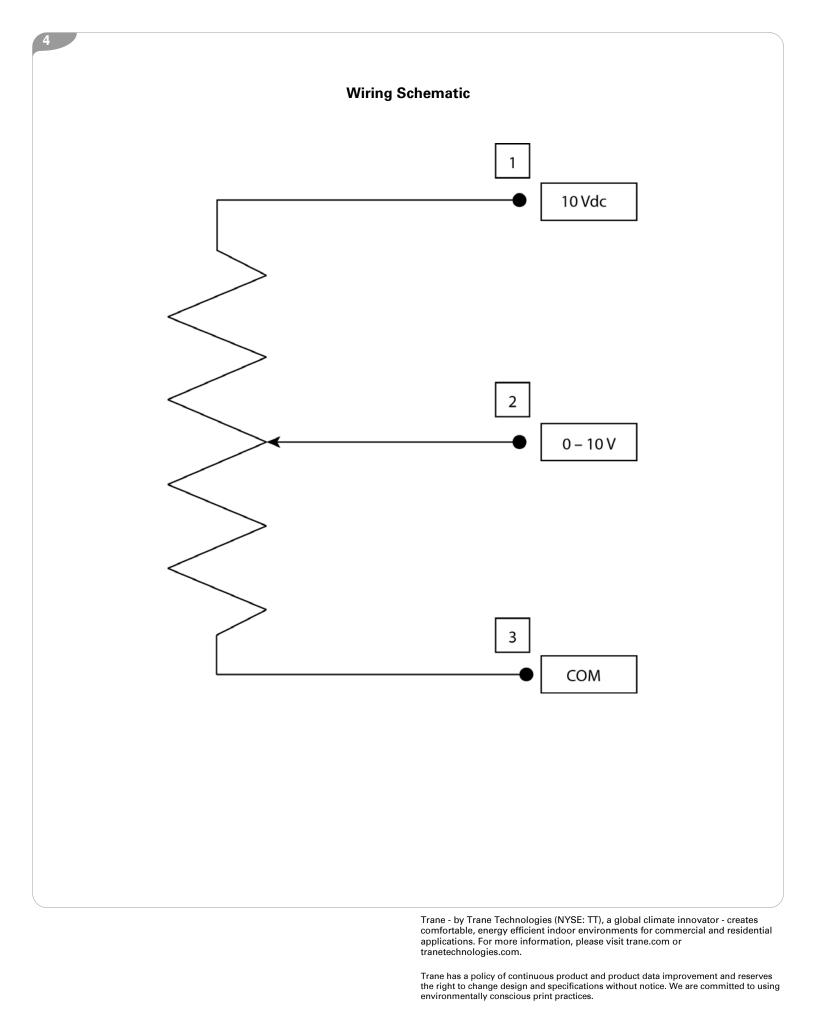

BAS-SVN205D-EN 05 Jun 2020 Supersedes X39641255-01C (Jul 2014)