




Installation

UHEC-IN-31

Library	Service Literature
Product Section	Air Terminal Devices and Heating Products
Product	Unit Heaters
Model	UHEC Accessories
Literature Type	Installation
Sequence	31
Date	April 1997
File No.	SV-TD-UH-UHEC-IN-31-497
Supersedes	EUH-IN-31A-1194

Line-Voltage Thermostat

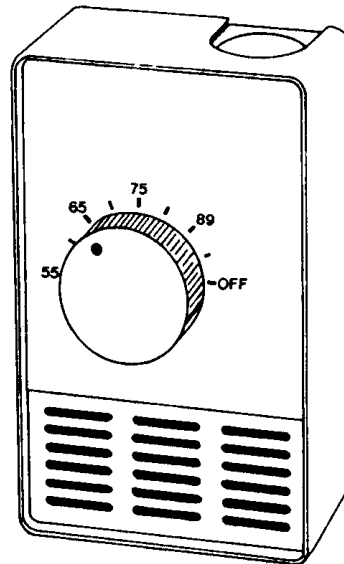

Model TW 1510
Order No. 236-714

Model TW 1512
Order No. 236-715

9496

Since the Trane Company has a policy of continuous product improvement, it reserves the right to change specifications and design without notice. The installation and servicing of the equipment referred to in this booklet should be done by qualified, experienced technicians.

Installation Instructions

Procedure

WARNING!

Open disconnect switches before servicing unit. Failure to do so may result in personal injury or death from electrical shock.

1. Disconnect heater from power supply.
2. Mount the thermostat in the desired location.
3. Wire the thermostat to the heater following the wiring diagrams located on the unit. All wiring must in accordance with NEC, CEC and local electrical codes. All conductors from the thermostat to the unit must be copper.
4. Restore power to the heater.
5. Check for proper thermostat operation.
6. 6 5/8" (168 mm) high, 4" (102 mm) wide and 3" (76 mm) deep.