



Compliance with the Indoor Air Quality Procedure of ASHRAE® Standard 62.1

IAQP Updates and Examples

This is for informational purposes only. Trane believes the facts and suggestions presented here to be accurate. However, final design and application decisions are your responsibility. Trane disclaims any responsibility for actions taken on the material presented.

Introduction

ASHRAE® Standard 62.1 “Ventilation and Acceptable Indoor Air Quality” prescribes requirements meant to ensure acceptable indoor air quality for the human occupants that minimize adverse health effects. The standard is written in code-enforceable language to help streamline its adoption into building codes. There are three procedures available to determine zone and system ventilation rates:

- **Ventilation Rate Procedure (VRP)** prescribes minimum zone-level outdoor air rates and procedures to determine the system level outdoor air intake rate.
- **Indoor Air Quality Procedure (IAQP)** allows compliance based upon an analysis of design compounds and design mixtures using performance criteria. Indoor air quality is monitored through survey and measurement. Air cleaning devices may be used to clean supply air.
- **Natural Ventilation Procedure (NVP)** prescribes minimum outdoor air openings, not outdoor air rates, for natural (passive) ventilation.

Project teams can choose one, or a combination, of these procedures to comply with the ventilation requirements of the standard. Often, the Natural Ventilation Procedure is used in conjunction with either the Ventilation Rate Procedure or Indoor Air Quality Procedure because mechanical ventilation must be available whenever passive ventilation is undesirable or ineffective.

The VRP is the most-commonly used procedure for determining the minimum outdoor airflow requirements. Use of the IAQP has not been as common in the marketplace, in large part because of the assumptions and documentation required. But recent addenda have improved its usability.

Overview of the Indoor Air Quality Procedure (IAQP)

The Indoor Air Quality Procedure (IAQP) is a performance-based procedure used to determine minimum outdoor airflow rates by evaluating design compounds, particulate matter, and mixtures of compounds while maintaining both objective and subjective occupant satisfaction. In contrast, the Ventilation Rate Procedure (VRP) is a prescriptive procedure designed to determine outdoor air rates by searching for people- and area-based ventilation rates from a table in the standard and then applying system-specific calculations.

Unlike the VRP, the IAQP allows designers to account for the addition of an air cleaning device to remove contaminants from the circulated air. This can be used to reduce the ventilation rate lower than the value determined in accordance with the VRP, while maintaining indoor air quality and meeting occupant satisfaction requirements. As a result, the ventilation rate for a system designed with the IAQP may be less than the same system designed with the VRP; which can allow for downsized equipment and reduced energy use.

Addendum n to Standard 62.1-2022 requires that air cleaning devices be tested to current standards, such as ASHRAE® Standard 145.2, ISO 10121-2, or others. If an air cleaning technology is used that is not covered by the standards, a third-party test can be performed to demonstrate removal efficiency.

Designers must consider pollutants as either particulate matter or gaseous contaminants when identifying design compounds and mixtures of compounds. **Design compounds** include a prescribed list of compounds with design concentration limits established by cognizant authorities. **Particulate matter** includes inert particles, biological particles, and liquid droplets. There are many sources of particles. Most inert particles and liquid particles originate outdoors. Biological particles originate both indoors and outdoors. Gaseous contaminants are either organic or inorganic. Like particles, gases originate both indoors and outdoors. Table 1 provides a list of design compounds and particulate matter along with their respective design limits and cognizant authorities. Designers are also required to consider any unusual sources of additional design compounds and add them to the analysis.

IAQP Revision

Standard 62.1 is under continuous maintenance, which means that it is constantly being updated by a committee of volunteers. In 2021, ASHRAE® approved Addendum aa to Standard 62.1-2019. This addendum included significant changes designed to simplify and improve the IAQP. Previously, the designer was required to identify “contaminants of concern,” indoor and outdoor sources, concentration limits, exposure periods, determine a percentage of satisfied building occupants, and perform a mass balance analysis for selected compounds. Now, the standard specifies limits for design compounds, mixtures of compounds, and particulate matter (with an additional requirement to include “unusual” sources as needed). Additionally, the committee added a minimum occupant satisfaction requirement along with objective and subjective testing requirements.

In 2022, ASHRAE® approved Addendum n to Standard 62.1-2022. This addendum adds air cleaning device efficiency requirements. In 2024, Addendum c was released with a set of spreadsheet-based calculation tools.

Table 1: Compounds, particulate matter, cognizant authorities, and design limits

Compound or PM _{2.5}	Cognizant Authority	Design Limit (µg/m ³)
acetaldehyde	Cal EPA CREL (June 2016)	140
acetone	AgBB LCI	1,200
benzene	Cal EPA CREL (June 2016)	3
dichloromethane	Cal EPA CREL (June 2016)	400
formaldehyde	Cal EPA 8-hour CREL (2004)	33
naphthalene	Cal EPA CREL (June 2016)	9
phenol	AgBB LCI	10 ^[1]
tetrachloroethylene	Cal EPA CREL (June 2016)	35
toluene	Cal EPA CREL (June 2016)	300
1,1,1-trichloroethane ^[2]	Cal EPA CREL (June 2016)	1,000
xylene, total	AgBB LCI	500
carbon monoxide	U.S. EPA NAAQS	9 ppm
PM _{2.5}	U.S. EPA NAAQS (annual mean)	12 ^[3]
ozone	U.S. EPA NAAQS	70 ppb
ammonia	Cal EPA CREL (June 2016)	200

^[1] Standard 62.1-2022 identifies the phenol design limit as 10 µg/m³. On August 30, 2024, ASHRAE introduced Addendum q for public review proposing to change the limit to 70 µg/m³ to match the cognizant authority's newer guidance.

^[2] On August 30, 2024, ASHRAE introduced Addendum q for public review proposing to remove 1,1,1-trichloroethane as a design compound indicating it is a “banned compound and is difficult and expensive to source for testing. Supply is limited and committee consensus is that this compound is no longer found to level of concern in most buildings.”

^[3] Standard 62.1-2022 lists the PM_{2.5} design limit as 12 µg/m³. On February 7, 2024, the cognizant authority (U.S. EPA) issued a final rule setting the limit to 9 µg/m³.

Mixtures of compounds are either source- or impact-related. Source mixtures (such as diesel exhaust or tobacco smoke) comprise a wide range of contaminants, often both particles and gases, which originate from known sources or processes. Mixtures of compounds comprise a set of particles or gases known to impact the same human organ or system, such as the eyes, the respiratory system, or the nervous system.

Many contaminants must be considered both as individual design compounds and as constituents of one or more mixtures. Ozone, for example, is considered an individual design compound and as a constituent of several mixtures of compounds because it affects the upper respiratory tract and eyes.

Both indoor and outdoor pollutants must be considered. Section 4 of Standard 62.1 provides more information on determining outdoor pollutants. Appendix E of Standard 62.1 includes a select list of standards and guidelines for outdoor particulate matter and ozone concentration. For indoor pollutants, Appendix N of Standard 62.1 provides some publications that have identified indoor pollutant emission rates for select space types.

How to Apply the IAQP

Section 6.3 in Standard 62.1-2022 outlines the requirements used to determine the breathing zone outdoor airflow (V_{bz}). The following steps are derived from those requirements.

Step 1: Identify the design compounds and particulate matter. Determine the design compounds and particulate matter ($PM_{2.5}$) starting with Table 1 (Standard 62.1-2022 Table 6-5). Additional compounds may be identified from one or more sources, such as an outdoor air quality survey performed in accordance with Standard 62.1 Section 4 or other identified unusual sources. These additional compounds should be assessed to determine if there is a cognizant authority and concentration design limit to be included in the analysis.

Step 2: Determine design compound emission rates and outdoor concentrations. The design team must determine emission rates for each design compound. One method to do this may include evaluating each floor, wall, and ceiling finish, furnishing, and other items in the space which may emit design compounds. Alternatively, Appendix N of Standard 62.1 provides a list of publications and resources that can be used to determine design compound emission rates.

The outdoor air concentration of each design compound must also be established. Local air quality could be assessed through the outdoor air quality survey discussed in Standard 62.1 Section 4. Alternatively, air quality monitoring station data may be available from agencies, such as the United States of America’s Environmental Protection Agency (U.S. EPA) through the National Ambient Air Quality Standards (NAAQS) program.

Step 3: Establish Design Limits. Standard 62.1 Table 6-5, reproduced as Table 1, includes concentration design limits for the listed design compounds. A combination of outdoor air and air cleaning system(s) can be designed to ensure design compound concentrations, mixtures of compounds, particulate matter, and any additional compounds (previously identified in step 2) are less than the corresponding concentration design limits.

The designer must establish whether the added compound has one or more mixture effects listed in Table 2 (Standard 62.1-2022 Table 6-6)—upper respiratory tract irritation, eye irritation, and central nervous system depression.

Table 2: Mixtures of compounds and effects

Upper respiratory tract irritation	Eye irritation	Central nervous system depression
<ul style="list-style-type: none"> • acetaldehyde • acetone • xylene, total • ozone 	<ul style="list-style-type: none"> • acetaldehyde • acetone • formaldehyde • xylene, total • ozone 	<ul style="list-style-type: none"> • acetone • dichloromethane • Xylene, total • 1, 1, 1-trichloroethane ^[4] • toluene
<p>^[4] On August 30, 2024, ASHRAE introduced Addendum q for public review proposing to remove 1,1,1-trichloroethane as a design compound indicating it is a “banned compound and is difficult and expensive to source for testing. Supply is limited and committee consensus is that this compound is no longer found to level of concern in most buildings.”</p>		

For each mixture, compute the mixed exposure sum (E_m) and ensure the sum is less than 1.0.

$$E_m = \frac{C_1}{DL_1} + \frac{C_2}{DL_2} + \frac{C_i}{DL_i}$$

where:

E_m = mixed exposure sum

C_i = mass-balanced model calculated airborne peak concentration for the i-th design compound

DL_i = design limit for the i-th design compound

The designer will need to revise the system if the mixed exposure sum is greater than 1.0. Example options include, but are not limited to, increasing the ventilation rate or increasing air cleaning device efficiency for one or more design compounds. It may also be possible to reduce design compound source strengths by changing building materials/finishes or indoor furnishings.

There are several exceptions to the requirement. First, benzene, phenol, and tetrachloroethylene are not included in the mixture calculation for upper respiratory tract irritation, eye irritation, and central nervous system depression.

Outside of the United States of America, the design limit for carbon monoxide, $PM_{2.5}$, or ozone can be dictated by the local applicable ambient air standards or the authority having jurisdiction (AHJ).


Finally, ammonia is only included for spaces with non-human animals.

Step 4: Perform a Mass-Balance Analysis. A mass balance analysis is performed to determine whether the initial minimum breathing zone outdoor air rate is sufficient to ensure each design compound concentration does not exceed the design limit and each mixed exposure sum (E_m) does not exceed 1.0. Air cleaning devices designed to reduce one or more design compounds are included in the analysis.

Informative Appendix F to Standard 62.1 includes mass balance equations for single-zone systems with an air cleaning device located in the recirculated air stream (position "A") or mixed air stream (position "B") as shown in Figure 1 (adapted from Standard 62.1-2022 Figure F-1).

ASHRAE® has released a set of IAQP and VRP calculators for purchase in the ASHRAE Bookstore (available from www.ashrae.org/bookstore). The IAQP calculator can be used to evaluate both single- and multiple-zone systems.

Figure 1: Air cleaning device locations

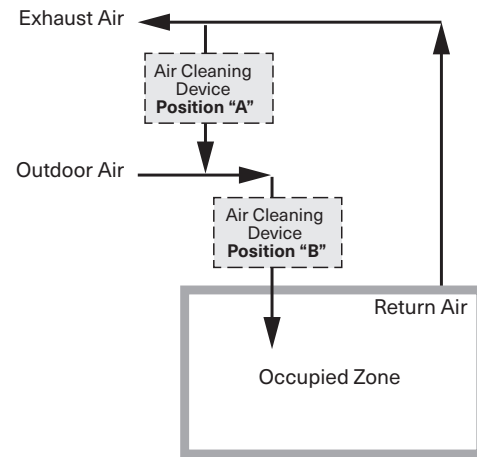

Step 5: Evaluate Objective and Perceived Indoor Air Quality then provide Design Documentation. Design documentation must be provided in accordance with Standard 62.1 Section 7.3. This includes performing an objective evaluation to measure design compounds and $PM_{2.5}$ in the completed building to ensure the design limits are not exceeded. For carbon monoxide, the peak concentration over an eight-hour period must not exceed the design limit. The standard provides requirements to support the evaluation, including a list of allowed compound test methods, measurement instrumentation accuracy and resolution requirements, and measurement points.

Next, a subjective evaluation must be conducted to demonstrate zone outdoor airflow rates are “sufficient to ensure that 80 percent or more of the occupants exposed do not express dissatisfaction with the quality of the air” when evaluated. Standard 62.1 Informative Appendix N includes an example subjective evaluation that could be used.

The standard clarifies in an exception that both the objective and subjective evaluations are “not required for every substantially similar zone” provided the outdoor airflow rates ensure objective and subjective satisfaction. The standard further clarifies in an informative note that a ventilation zone is similar if it has the same occupancy category (from Standard 62.1-2022 Table 6-1), occupant density, zone air distribution effectiveness, and design zone primary airflow per unit area. In a collection of similar zones, the designer should evaluate the single zone that has the least amount of ventilation air.

Finally, design documentation should be provided that includes test methodology, test results, and adjustments made to the design outdoor air rates.

Indoor Air Quality Procedure Example

Consider an example single-zone air handler that serves a classroom, designated as the “Classrooms (ages 5 to 8)” category. The single-zone, constant volume air handler is designed to provide ventilation air while cleaning the return/outdoor air mixture. The design team is evaluating whether supplying 5 cfm of outdoor air per person [8.5 m³/hr per person] will be adequate to maintain design limits.

- Occupancy category: classrooms (ages 5 to 8)
- Area: 1,000 ft² [92.9 m²]
- Design zone population: 25 people
- Design supply airflow: 1,000 cfm [1,699 m³/hr]
- Proposed ventilation rate: 5 cfm/person [8.5 m³/hr-person]
- Zone air distribution effectiveness, cooling (E_z): 1.0
- Zone air distribution effectiveness, heating (E_z): 0.8

For comparison, the design outdoor air intake flow is calculated based upon the procedure outlined in the Standard 62.1 Ventilation Rate Procedure using the smaller zone air distribution effectiveness value:

$$V_{ot} = V_{oz} = V_{bz}/E_z = (R_p \times P_z + R_a \times A_z)/E_z$$

$$= (10 \text{ cfm/person} \times 25 \text{ people} + 0.12 \text{ cfm/ft}^2 \times 1,000 \text{ ft}^2) / 0.8$$

$$= 463 \text{ cfm [786 m}^3/\text{hr]}$$

The design team has proposed to use 5 cfm/person [8.5 m³/hr per person], which would result in an outdoor air intake flow of 125 cfm [212 m³/hr]:

$$V_{ot,proposed} = 5 \text{ cfm/person} \times 25 \text{ people} = 125 \text{ cfm [212 m}^3/\text{hr]}$$

Step 1: Identify the design compounds and particulate matter. After evaluation, no additional design compounds were identified by the design team. The list of design compounds and particulate matter provided by Standard 62.1 will be evaluated (see Table 1).

Step 2: Determine design compound emission rates and outdoor concentrations. Design compound emission rates were sourced from the ASHRAE® IAQP spreadsheet calculator, available from the ASHRAE Bookstore, for classrooms (ages 5-8). Design compound outdoor concentrations were sourced from the ASHRAE Standard 62.1-2019 User’s Manual. Outdoor concentrations may be provided in different unit systems and must be converted to micrograms per cubic meter for each compound (Table 3).

Step 3: Establish design limits. The design limits and mixed exposure sums published in Standard 62.1 will be used. No additional design compounds were added to the analysis.

Step 4: Perform a mass-balance analysis. A mass balance analysis is used to determine the concentration in the breathing zone of each design compound. The following equation was selected from Standard 62.1-2022 Table F-1 based upon the use of a single-zone, constant-volume system with an optional air cleaning device in position “B” to clean the return/outdoor air mixture. The entire return/outdoor air mixture will be cleaned, so the recirculation flow factor is set to 1.0. Initially, the system will be evaluated without air cleaning to determine acceptability, so the air cleaning device efficiency term (E_r) is set to 0. This process is repeated for each design compound to determine the contaminant concentration in the zone.

$$C_{bz} = \frac{N + E_z V_{oz} (1 - E_r) C_o}{E_z (V_{oz} + R V_r E_r)}$$

where:

C_{bz} = breathing zone contaminant concentration (µg/m³)

N = contaminant emission rate (µg/hr)

E_z = zone air distribution effectiveness (dimensionless)

V_{oz} = outdoor air flow rate (m³/hr)

E_r = air cleaning device efficiency (percent)

C_o = outdoor contaminant concentration (µg/m³)

R = recirculation flow factor through the air cleaning device (dimensionless)

V_r = recirculation air flow rate (m³/hr)

First, the indoor contaminant emission rate (N) must be determined for each design compound. For this example, formaldehyde will be evaluated in detail. The emission rates are based upon floor area.

$$V_{\text{formaldehyde}} = \text{floor area} \times \text{emission rate} = 92.9 \text{ m}^2 \times 59.2 \text{ } \mu\text{g/hr}\cdot\text{m}^2 = 5,499.9 \text{ } \mu\text{g/hr}$$

Next, the single-zone, constant-volume breathing zone contaminant concentration equation is independently evaluated for each design compound.

$$C_{bz, \text{formaldehyde}} = \frac{N + E_z V_{oz} (1 - E_r) C_o}{E_z (V_{oz} + R V_r E_r)}$$

$$= \frac{5,499 \text{ } \mu\text{g/m}^3 + (0.8)(212.4 \text{ m}^3/\text{hr}) \times (1 - 0)(3.71 \text{ m}^3/\text{h})}{(0.8)(212.4 \text{ m}^3/\text{hr} + 1.0 \times 1,699 \text{ m}^3/\text{hr} \times 0)}$$

$$= 36.08 \text{ } \mu\text{g/m}^3$$

Table 3: Design compound details

Compound or PM _{2.5}	Design Limit (µg/m ³)	Molecular Weight (g/mol)	Indoor Emission Rate (µg/hr·m ²) ^[5]	Outdoor Air Concentration ^[6]	
				(ppb)	(µg/m ³)
acetaldehyde	140	44.05	16.5	0.98	1.77
acetone	1,200	58.08	37.7	2.4	5.70
benzene	3	78.11	0.21	1.2	3.83
dichloromethane	400	84.93	1.18	0	0
formaldehyde	33	30.03	59.2	3.02	3.71
naphthalene	9	128.17	0.38	0.4	2.10
phenol ^[7]	10 ^[1]	94.11	6.25	0.6	2.31
tetrachloroethylene	35	165.82	0.14	0.6	4.07
toluene	300	92.14	3.84	1.1	4.15
1,1,1-trichloroethane ^[8]	1,000	133.40	0.12	0	0
xylene, total	500	106.17	3.13	0.6	2.61
carbon monoxide	9 ppm [10,310] ^[9]	28.01	0	0.98	1.12
PM _{2.5} ^{[10][11]}	12	N/A	0	N/A	5.7
ozone	70 ppb [137.7] ^[12]	48.0	0	1.2	2.36
ammonia ^[13]	200	17.03	0	0	0

^[6] The indoor emission rates are based upon units of floor area.

^[6] The following formula can be used to convert concentration from parts per billion to micrograms per cubic meter:
concentration (µg/m³) = concentration (ppb) × molecular weight (g/mol) ÷ 24.45. For example, 0.98 ppb of acetaldehyde is equal to 1.77 µg/m³
(concentration = 0.98 × 44.05 ÷ 24.45 = 1.77 µg/m³).

^[7] For this analysis, the phenol design limit of 10 µg/m³ was used.

^[8] 1,1,1-trichloroethane is being evaluated, despite Addendum q to Standard 62.1-2022 which proposed to remove this compound.

^[9] Using the procedure described in Footnote 6, the design limit for carbon monoxide was computed to be 10,310 µg/m³.

^[10] A common conversion for particulate matter does not exist because the composition of liquids and solids varies. As a result, there is no uniform molecular weight. Particulate matter is typically reported in micrograms per cubic meter.

^[11] The PM_{2.5} design limit of 12 µg/m³ from Standard 62.1-2022 was used for this analysis.

^[12] Using the procedure described in Footnote 6, the design limit for ozone was computed to be 137.7 µg/m³.

^[13] For this analysis, there are no non-human animals in the space therefore ammonia was not evaluated but the molecular weight is provided for reference.

^[14] This whitepaper is written in the Imperial (I-P) unit system. The Standard 62.1 IAQP equations are evaluated in the International System of Units (SI).

This process is repeated for each design compound. Table 4 shows the calculated concentration for each design compound. The computed concentration values for benzene and formaldehyde exceed their respective design limits.

Table 4: Design compound summary

Compound or PM _{2.5}	Design Limit (µg/m ³)	Breathing Zone Contaminant Concentration, C _{bz} (µg/m ³)	Percent of Design Limit
acetaldehyde	140	10.79	7.7
acetone	1,200	26.32	2.2
benzene	3	3.95	131.6
dichloromethane	400	0.65	0.2
formaldehyde	33	36.08	109.3
naphthalene	9	2.30	25.6
phenol ^[7]	10	5.73	57.3
tetrachloroethylene	35	4.15	11.8
toluene	300	6.25	2.1
1,1,1-trichloroethane ^[8]	1,000	0.07	0.0
xylene, total	500	4.32	0.9
carbon monoxide	10,310	1.12	0.0
PM _{2.5} ^{[10][11]}	12	5.70	47.5
ozone	137.7	2.36	1.7
ammonia	200	0	0.0

Finally, the Mixed Exposure Sums (E_m) must be evaluated to determine if any exceed 1.0.

$$E_m = \frac{C_1}{DL_1} + \frac{C_2}{DL_2} + \frac{C_i}{DL_i}$$

where:

E_m = mixed exposure sum

C_i = mass-balanced model calculated airborne peak concentration for the i-th design compound

DL_i = design limit for the i-th design compound

For upper respiratory tract irritation, acetaldehyde; acetone; xylene, total; and ozone are input into the equation:

$$E_m = \frac{10.79 \mu\text{g}/\text{m}^3 + 26.32 \mu\text{g}/\text{m}^3 + 4.32 \mu\text{g}/\text{m}^3 + 2.36 \mu\text{g}/\text{m}^3}{140 \mu\text{g}/\text{m}^3 + 1200 \mu\text{g}/\text{m}^3 + 500 \mu\text{g}/\text{m}^3 + 137.7 \mu\text{g}/\text{m}^3} = 0.125 (12.5\%)$$

Table 5 provides a summary of the mixtures of compounds and the results of each calculation. The eye irritation category has resulted in a value greater than 1.0 due to the high concentration of formaldehyde.

Table 5: Mixtures of compounds summary

Upper respiratory tract irritation	Eye irritation	Central nervous system depression
<ul style="list-style-type: none"> Acetaldehyde Acetone Xylene, total Ozone 	<ul style="list-style-type: none"> Acetaldehyde Acetone Formaldehyde Xylene, total Ozone 	<ul style="list-style-type: none"> Acetone Dichloromethane Xylene, total 1, 1, 1-trichloroethane ^[4] Toulene
0.125 (12.5%)	1.218 (121.8%)	0.053 (5.3%)

The system must be revised to demonstrate compliance. There are several options available to the design team:

- **Install an air cleaning device.** A gaseous air cleaning device could be installed to remove design compounds from some or all the recirculated air (position “A”) or the return/outdoor air mixture (position “B”).
- **Increase the delivery of outdoor air for ventilation.** If the problematic design compound(s) concentration values are due to indoor emission, increased ventilation may be used to increase dilution and reduce the indoor concentration.
- **Reduce the indoor design compound emission rate(s).** Different construction materials, finishes, and/or furnishings could be selected to decrease design compound emission rates.

Combining these design decisions and conducting a life-cycle cost analysis can help determine the best solution for IAQP-intended projects.

For this example, the design team will employ a gaseous air cleaning device and particulate filter to reduce the concentration of design compounds and the resulting mixtures as a new alternative. This device will be installed into position “B” to clean the return/outdoor air mixture. The device has a 60 percent efficiency rate when used with formaldehyde and all return/outdoor air will pass through it, resulting in a recirculation flow factor of 1.0.

$$C_{bz, \text{formaldehyde}} = \frac{N + E_z V_{oz} (1 - E_r) C_o}{E_z (V_{oz} + R V_r E_r)}$$

$$= \frac{5,499 \mu\text{g}/\text{m}^3 + (0.8)(212.4 \text{ m}^3/\text{hr}) \times (1 - 0.60)(3.71 \text{ m}^3/\text{hr})}{(0.8)(212.4 \text{ m}^3/\text{hr} + 1.0 \times 1,699 \text{ m}^3/\text{hr} \times 0.60)}$$

$$= 5.84 \mu\text{g}/\text{m}^3$$

Tables 6 and 7 summarize the results of the new alternative with the air cleaning devices. With the air cleaning devices, all design compound concentrations are under their respective design limits and the mixture sums are all under 1.0.

Table 6: Design compound summary - air cleaning device alternatives

Compound or PM _{2.5}	Design Limit (μg/m ³)	Air Cleaning Device Efficiency (%)	Breathing Zone Contaminant Concentration, C _{bz} (μg/m ³)	Percent of Design Limit (%)
acetaldehyde	140	45	2.17	1.6
acetone	1,200	45	5.16	0.4
benzene	3	80	0.12	4.0
dichloromethane	400	55	0.12	0.0
formaldehyde	33	60	5.84	17.7
naphthalene	9	55	0.21	2.4
phenol ^[7]	10	55	0.83	8.3
tetrachloroethylene	35	55	0.35	1.0
toluene	300	80	0.40	0.1
1,1,1-trichloroethane ^[8]	1,000	55	0.01	0.0
xylene, total	500	25	1.22	0.2
carbon monoxide	10,310	25	0.28	0.0
PM _{2.5} ^{[10][11]}	12	10 ^[15]	2.85	23.8
ozone	137.7	25	0.59	0.4
ammonia	200	0	0.00	0.0

^[15] Gaseous air cleaning systems must include a particulate filter to reduce PM_{2.5}. This analysis assumes a MERV 8 filter. The efficiency value of 10% was selected to correspond with the filter’s worst performance near its most penetrating particle size.

Table 7: Mixtures of compounds summary - air cleaning device alternative

Upper respiratory tract irritation	Eye irritation	Central nervous system depression
<ul style="list-style-type: none">acetaldehydeacetonexylene, totalozone	<ul style="list-style-type: none">acetaldehydeacetoneformaldehydexylene, totalozone	<ul style="list-style-type: none">acetonedichloromethanexylene, total1, 1, 1-trichloroethane ^[4]toulene
0.027 (2.7%)	0.203 (20.3%)	0.008 (0.8%)

Step 5: Evaluate Objective and Perceived Indoor Air Quality then provide Design Documentation. After system start-up and commissioning, the design team provides design documentation to the building owner or owner’s agent. Both an objective and subjective evaluation are performed to ensure occupant satisfaction and design compounds do not exceed their respective design limits.

Conclusion

The IAQP can be used to demonstrate compliance with ASHRAE® Standard 62.1’s ventilation requirements. This can be done with an analysis that evaluates design compounds and mixtures of compounds. Air cleaning devices can be used to remove design compounds from the air and potentially reduce the system ventilation rate.

Bibliography

1. ANSI/ASHRAE Standard 62.1-2022: Ventilation for Acceptable Indoor Air Quality. Available from www.ashrae.org/bookstore
2. ANSI/ASHRAE Standard 62.1-2019 User’s Manual. Available from www.ashrae.org/bookstore
3. ASHRAE IAQP calculator. Available from www.ashrae.org/bookstore

Additional Resources

1. “Air Cleaning Technologies for Indoor Air Quality” Engineers Newsletter Live. APP-CMC078-EN. 2021.
2. “ASHRAE® Standard 62.1-2019” Engineers Newsletter Live. APP-CMC077-EN. 2021.
3. “Air Cleaning Systems” Applications Engineering Manual. APP-APM002*-EN. 2023.



Trane - by Trane Technologies (NYSE: TT), a global climate innovator - creates comfortable, energy efficient indoor environments for commercial and residential applications. For more information, please visit trane.com or tranetechnologies.com.

Trane has a policy of continuous product and product data improvement and reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.

All trademarks referenced are the trademarks of their respective owners.