

- 1 FOR 2-STAGE ELECTRIC HEAT, MOVE ELECTRIC HEAT PLUG (PPF14) FROM SINGLE STAGE ELECTRIC HEAT OUTPUT (RB-J3) TO DUAL STAGE ELECTRIC HEAT OUTPUT (RB-J2). SEE ELECTRIC HEAT DIAGRAM FOR APPROPRIATE WIRING.
- 2 AIR HANDLER THAT IS PAIRED WITH A SYMBIO CONDENSER REQUIRES OPTIONS MODULE TO CONTROL ELECTRIC HEAT. INSTALL IMC COMMUNICATION HARNESS TO RELAY BOARD (RB-P2) AND OPTIONS MODULE (OM-P4).
- 3 INSTALL ELECTRIC HEAT CONTROLS HARNESS TO RELAY BOARD (RB-J1) AND OPTIONS MODULE (OM-P6 & OM-P7). WIRE IMC CONNECTIONS FROM RELAY BOARD (RB-P4) TO ADAPTER BOARD (AB-J15) IN CONDENSER.
- 4 CONNECTIONS SHOWN ARE FOR 230V/60HZ/3PH UNIT. FOR 208V/60HZ/3PH OPERATION, MOVE WIRE FROM 230V TERMINAL TO 208V TERMINAL ON UNIT TRANSFORMER. FOR ALL OTHER VOLTAGES TRANSFORMERS ARE SINGLE TAP PRIMARY AND WILL BE SHIPPED FROM FACTORY WITH THE APPROPRIATE WIRING.
- 5 WIRING SHOWN IS APPLICABLE TO UNITS THAT ARE PAIRED WITH SYMBIO CONDENSER. SEE INSET A FOR STANDARD THERMOSTAT WIRING. SEE INSET B FOR WIRING FROM RELIATEL CONDENSER.
- 6 FOR PAIRING WITH ELECTROMECHANICAL OR RELIATEL CONDENSER, CUT WIRES AT RB-P8 AND SPLICE WITH WIRES THAT CONNECT TO EDC TERMINALS IN CONDENSER.
- 7 SWITCH IS SHIPPED IN THE NORMALLY OPEN CONFIGURATION. FOR PAIRING WITH ELECTROMECHANICAL OR RELIATEL CONDENSER, MOVE WIRE FROM TERMINAL "H" TO TERMINAL "L" ON EDC SWITCH ENABLING NORMALLY CLOSED SWITCH OPERATION.
- 8 24 VAC IS SUPPLIED TO THE AIR HANDLER FROM A SYMBIO CONDENSER AS SHOWN, CONNECTIONS FOR ELECTROMECHANICAL OR RELIATEL CONDENSER ARE SHOWN IN INSET D. ALTERNATIVELY, 24VAC CAN BE SUPPLIED FROM A SEPARATE TRANSFORMER TNS3, WHICH IS STANDARD ON 5 TON AIR HANDLERS OR AVAILABLE AS A FIELD INSTALLED ACCESSORY (SEE INSET C).

DESIGNER: SONALI V
ENGINEER: B JONES
TRANE © DATE: 8/27/2019
REPLACES:
SIMILAR TO:
REVISION DATE: 12/16/2019
REVISED BY: S VAWHAL
APPROVED BY: D MCGREGOR
CAD SYSTEM USED: CREO SCHEMATIC

TRANE®

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.


ODYSSEY
DIAGRAM
SCHEMATICS: AIR HANDLER
TWE-CONSTANT VOLUME
(1 PHASE)

MASTER NUMBER: -

DRAWING NUMBER: 12133272

SHEET: 1 OF 1

REV: B

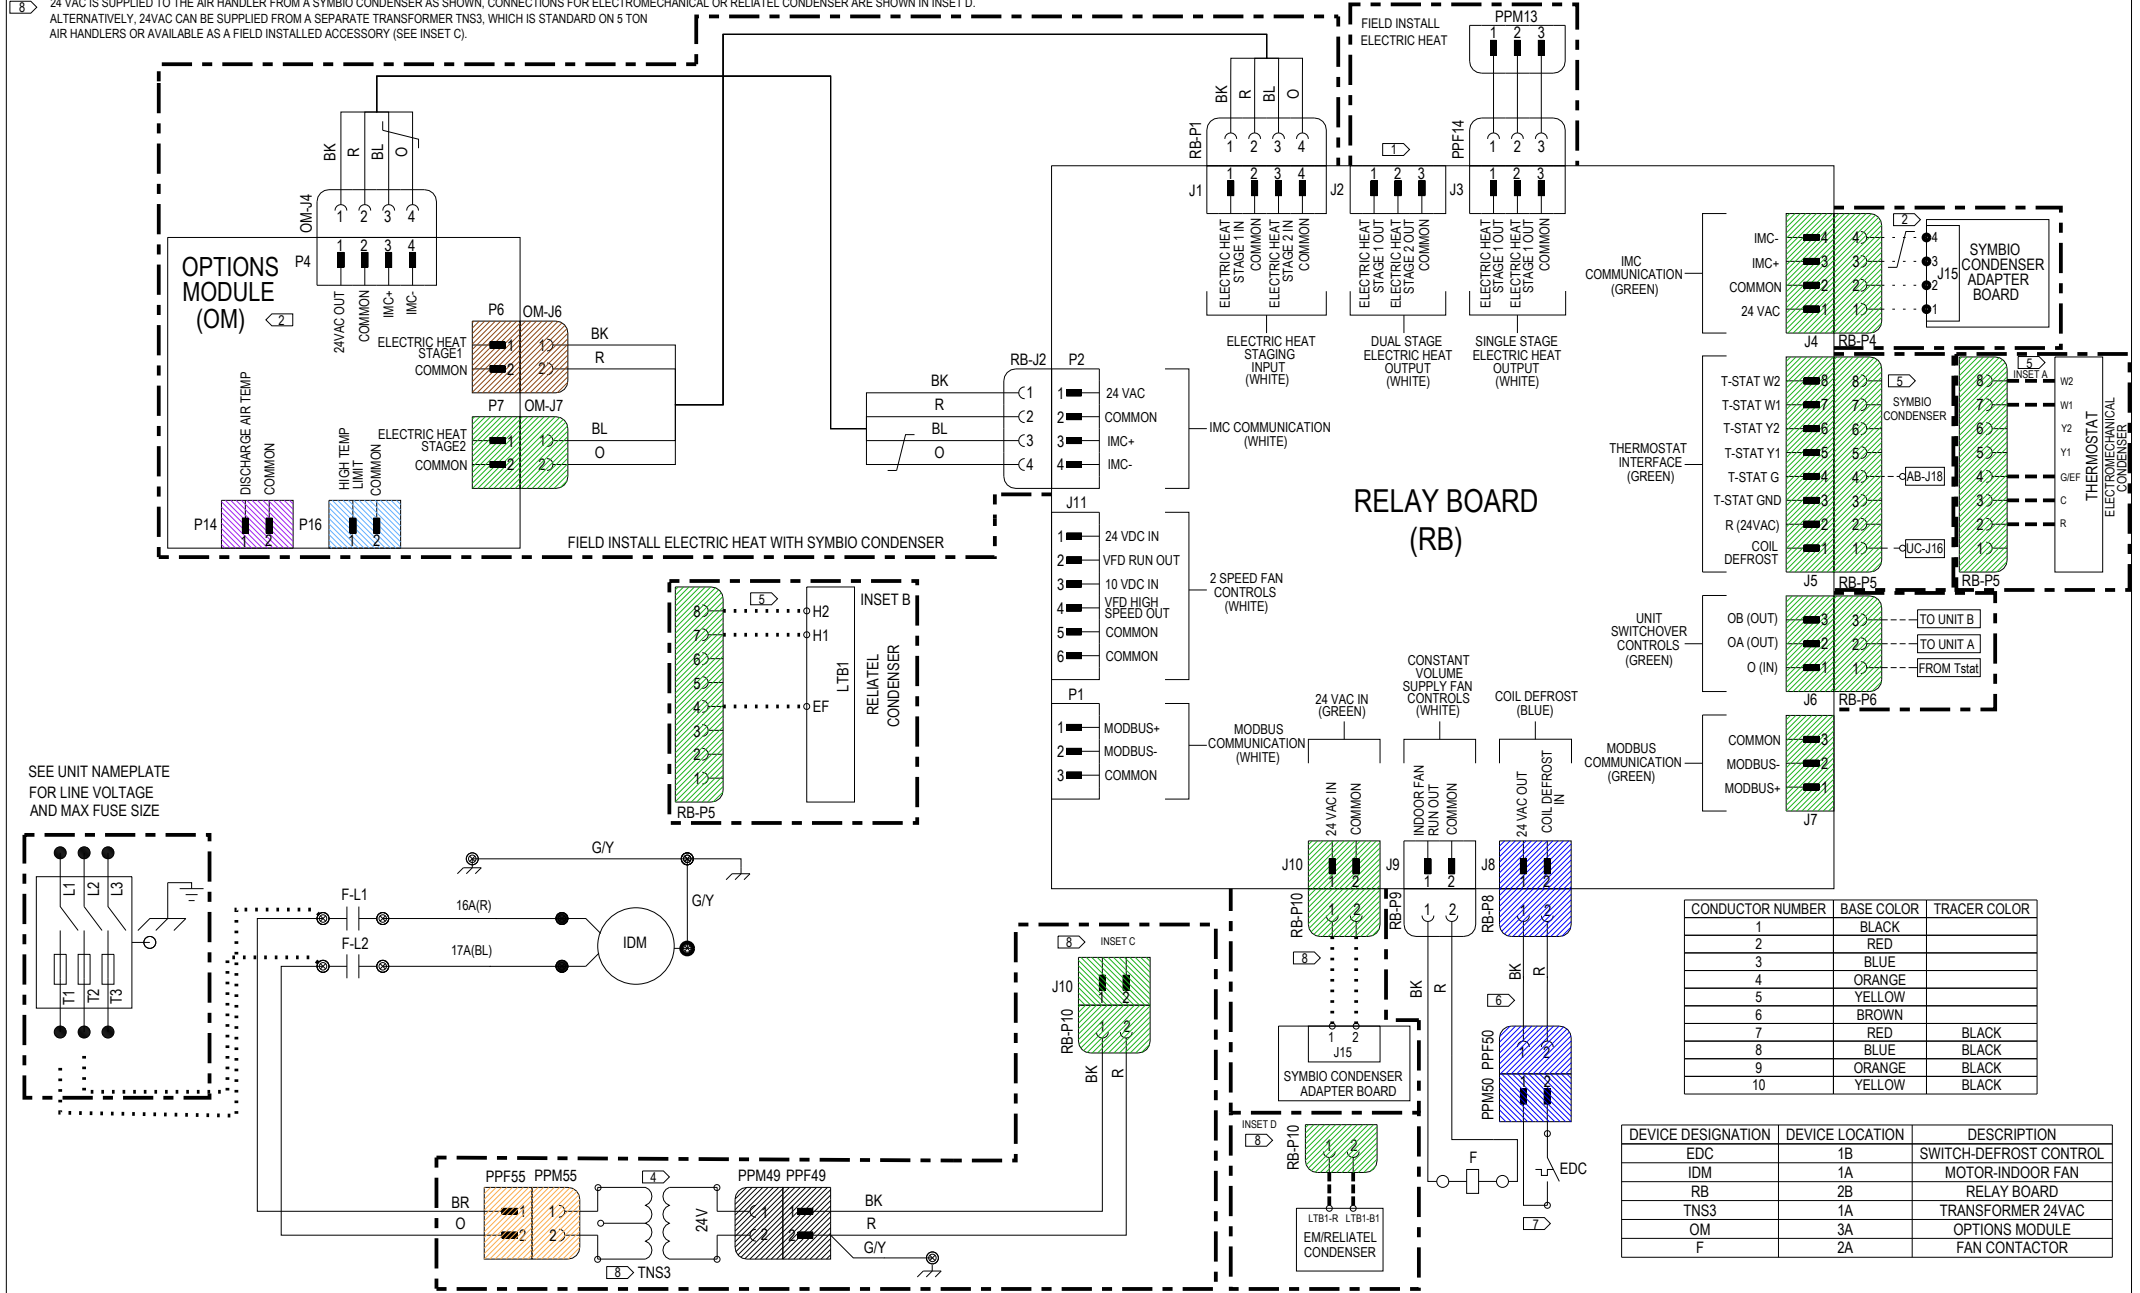

CONDUCTOR NUMBER	BASE COLOR	TRACER COLOR
1	BLACK	
2	RED	
3	BLUE	
4	ORANGE	
5	YELLOW	
6	BROWN	
7	RED	BLACK
8	BLUE	BLACK
9	ORANGE	BLACK
10	YELLOW	BLACK

DEVICE DESIGNATION	DEVICE LOCATION	DESCRIPTION
EDC	1B	SWITCH-DEFROST CONTROL
IDM	1A	MOTOR-INDOOR FAN
RB	2B	RELAY BOARD
TNS3	1A	TRANSFORMER 24VAC
OM	3A	OPTIONS MODULE
F	2A	FAN CONTACTOR

A

I

B