
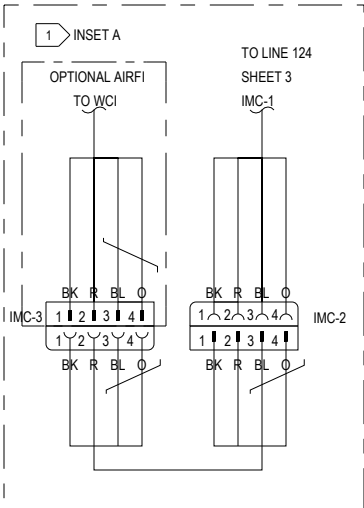


REF DES	DESCRIPTION	LINE NO
CFS	SWITCH - CLOGGED FILTER	349
ECA	ACTUATOR - ECONOMIZER	321
FOM	MODULE - FRESH AIR OPTIONS	312
OAH	SENSOR - OUTDOOR AIR HUMIDITY	313
RAH	SENSOR - RETURN AIR HUMIDITY	309
RASD	SENSOR - RETURN AIR SMOKE DETECTOR	305
RAT	SENSOR - RETURN AIR TEMP	317
RBA	ACTUATOR - ECONOMIZER, LOW LEAK	326
WCI	MODULE - WIRELESS COMMUNICATIONS	308
XFR	CONTACTOR - POWER EXHAUST	316

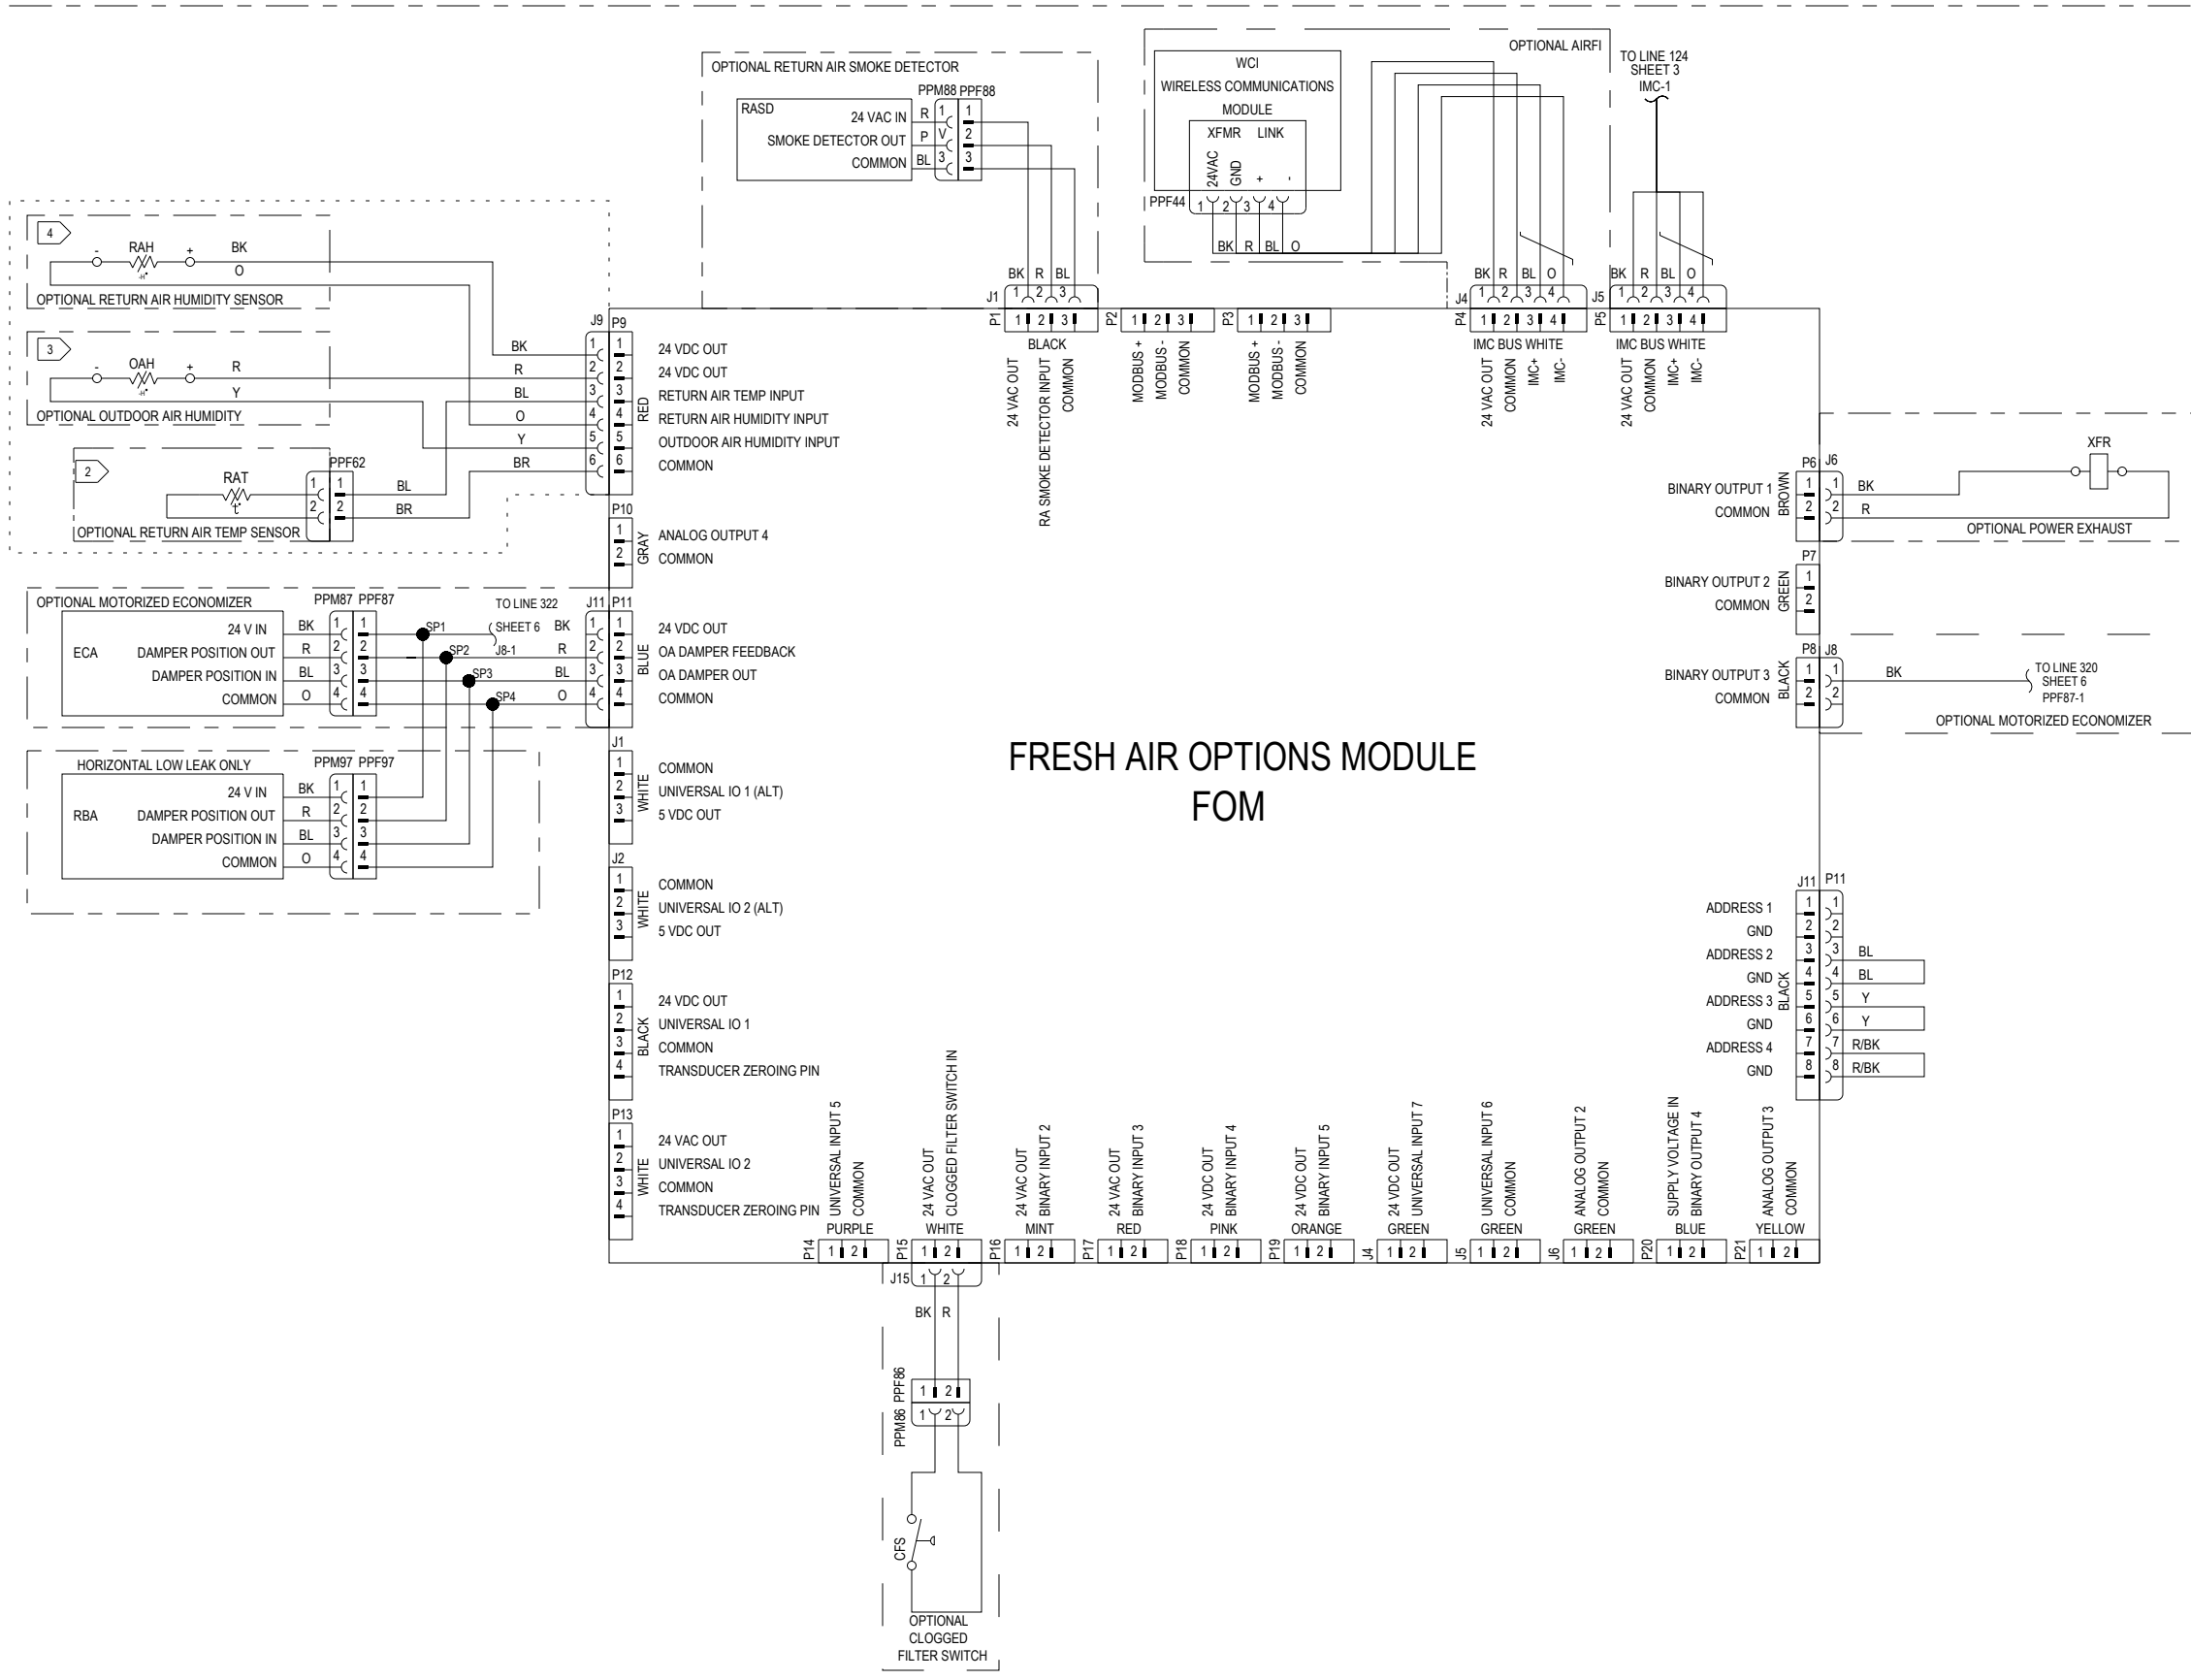

- 1 FRESH AIR OPTIONS MODULE ONLY PRESENT ON CERTAIN UNIT CONFIGURATIONS. SEE INSET "A" FOR UNITS WITHOUT FRESH AIR OPTIONS MODULE
- 2 RETURN AIR TEMP SENSOR PRESENT ON UNITS WITH DIFFERENTIAL DRY BULB AND COMPARATIVE ENTHALPY CONTROL
- 3 OUTDOOR AIR HUMIDITY SENSOR PRESENT ON UNITS WITH REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY CONTROL
- 4 RETURN AIR HUMIDITY SENSOR PRESENT ON UNITS COMPARATIVE ENTHALPY CONTROL

DESIGNER:	POULOMI CHATTERJEE
ENGINEER:	D. MACVICAR
TRANE © DATE:	08-JAN-2024
REPLACES:	
SIMILAR TO:	
REVISION DATE:	-
REVISED BY:	-
APPROVED BY:	D. MACVICAR
CAD SYSTEM USED:	CREO SCHEMATICS

TRANE®

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

PRECEDENT
UNIT SCHEMATIC
SCHEMATIC; SHEET 6
CONTROLS
FRESH AIR OPTIONS, A CAB

MASTER NUMBER:	DRAWING NUMBER:	SHEET:	REV
	12134809	6 OF 10	A