



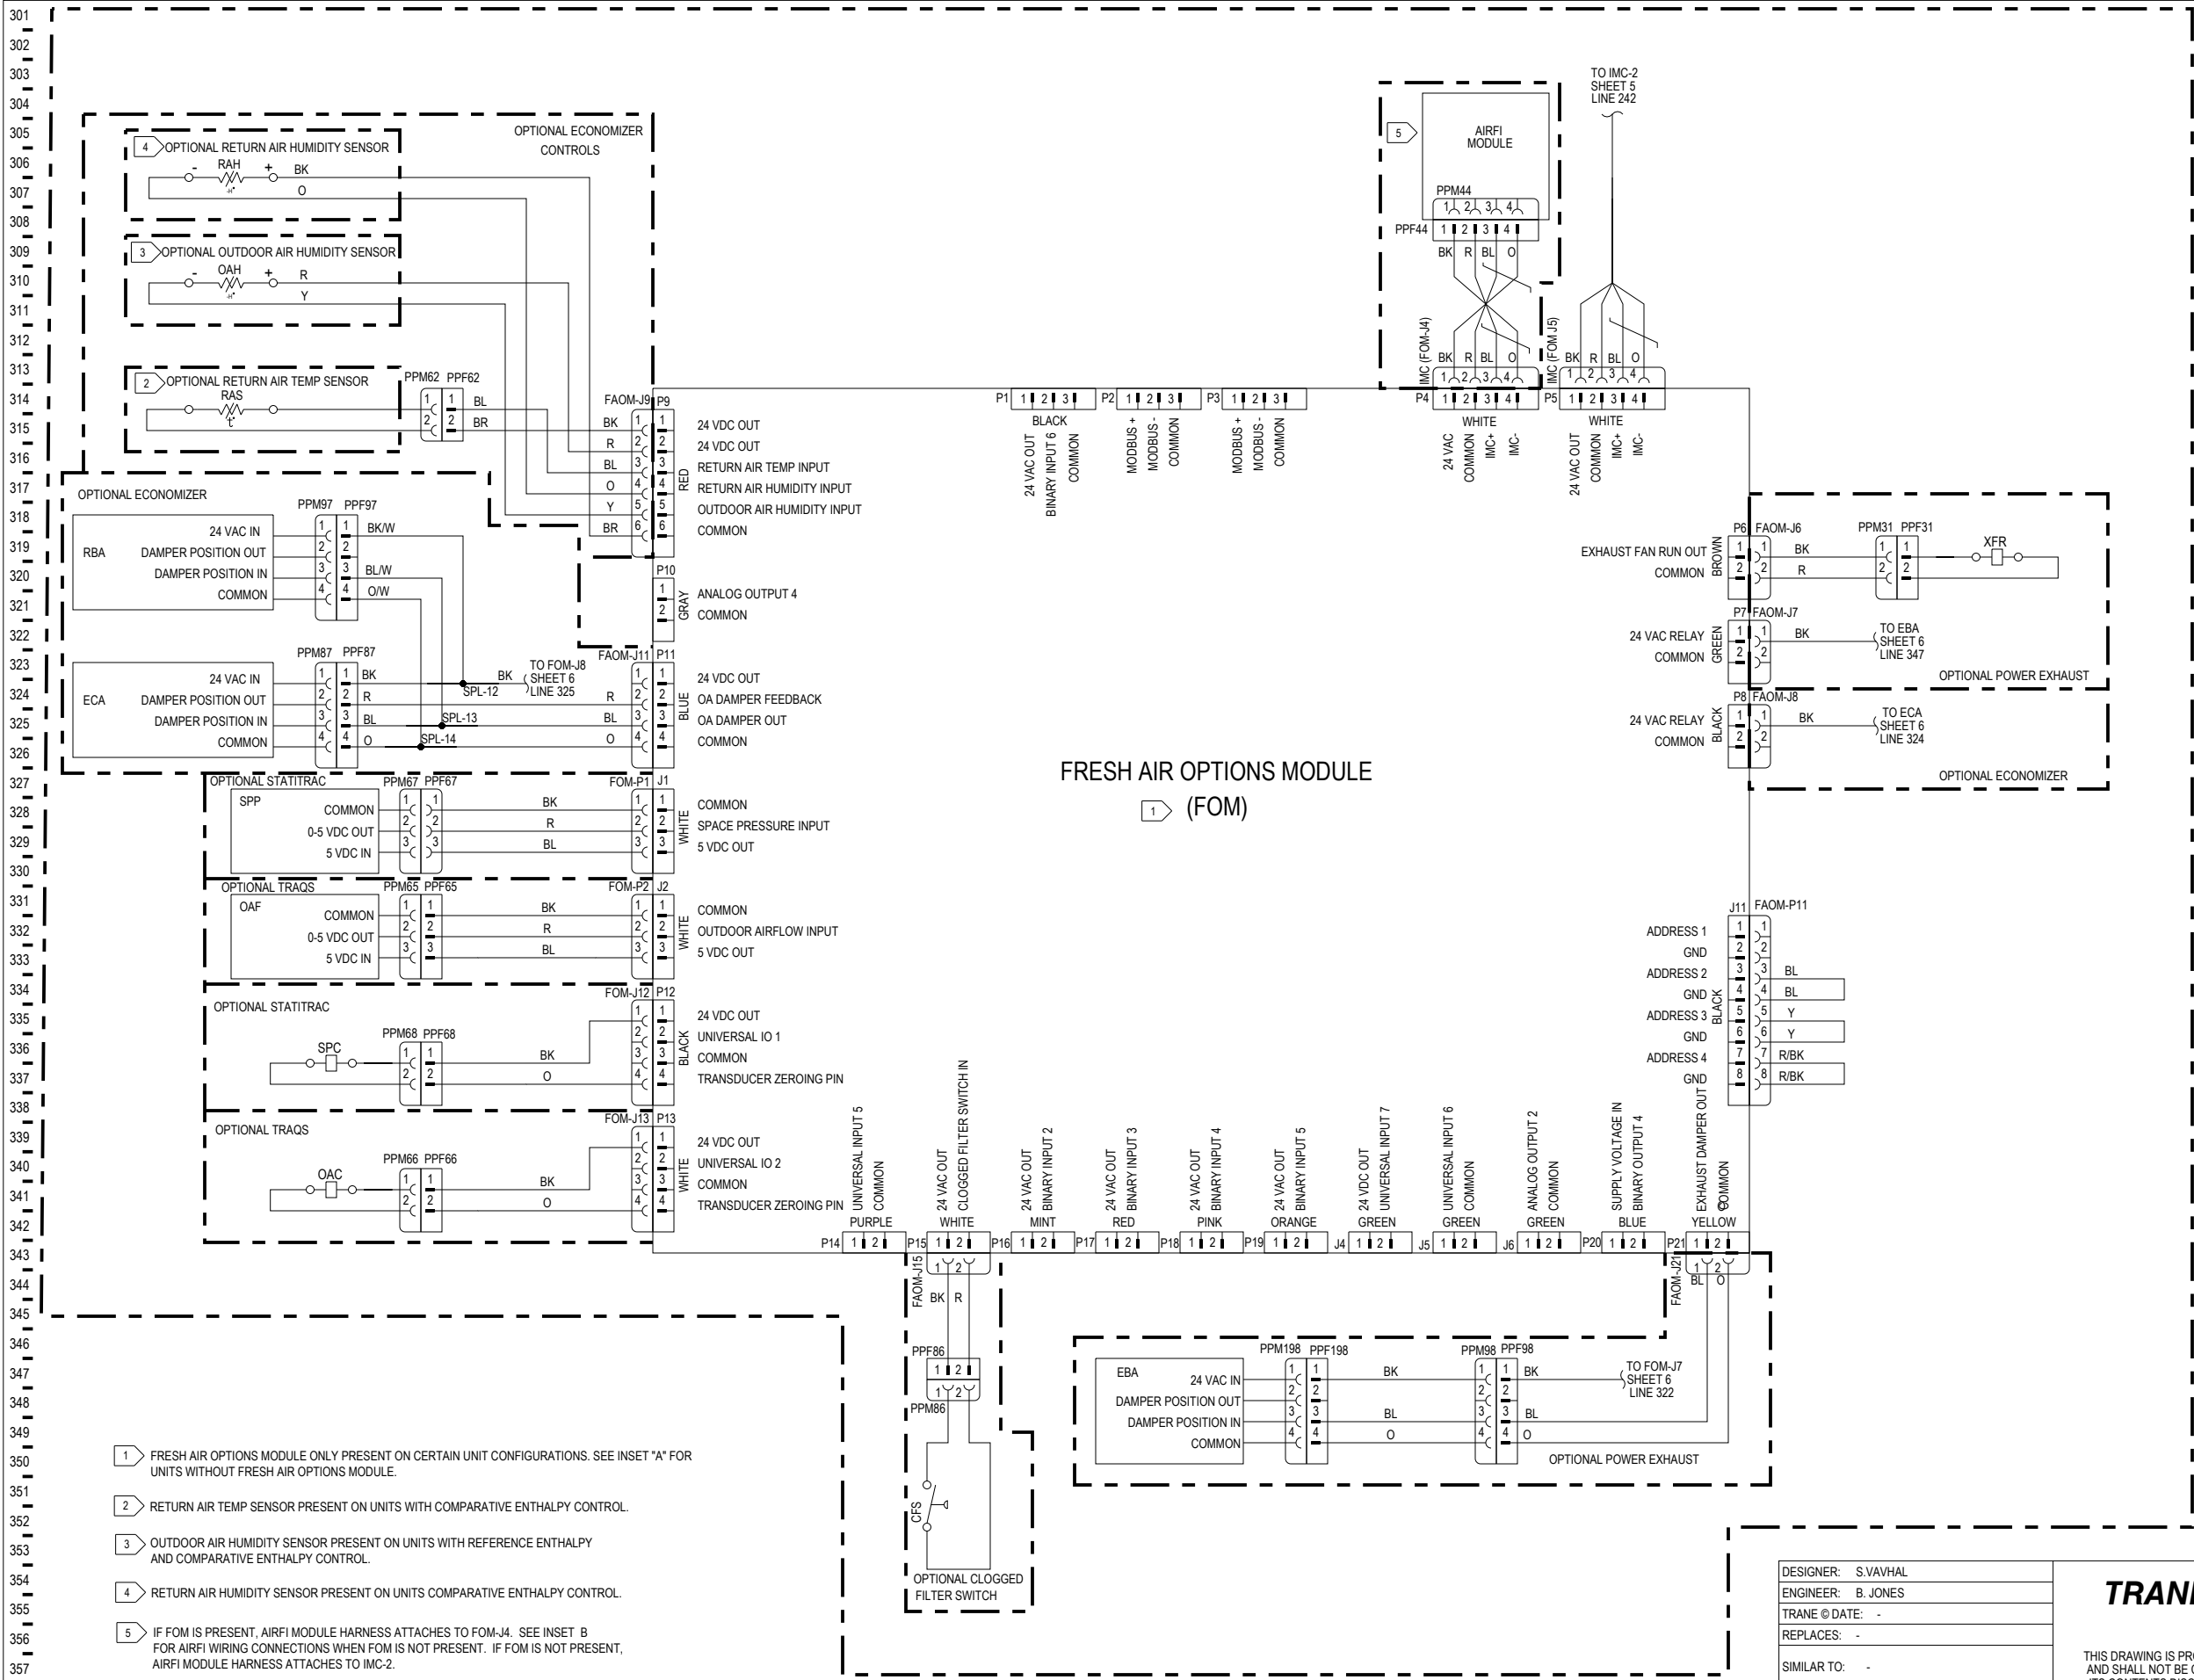

XFR, 99, 107

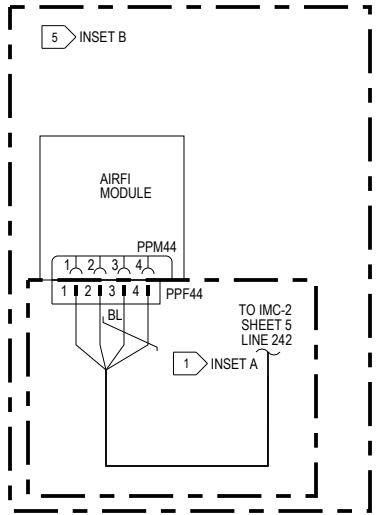

- 1 FRESH AIR OPTIONS MODULE ONLY PRESENT ON CERTAIN UNIT CONFIGURATIONS. SEE INSET "A" FOR UNITS WITHOUT FRESH AIR OPTIONS MODULE.
- 2 RETURN AIR TEMP SENSOR PRESENT ON UNITS WITH COMPARATIVE ENTHALPY CONTROL.
- 3 OUTDOOR AIR HUMIDITY SENSOR PRESENT ON UNITS WITH REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY CONTROL.
- 4 RETURN AIR HUMIDITY SENSOR PRESENT ON UNITS COMPARATIVE ENTHALPY CONTROL.
- 5 IF FOM IS PRESENT, AIRFI MODULE HARNESS ATTACHES TO FOM-J4. SEE INSET B FOR AIRFI WIRING CONNECTIONS WHEN FOM IS NOT PRESENT. IF FOM IS NOT PRESENT, AIRFI MODULE HARNESS ATTACHES TO IMC-2.

DESIGNER:	S.VAVHAL
ENGINEER:	B. JONES
TRANE © DATE:	-
REPLACES:	-
SIMILAR TO:	-
REVISION DATE:	12-MAY-2022
REVISED BY:	S VAVHAL
APPROVED BY:	-
CAD SYSTEM USED:	CREO SCHEMATICS

TRANE®

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

VOYAGER 3
UNIT SCHEMATIC
SCHEMATIC; SHEET 6
CONTROLS FRESH AIR OPTIONS
ULL ECON

MASTER NUMBER:	DRAWING NUMBER:	SHEET:	REV
-	12134533	6	B