APPROVED 21/Nov/2024 16:10:33 GMT

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

ATTENTION

N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!

LES BORNES DE L'UNIT É NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.

L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'ÉQUIPEMENT.

PRECAUCIÓN

¡UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!

LAS TERMINALES DE LA UNIDAD NO EST ÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.

SI NO HACE. PUEDE OCASIONAR DA ÑO AL EQUIPO.

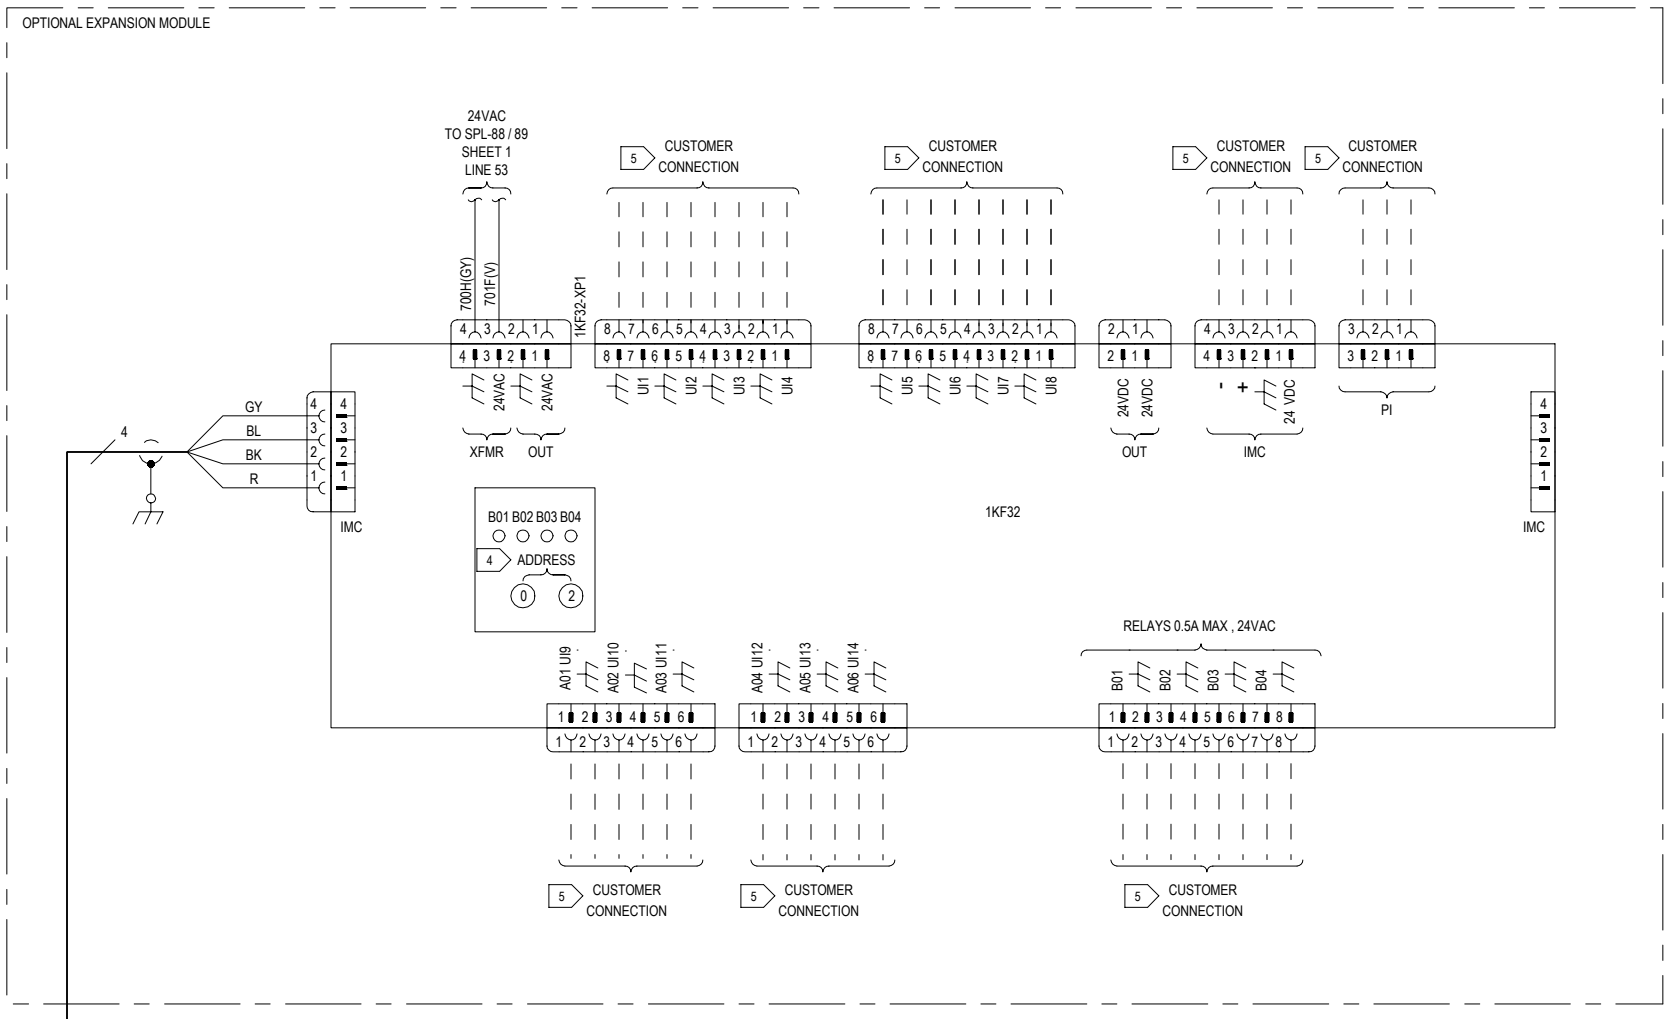

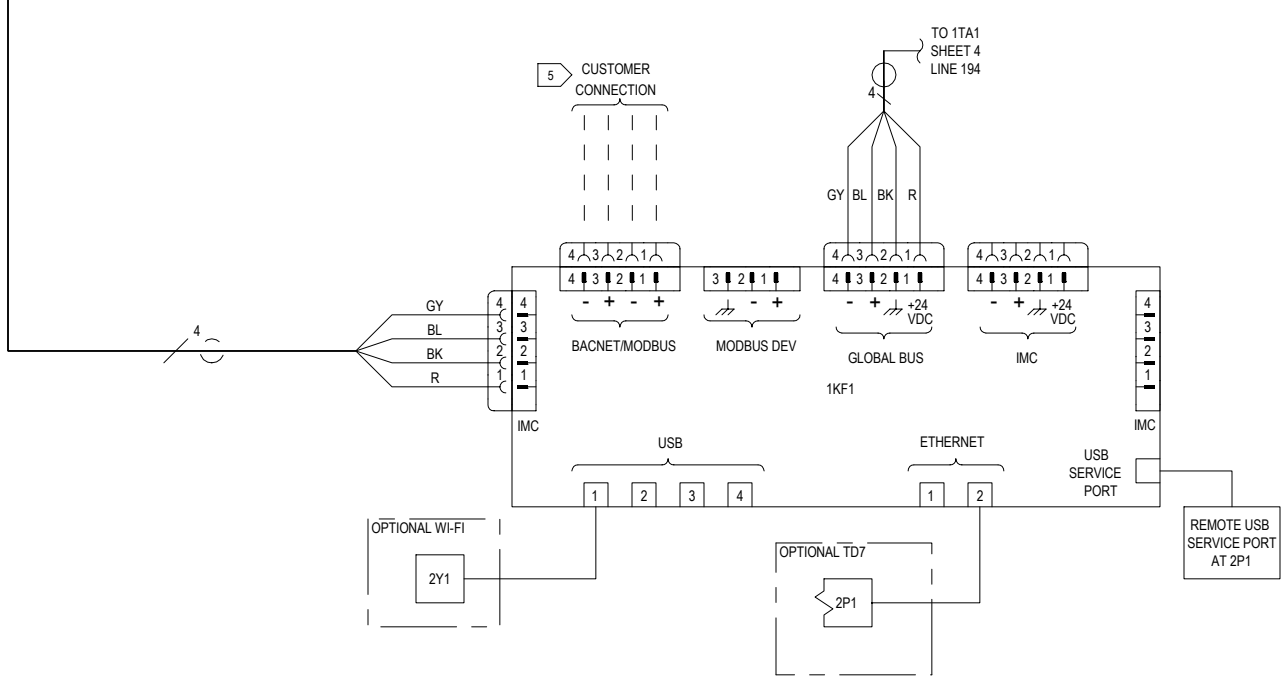

LEGEND		
REF DES	DESCRIPTION	LINE NO
1KF1	UNIT CONTROLS MODULE (UCM)	168
1KF32	MODULE - EXPANSION	145
2P1	USER INTERFACE - TD7	174
2Y1	ANTENNA, WI-FI	173

NOTES: (SEE SHEET 1 FOR STANDARD NOTES 1-3, WIRE COLOR & SYMBOL LEGEND TABLES.)

4 1KF32 ADDRESS DIALS MUST BE SET TO "02".

5 CUSTOMER PROVIDED DRY CONTACTS SHOULD BE RATED FOR 5VDC / 5mA CONTROL CIRCUIT. USE CLASS 2 CIRCUIT ONLY.

DESIGNER:	C. CATHCART
ENGINEER:	S. MCKINLEY
TRANE © DATE:	19-SEP-2023
REPLACES:	
SIMILAR TO:	
REVISION DATE:	26-AUG-2024
REVISED BY:	A. BREWINGTON
APPROVED BY:	S. MCKINLEY
CAD SYSTEM USED:	CREO SCHEMATICS

TRANE ®

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

INTELLICORE RA
SCHEMATIC
UNIT CONTROLS

MASTER NUMBER:	DRAWING NUMBER:	SHEET:	REV
	12134865	3	B