


FRONT VIEW

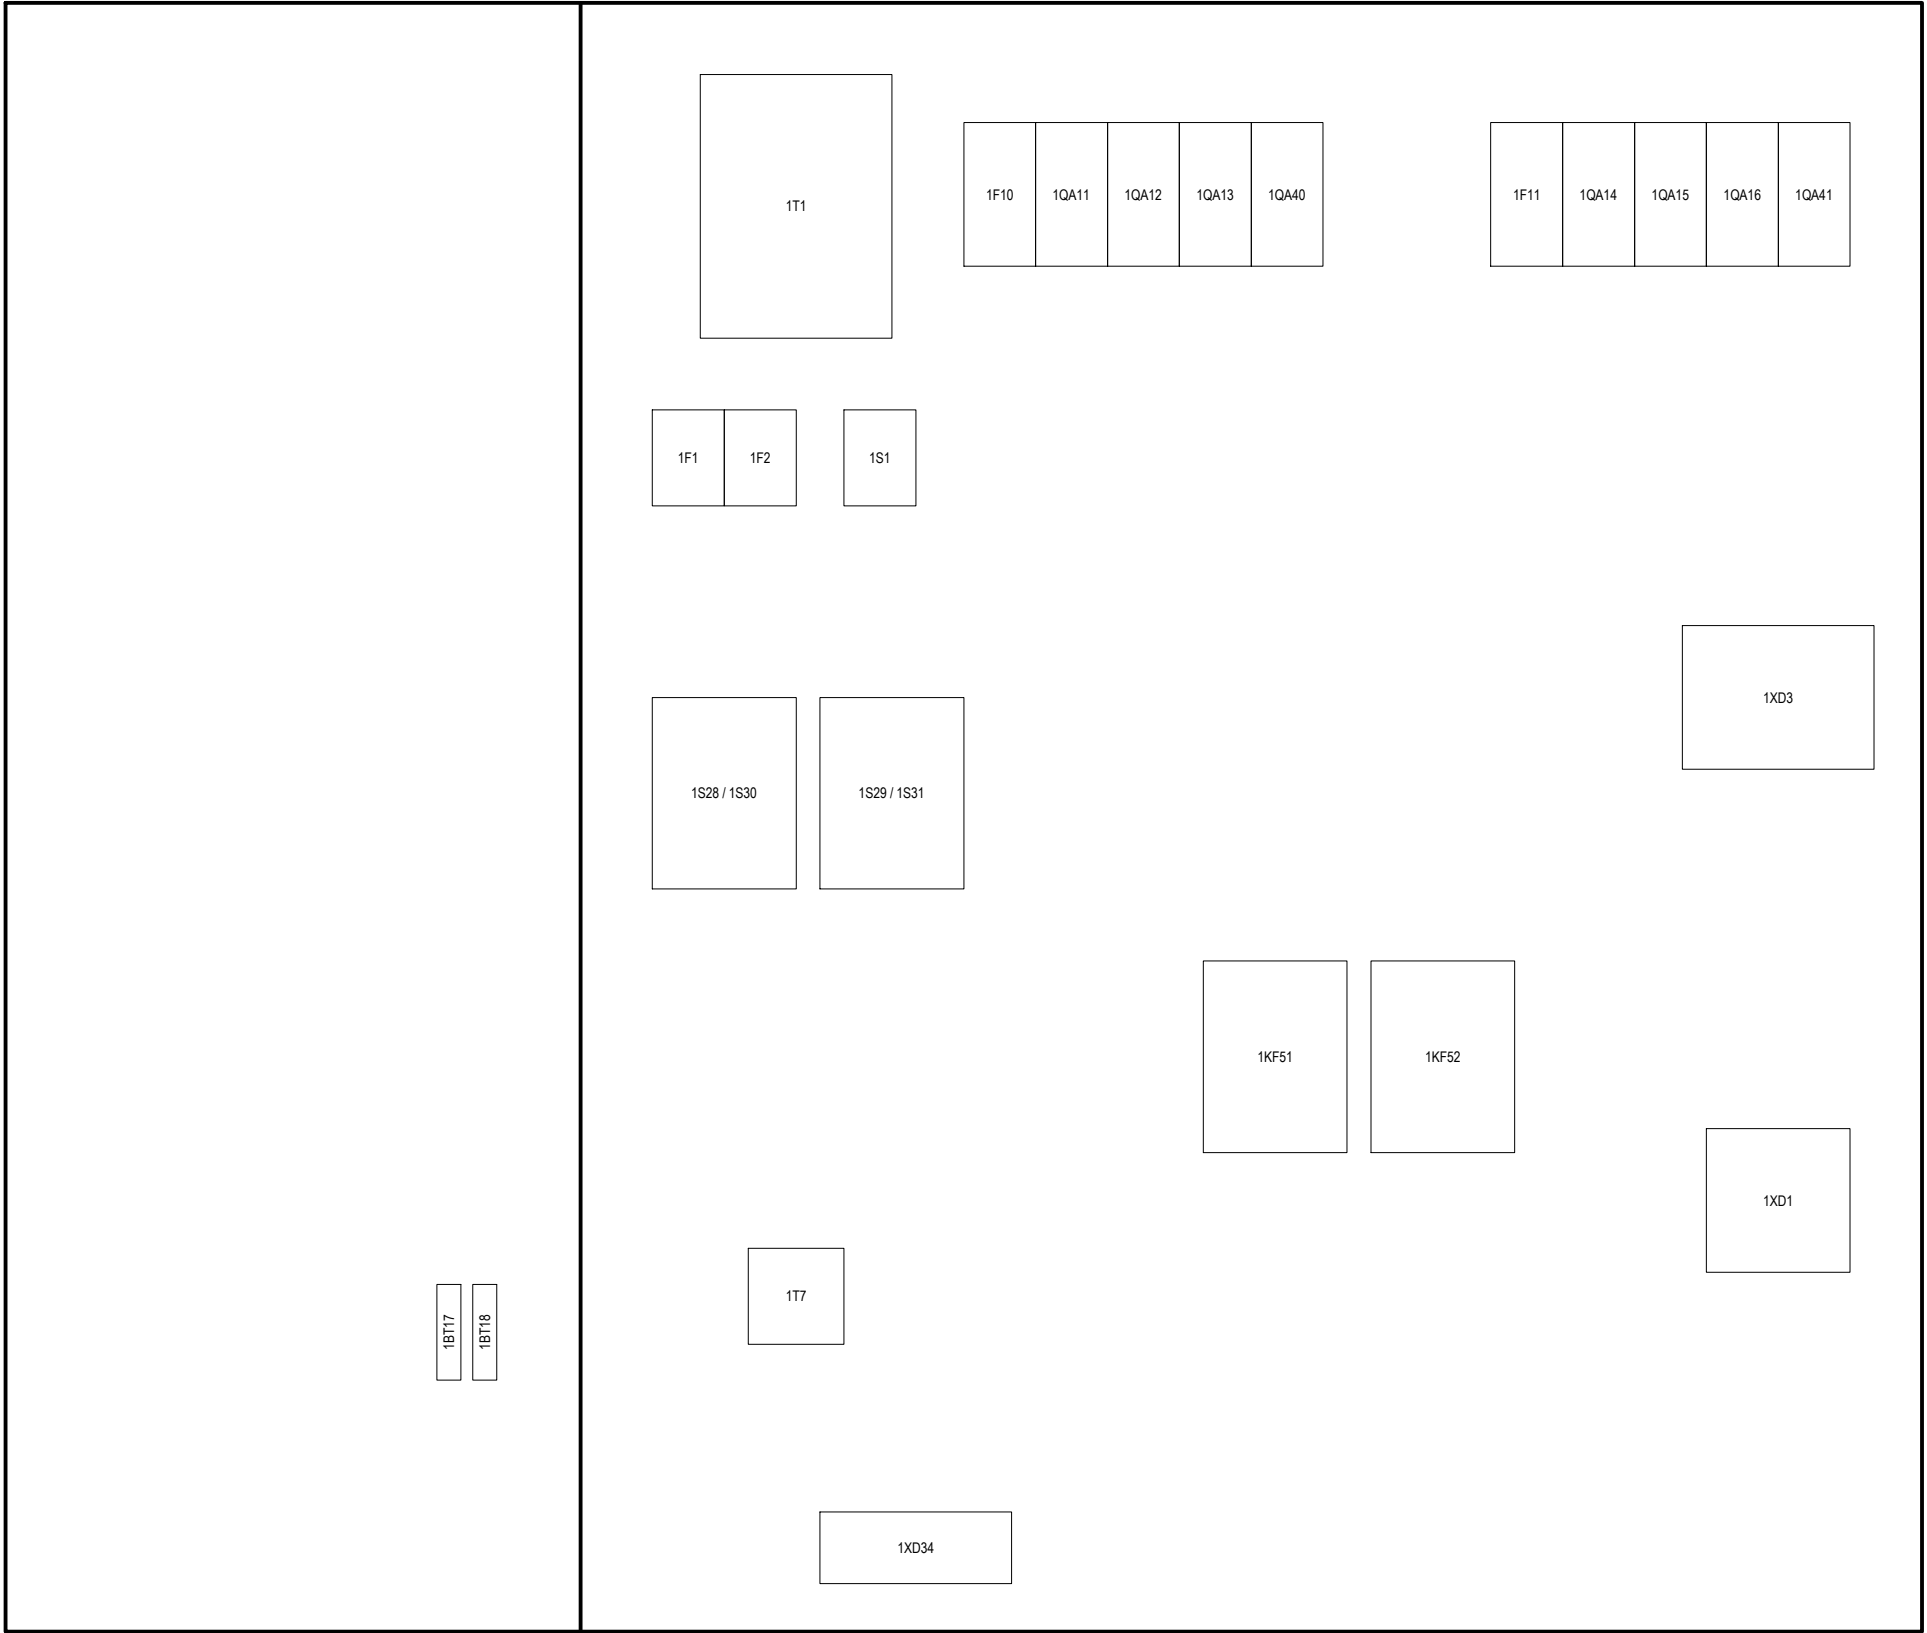

FUSE REPLACEMENT TABLES

CONTROLS TRANSFORMER PROTECTION (1F1, 1F2)	
VOLTAGE	FUSE SIZE
200V	25A CLASS CC TIME DELAY
230V	20A CLASS CC TIME DELAY
380V, 415V	12A CLASS CC TIME DELAY
460V, 575V	8A CLASS CC TIME DELAY

CONDENSER MOTOR CIRCUIT PROTECTION (1F10, 1F11) - x3 EACH	
UNIT CONFIGURATION	FUSE SIZE
20T, 25T, 30T, 40T, 50T, 60T, 80T	30A CLASS CC TIME DELAY
100T, 120T - 380V, 415V, 460V, 575V	30A CLASS CC TIME DELAY
100T, 120T - 200V, 230V	35A CLASS J TIME DELAY

CONTROLS CIRCUIT SWITCH (1S1)
20A CLASS CC TIME DELAY

NOTES: (SEE SHEET 1 FOR STANDARD NOTES 1-3, WIRE COLOR & SYMBOL LEGEND TABLES.)
4. SOME COMPONENTS ARE OPTIONAL AND MAY NOT BE PRESENT.
SEE UNIT SCHEMATICS FOR OPTIONAL UNIT CONFIGURATIONS.

DESIGNER: C.SCHOTT		INTELLICORE CA COMPONENT LOCATION DIAGRAM CONTROL BOX			
ENGINEER: S.MCKINLEY					
TRANE © DATE: 21-JUN-2024					
REPLACES:					
SIMILAR TO:					
REVISION DATE: 14-JAN-2025	THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.	MASTER NUMBER:	DRAWING NUMBER: 12134884	SHEET: 5	REV C
REVISED BY: A.BREWINGTON					
APPROVED BY: S.MCKINLEY					
CAD SYSTEM USED: CREO SCHEMATICS					