


241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300

LEGEND		
REF DES	DESCRIPTION	LINE NO
1KF12	LLID - CAPACITY FEEDBACK	280
1KF13	LLID - EXTERNAL CAPACITY RELAYS	264

1 USE COPPER CONDUCTORS ONLY. UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS. FAILURE TO DO SO MAY DAMAGE TO THE EQUIPMENT. USE CLASS 2 CIRCUIT ONLY.

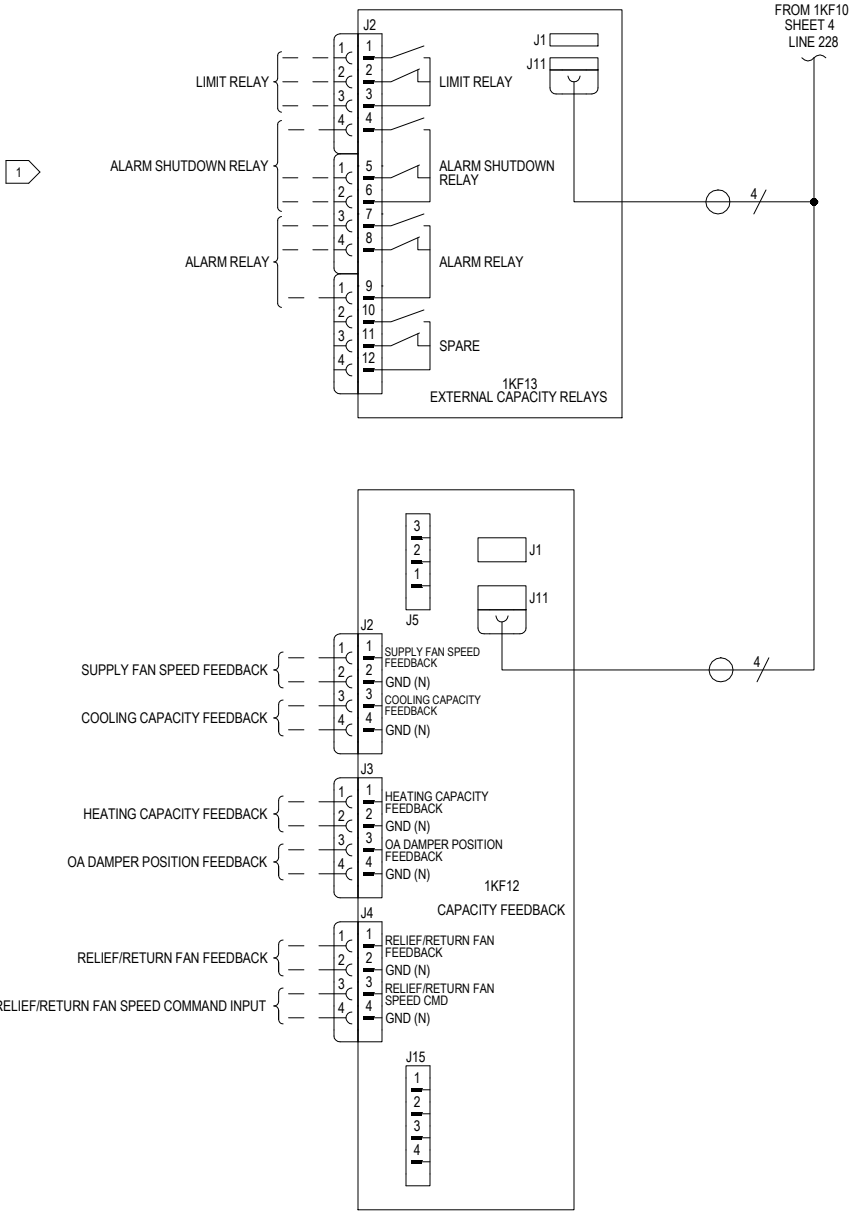

SYMBOL LEGEND					
TRANE WIRING: ———	CUSTOMER PROVIDED: — —	EARTH GROUND:	SPLICE: ●	MULTIPLE WIRE SYMBOL:	SHIELDED CABLE:
FIELD WIRING: — — —	ALTERNATE/OPTIONS: — — —	EQUIPMENT CHASSIS:	JUNCTION: ●	TWISTED CONDUCTORS:	LINE BREAK:
TRANE ® THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.		IPAK 1 SCHEMATIC; CONTROLS 20-130T, CUSTOMER CONNECTIONS #2, EXTERNAL CAPACITY CONTROLS			
DESIGNER: C.CATHCART		ENGINEER: S. MCKINLEY	NUMBER: 12135049	TRANE @ DATE: 14-MAY-2025	REV A
					SHEET 5 of 17