
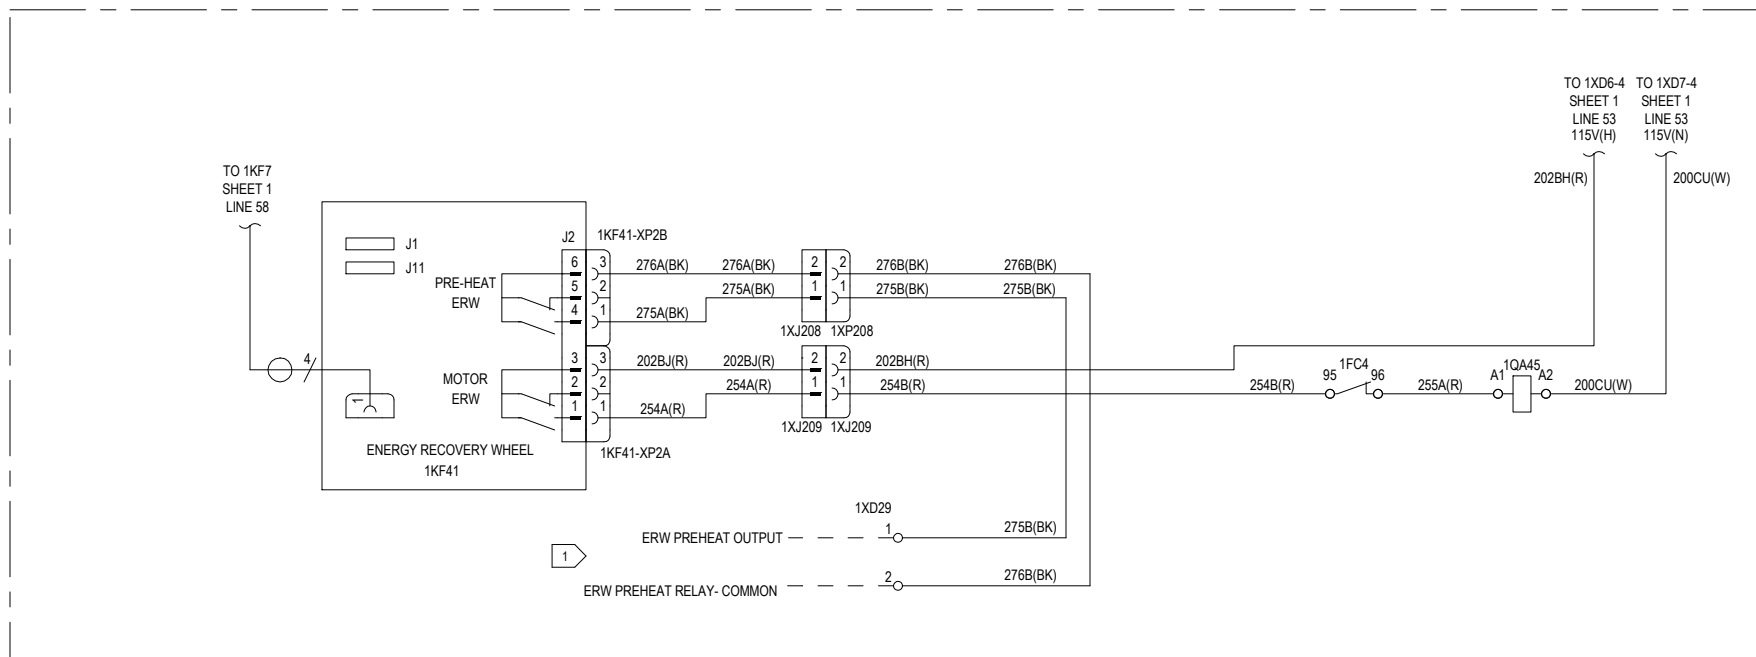
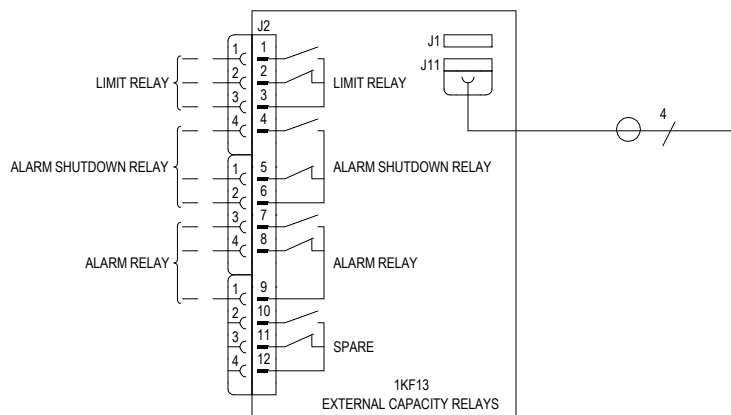


TO 1KF10
SHEET 5
LINE 288

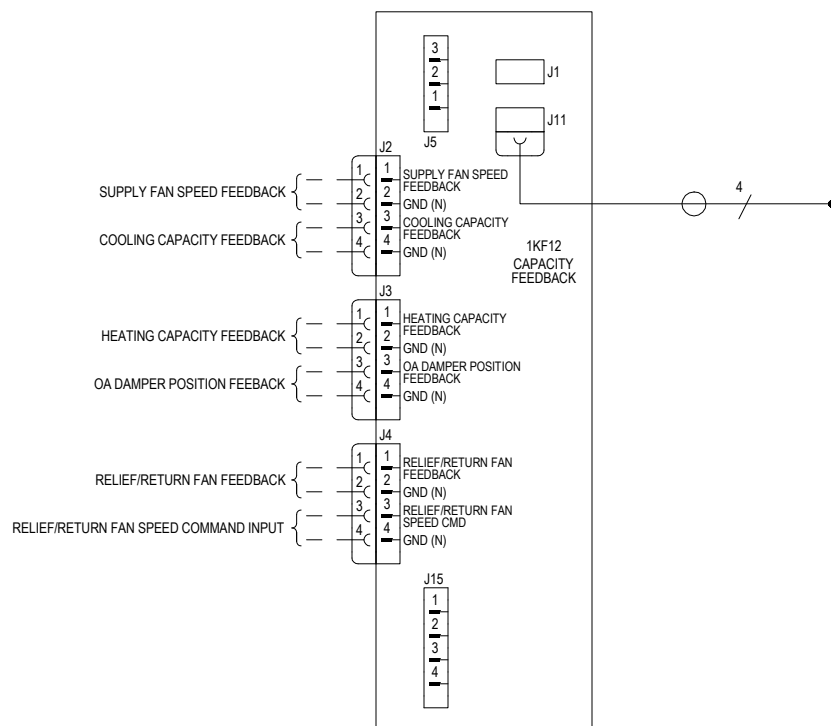

	LEGEND	
REF DES	DESCRIPTION	LINE NO
1FC4	OVERLOAD - ERW MOTOR	343
1KF12	LLID - CAPACITY FEEDBACK	317
1KF13	LLID - EXTERNAL CAPACITY RELAYS	331
1KF41	LLID (DUAL) - ENERGY RECOVERY WHEEL	339
1QA45	CONTACTOR - ERW MOTOR	343
1XD29	TERMINAL BLOCK - ERW	346

NOTES:

1 USE COPPER CONDUCTORS ONLY. UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS. FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT. USE CLASS 2 CIRCUIT ONLY.

SYMBOL LEGEND						
TRANE WIRING: _____	CUSTOMER PROVIDED:  _____	EARTH GROUND: 	SPLICE: 	MULTIPLE WIRE SYMBOL: 	SHIELDED CABLE: 	
FIELD WIRING: _____	ALTERNATE/OPTIONS: _____	EQUIPMENT CHASSIS: 	JUNCTION: 	TWISTED CONDUCTORS: 	LINE BREAK: 	
TRANE® THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.	IPAK 2 SCHEMATIC; CONTROLS 90-150T, CUSTOMER CONNECTIONS #2, EXTERNAL CAPACITY CONTROLS					
	DESIGNER: C.CATHCART	ENGINEER: S.MCKINLEY	NUMBER: 12135052	TRANE © DATE: 15-MAY-2025	REV A	SHEET 6 OF 19