
RELEASED 21/Oct/2026 13:35:52 GMT

LEGEND		
REF DES	DESCRIPTION	LINE NO
AB	MODULE-ADAPTER BOARD	199
CC1	CONTACTOR - COMPRESSOR 1	191
CC1(AUX2)	CONTACTOR - COMPRESSOR 1 AUX 2	187
CC2	CONTACTOR - COMPRESSOR 2	194
CC2(AUX2)	CONTACTOR - COMPRESSOR 2 AUX 2	189
DTL1	SWITCH-DISCHARGE TEMP LIMIT 1	201
DTL2	SWITCH-DISCHARGE TEMP LIMIT 2	208
HPC1	SWITCH-HIGH PRESSURE CUT OUT 1	198
HPC2	SWITCH-HIGH PRESSURE CUT OUT 2	204
VHR	RELAY-VENTILATION HEAT	194
VHR-NC	CONTACT-NORMALLY CLOSED, VHR	190
VHR-NO	CONTACT-NORMALLY OPEN, VHR	189
VHR-TB	TERMINAL BLOCK-VENTILATION HEAT	184

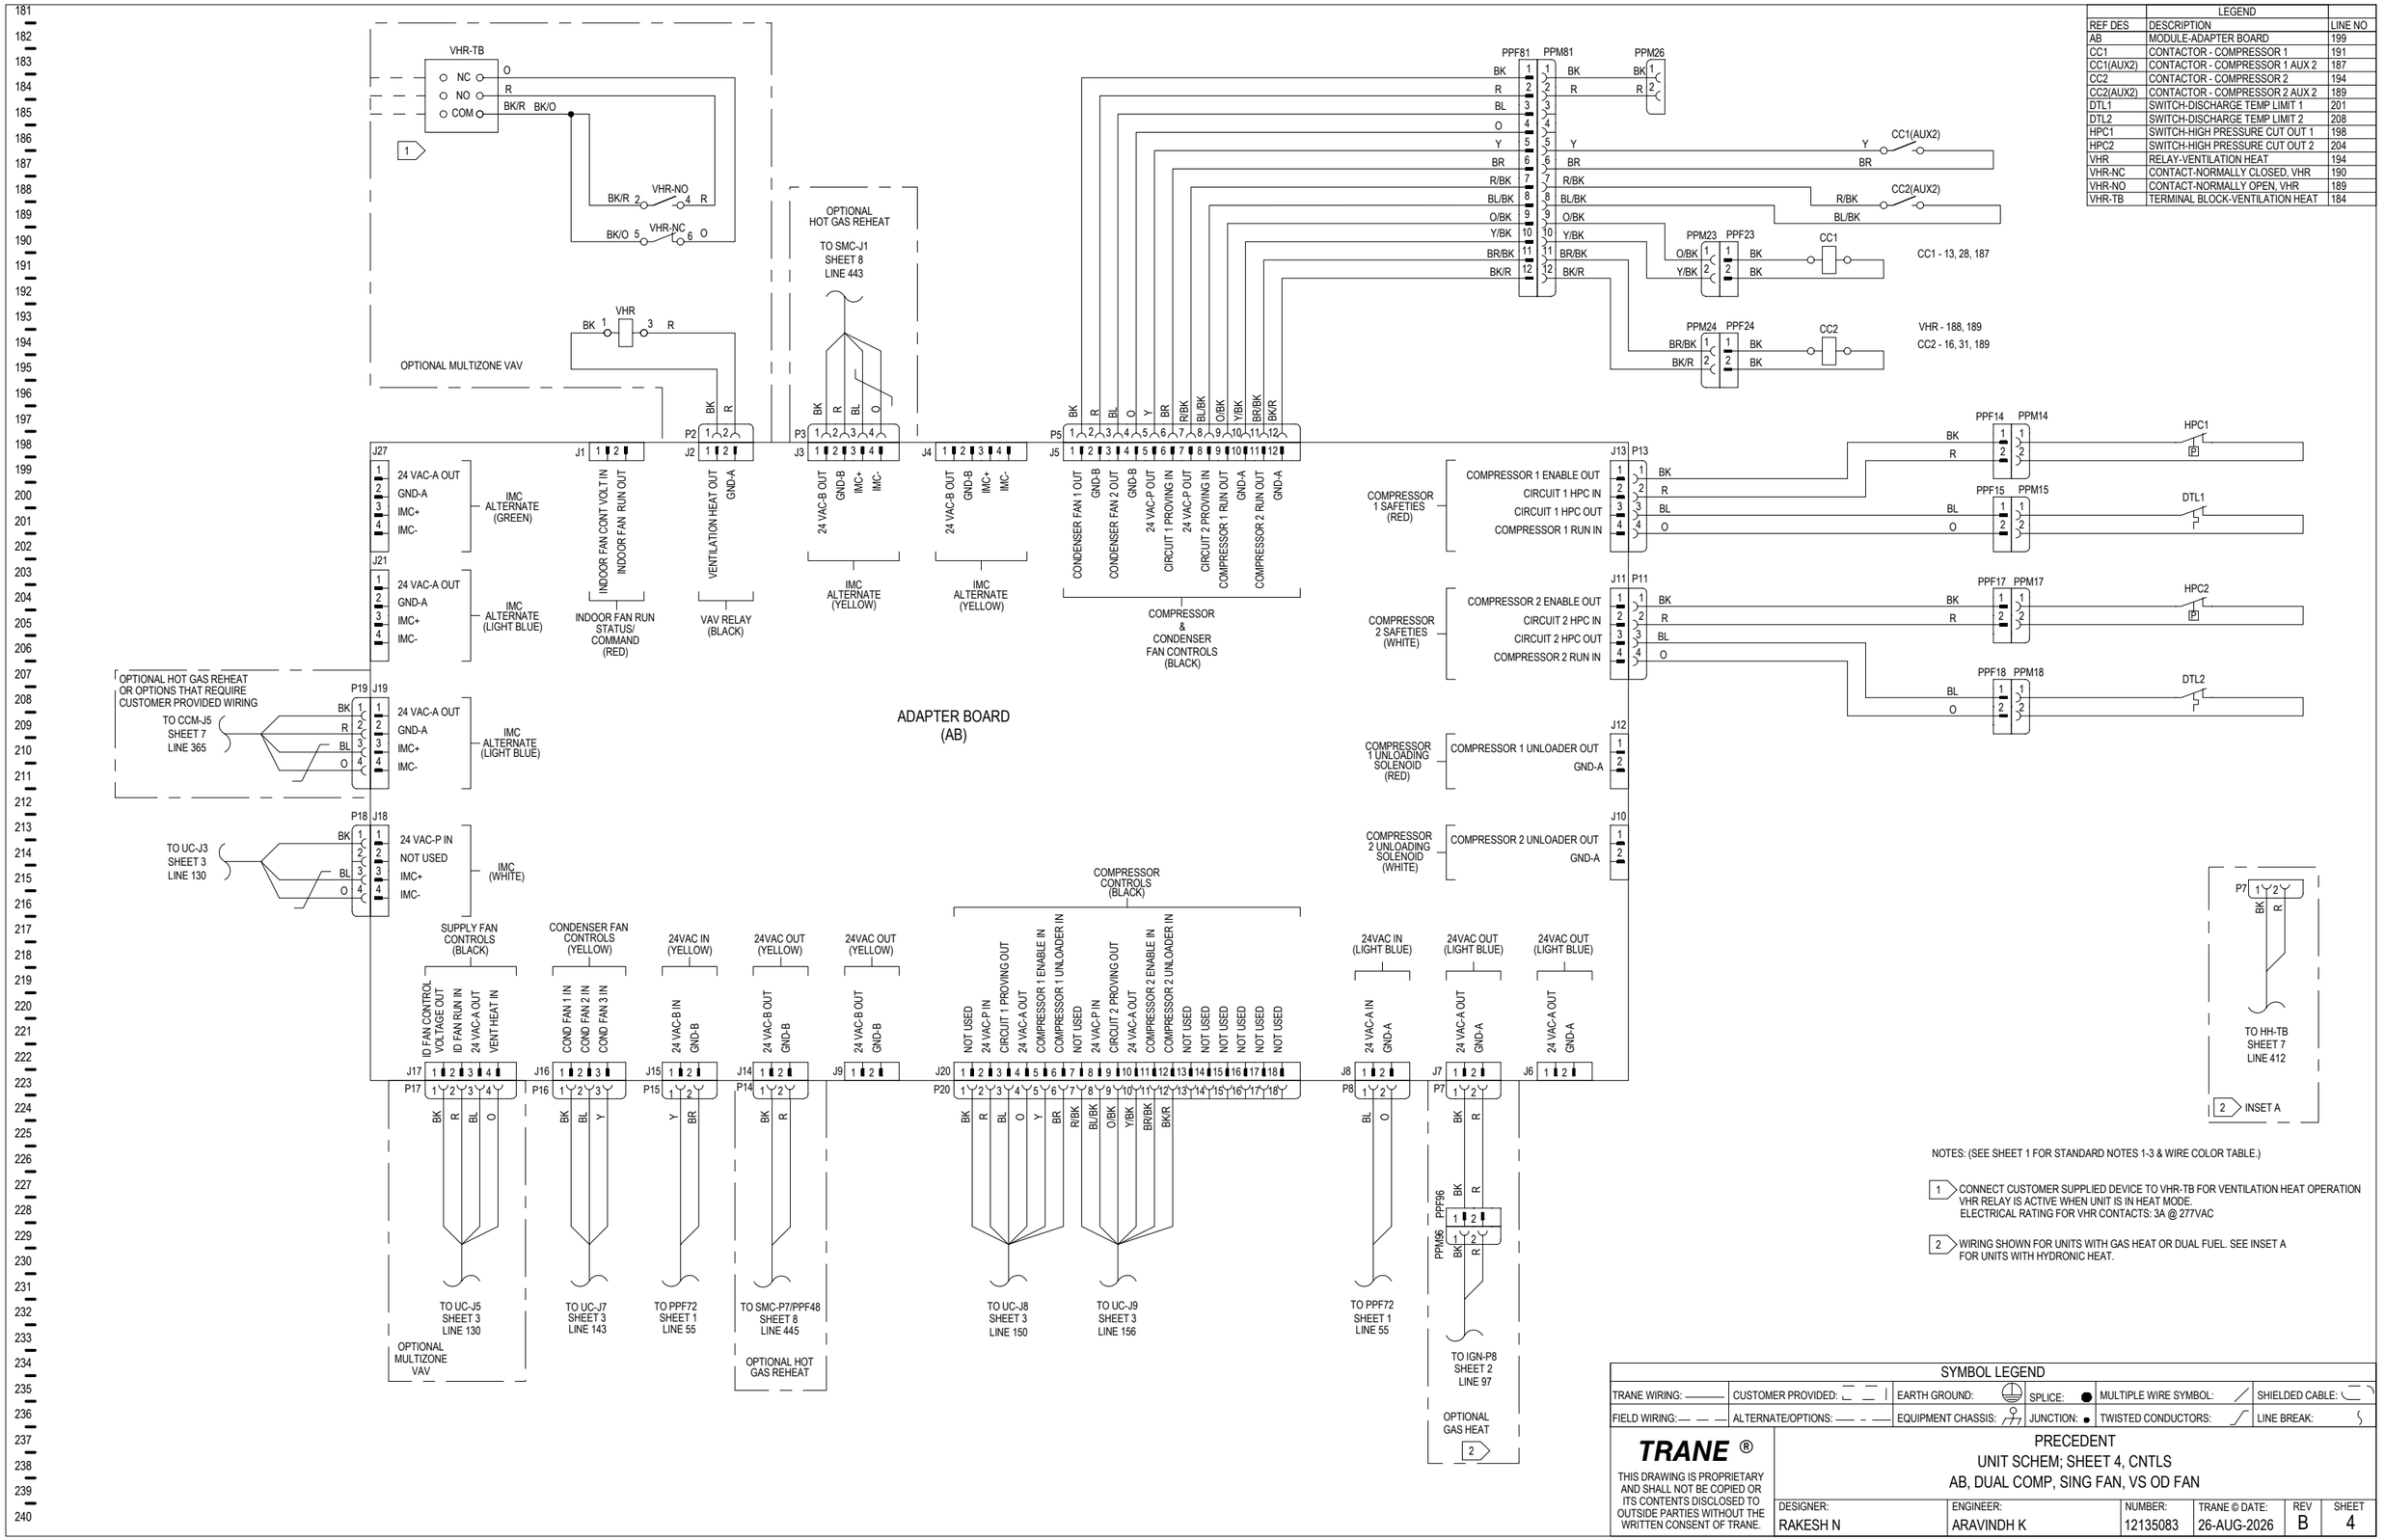

NOTES: (SEE SHEET 1 FOR STANDARD NOTES 1-3 & WIRE COLOR TABLE.)

1. CONNECT CUSTOMER SUPPLIED DEVICE TO VHR-TB FOR VENTILATION HEAT OPERATION VHR RELAY IS ACTIVE WHEN UNIT IS IN HEAT MODE. ELECTRICAL RATING FOR VHR CONTACTS: 3A @ 277VAC

2. WIRING SHOWN FOR UNITS WITH GAS HEAT OR DUAL FUEL. SEE INSET A FOR UNITS WITH HYDRONIC HEAT.

SYMBOL LEGEND

TRANE WIRING:	CUSTOMER PROVIDED:	EARTH GROUND:	SPLICE:	MULTIPLE WIRE SYMBOL:	SHIELDED CABLE:
FIELD WIRING:	ALTERNATE/OPTIONS:	EQUIPMENT CHASSIS:	JUNCTION:	TWISTED CONDUCTORS:	LINE BREAK:

TRANE ®
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

PRECEDENT
UNIT SCHEM; SHEET 4, CNTLS
AB, DUAL COMP, SING FAN, VS OD FAN

DESIGNER:	ENGINEER:	NUMBER:	TRANE © DATE:	REV	SHEET
RAKESH N	ARAVINDH K	12135083	26-AUG-2026	B	4