

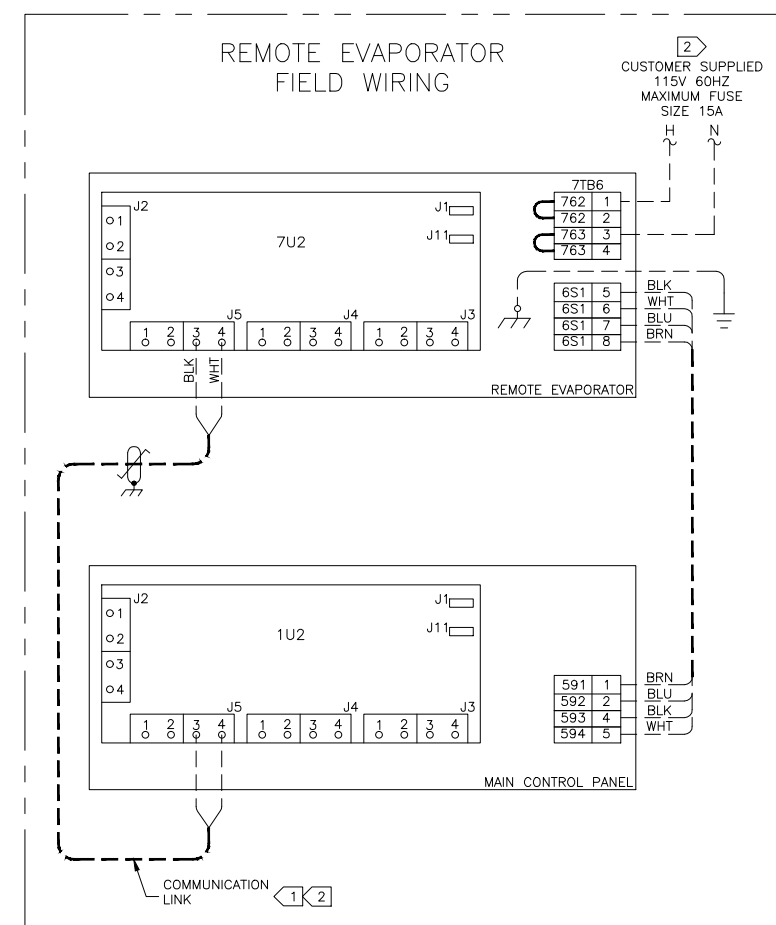
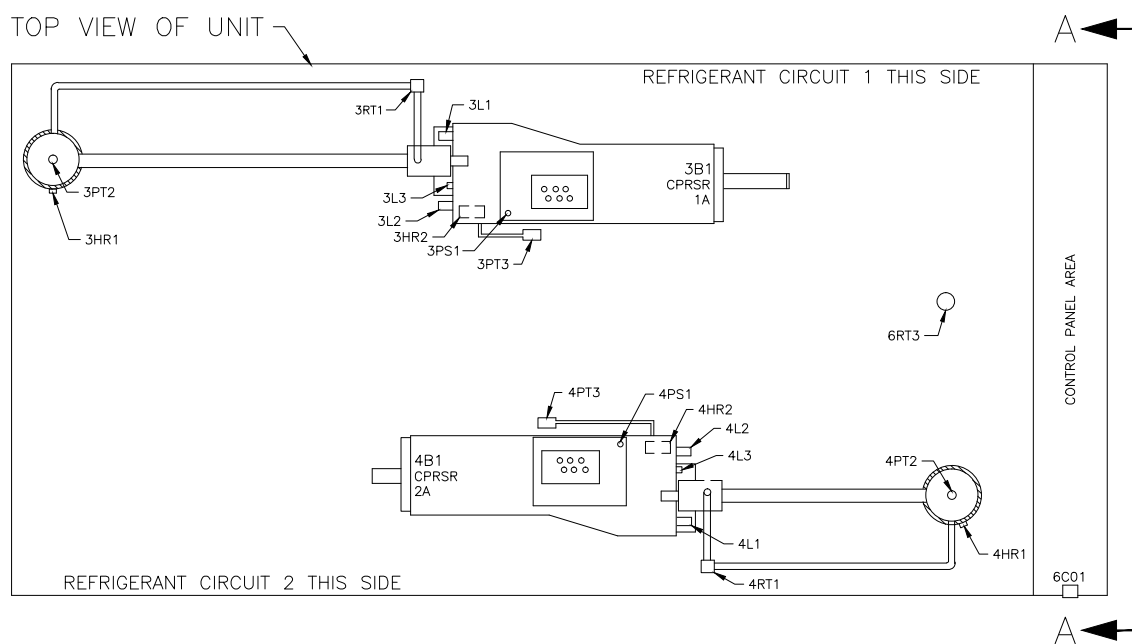
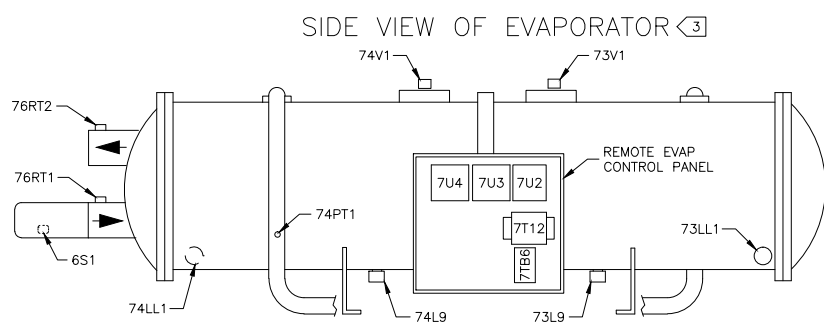


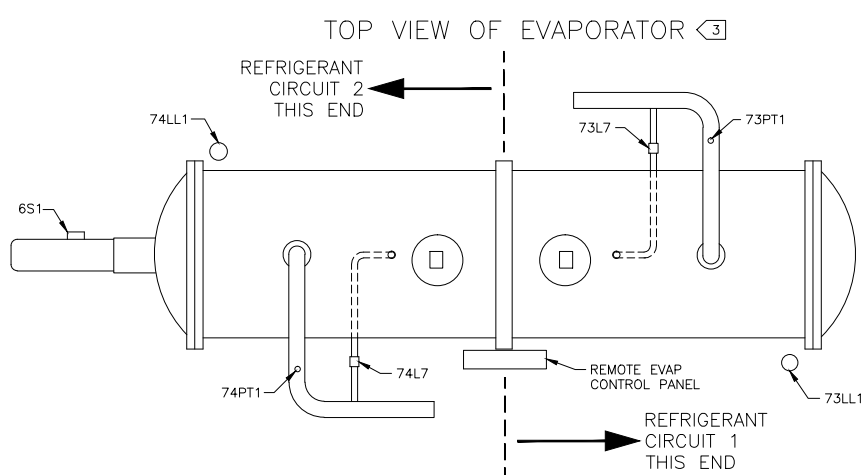

TRANE THIS DRAWING IS PROPERTY OF TRANE. IT IS NOT TO BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.	2309--4872	REV. SHEET 1 OF 1 G
DRAWN BY: PBL REPLACES: REVISION DATE: SIMILAR TO:	COMPONENT LOCATION RTAC MEDIUM AIR COOLED 2 COMPRESSOR UNITS REMOTE EVAPORATOR	

- NOTES:**
1. ALL COMPONENTS & OPTIONS ARE SHOWN. SOME ITEMS MAY NOT BE PRESENT ON ALL PRODUCTS.
 2. RESISTORS 1R1 THRU 1R13 ARE USED ONLY WITH WYE DELTA STARTER. THE ACROSS THE LINE STARTER OPTION USES CONTROLLERS 1K1 AND 1K5 ONLY.
 3. EVAPORATOR WATER PIPING CONNECTIONS ARE SHOWN FOR A 2 PASS EVAPORATOR.
 4. 1U24 = BCI-R BACNET / 1U8 = LCI-C LONTALK.
18U = LCI-C LONTALK COM5 / COM3.
 5. 1T10 AND 1T11 TRANSFORMERS ARE ONLY REQUIRED ON UNITS WITH FAN INVERTER DRIVES AND 575 VOLTS.
 6. INVERTER DRIVES AND 1F18-1F23 ARE PROVIDED ONLY ON LOW OR WIDE AMBIENT TEMPERATURE OPTIONS. 1K13 AND 1K9 ARE NOT USED WITH INVERTERS.

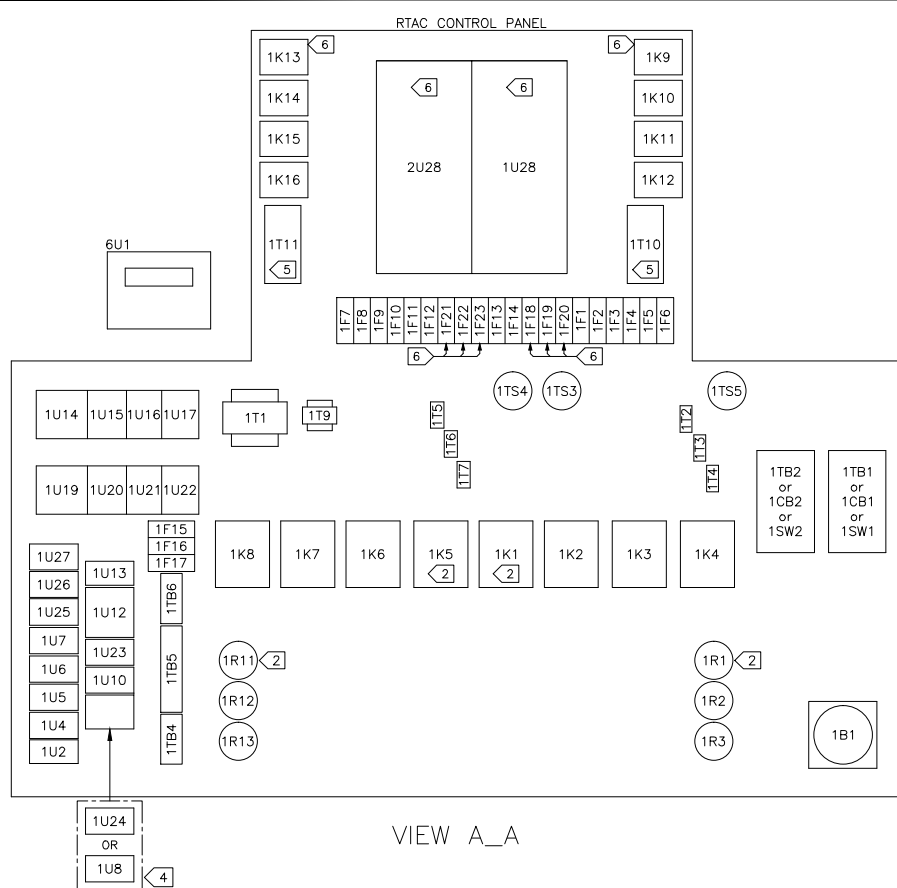