
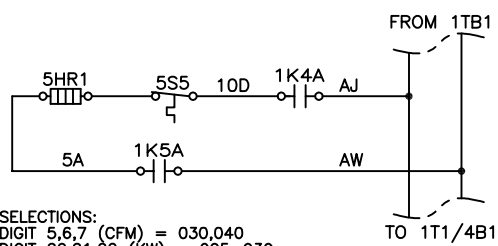



INSET "A" ELECTRIC HEAT:1EH 1STAGE 4

UC400B

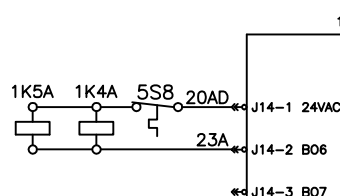


SELECTIONS:
DIGIT 32 (CTYP) = 3 OR 4


CSTI

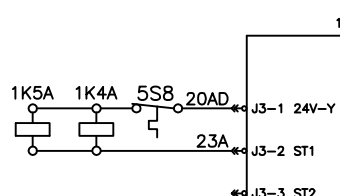

SELECTIONS:
DIGIT 32 (CTYP) = 1 OR 2

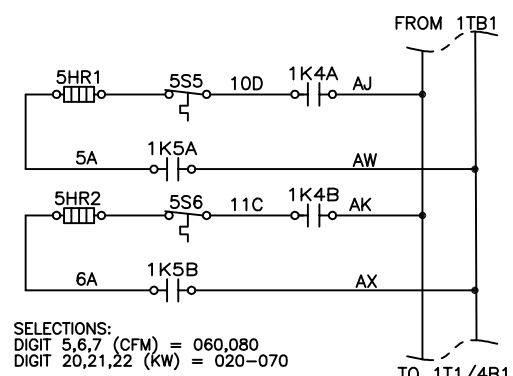
INSET "B" ELECTRIC HEAT:2EH 2STAGE 5

UC400B

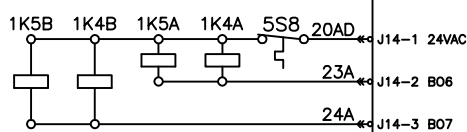


SELECTIONS:
DIGIT 32 (CTYP) = 3 OR 4


CSTI

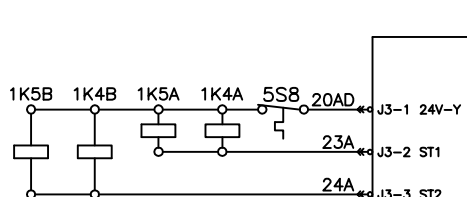

SELECTIONS:
DIGIT 32 (CTYP) = 1 OR 2

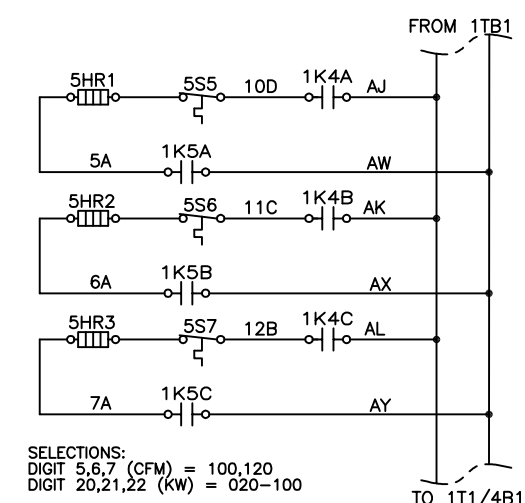
INSET "C" ELECTRIC HEAT:3EH 2STAGE 6

UC400B

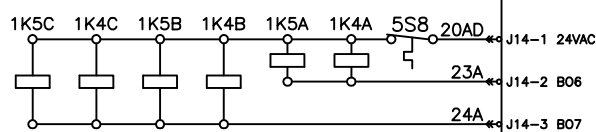

SELECTIONS:
DIGIT 32 (CTYP) = 3 OR 4

CSTI

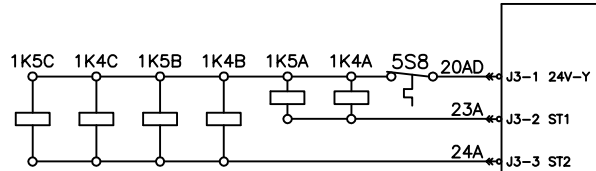

SELECTIONS:
DIGIT 32 (CTYP) = 1 OR 2

NOTES:

1. UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25° C (77° F), WITH ALL UTILITIES TURNED OFF, AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
2. DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINED ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHASES ARE INDICATED BY "A", "B", AND "C". ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS. SOLID LINES INDICATE WIRING BY TRANE.
3. ALL FIELD WIRING MUST BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC). STATE AND LOCAL REQUIREMENTS.

4 INSET A SHOWS THE WIRING FOR ELECTRIC HEAT SCHEMATIC OF 1 EH 1 STAGE

5 INSET B SHOWS THE WIRING FOR ELECTRIC HEAT
SCHEMATIC OF 2 EH 2 STAGE

6 INSET C SHOWS THE WIRING FOR ELECTRIC HEAT SCHEMATIC OF 3 FH 2 STAGE

DEVICE PREFIX LOCATION CODE	
AREA	LOCATION
1	MAIN CONTROL PANEL
2	CONTROL END
3	PIPING END
4	FAN SECTION
5	COIL SECTION
6	CUSTOMER INSTALLED
7	FIELD SUPPLIED DEVICE

[illegible]

REVISED	NAME	23114815	NO
REVISION DATE			
DRAWN BY			
DATE			
01-AUGUST-2017	<p>THIS DRAWING IS THE PROPERTY OF THE U.S. GOVERNMENT AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM THE U.S. GOVERNMENT</p> <p>© DISC</p>	<p>SCHEMATIC DIAGRAM</p> <p>VERTICAL HI RISE FC - FCV</p> <p>EH SCHEMATIC</p> <p>SHEET 3</p>	