


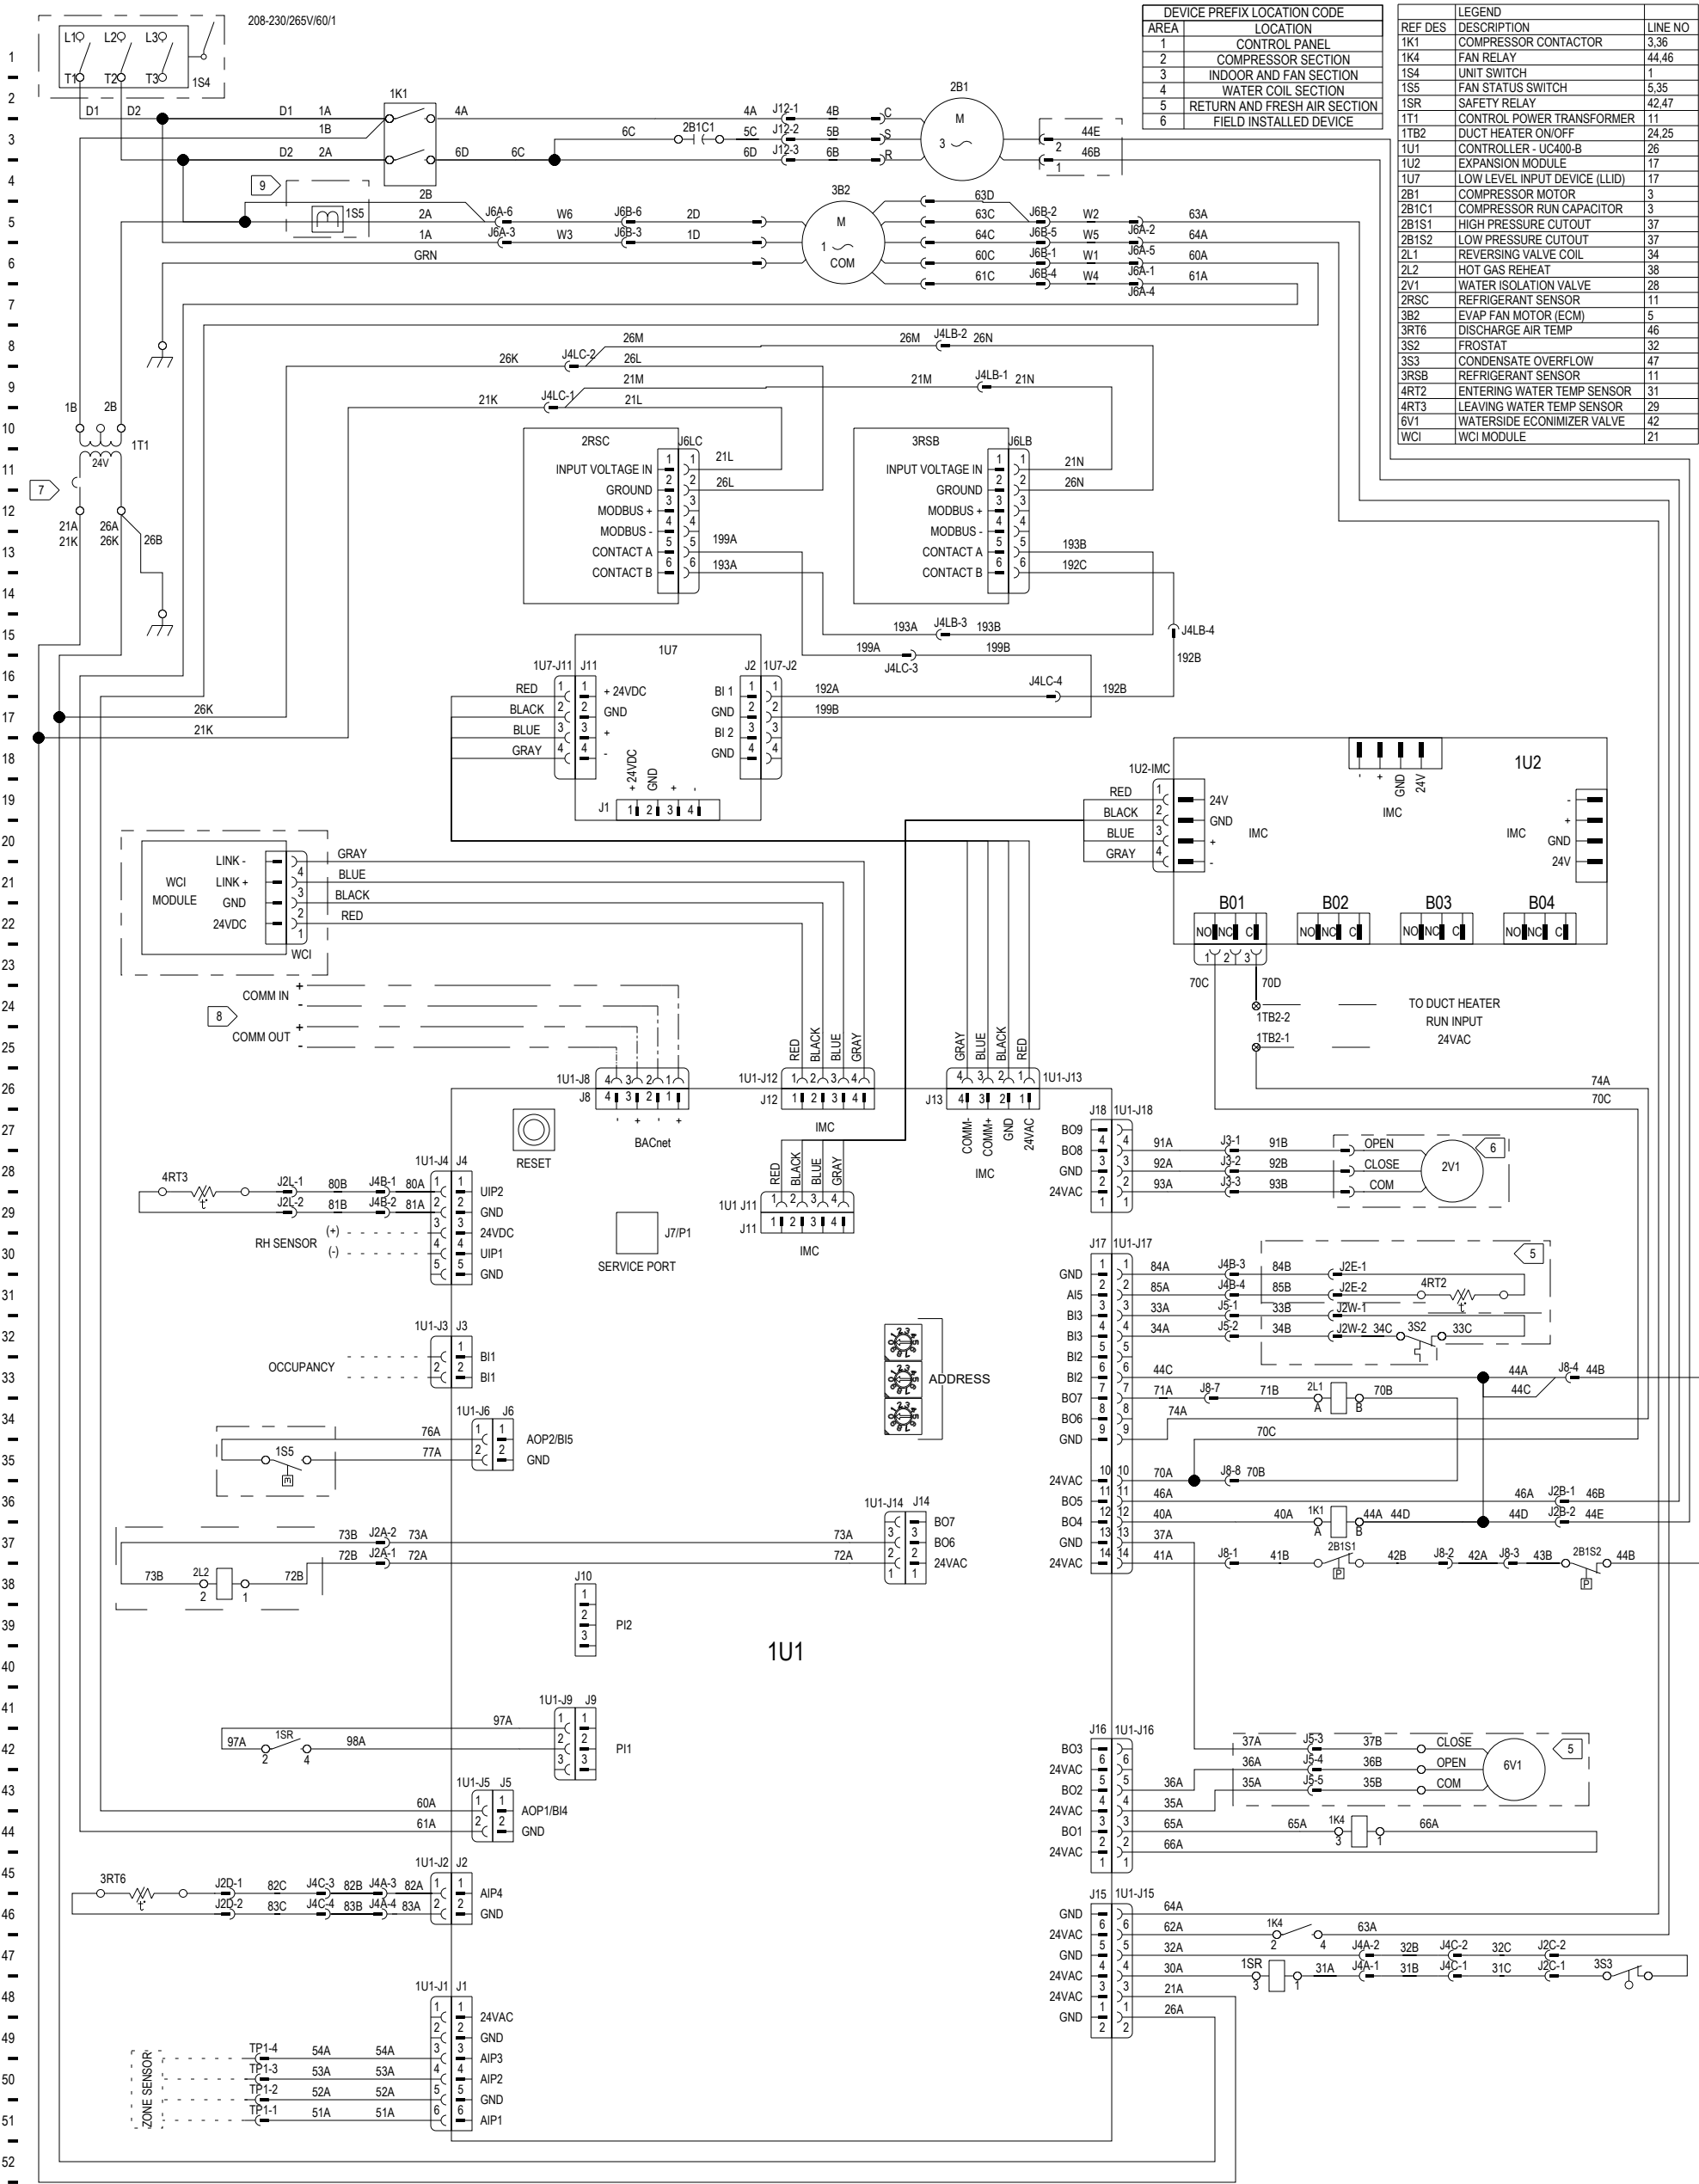

DEVICE PREFIX LOCATION CODE	
AREA	LOCATION
1	CONTROL PANEL
2	COMPRESSOR SECTION
3	INDOOR AND FAN SECTION
4	WATER COIL SECTION
5	RETURN AND FRESH AIR SECTION
6	FIELD INSTALLED DEVICE

REF DES	DESCRIPTION	LINE NO
1K1	COMPRESSOR CONTACTOR	3,36
1K4	FAN RELAY	44,46
1S4	UNIT SWITCH	1
1S5	FAN STATUS SWITCH	5,35
1SR	SAFETY RELAY	42,47
1T1	CONTROL POWER TRANSFORMER	11
1T2	DUCT HEATER ON/OFF	24,25
1U1	CONTROLLER - UC400-B	26
1U2	EXPANSION MODULE	17
1U7	LOW LEVEL INPUT DEVICE (LLID)	17
2B1	COMPRESSOR MOTOR	3
2B1C1	COMPRESSOR RUN CAPACITOR	3
2B1S1	HIGH PRESSURE CUTOUT	37
2B1S2	LOW PRESSURE CUTOUT	37
2L1	REVERSING VALVE COIL	34
2L2	HOT GAS REHEAT	38
2V1	WATER ISOLATION VALVE	28
2RSC	REFRIGERANT SENSOR	11
3B2	EVAP FAN MOTOR (ECM)	5
3RT6	DISCHARGE AIR TEMP	46
3S2	FROSTAT	32
3S3	CONDENSATE OVERFLOW	47
3RSB	REFRIGERANT SENSOR	11
4RT2	ENTERING WATER TEMP SENSOR	31
4RT3	LEAVING WATER TEMP SENSOR	29
6V1	WATERSIDE ECONIMIZER VALVE	42
WCI	WCI MODULE	21

- NOTES:
- UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25° C (77° F) AT ATMOSPHERIC PRESSURE, AT 50% RELATIVE HUMIDITY, WITH ALL UTILITIES TURNED OFF, AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
 - DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS. SOLID LINE INDICATES WIRING BY TRANE CO.
 - NUMBERS ALONG THE RIGHT SIDE OF THE SCHEMATIC DESIGNATE THE LOCATION OF CONTACTS BY THE LINE NUMBER. AN UNDERLINED NUMBER INDICATES A NORMALLY CLOSED CONTACT. AN OPEN ARROW BELOW THE LINE NUMBER POINTING UPWARD INDICATES A TIMED CONTACT WHICH BEGINS TIMING WHEN ENERGIZED.
 - ALL FIELD WIRING MUST BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC), STATE AND LOCAL REQUIREMENTS. ALL LOW VOLTAGE FIELD CONNECTIONS ARE CLASS 2.
- 5 WSE VALVE PLUG AND ENTERING WATER SENSOR BULB ARE COILED UP BEHIND CONTROL BOX. SENSOR BULB MUST BE FIELD MOUNTED ON ENTERING WATER LINE OF WSE VALVE.
- 6 FOR TWO WIRE VALVES CONNECT TO WIRES 91B AND 93B
- 7 FOR 208/230V UNITS TRANSFORMER IS FACTORY WIRED FOR 230V. FOR 208V APPLICATION MOVE PRIMARY WIRE FROM THE 230V TAB TO THE 208V TAB.
- 8 USE 18 AWG (25PF/FT. NOM.) COMMUNICATION WIRE STYLE. BRAID OR FOIL SHIELDED TWISTED PAIR, IMPEDANCE 60.7 OHMS, 4,000 FT. MAXIMUM LENGTH CAUTION! DO NOT RUN POWER IN THE SAME CONDUIT WITH COMMUNICATION WIRE
- 9 WIRE 2A MUST PASS THROUGH DEVICE CENTRE 2 TIMES FOR PROPER OPERATION.

⚠ WARNING

HAZARDOUS VOLTAGE!

⚠ AVERTISSEMENT

TENSION DANGEREUSE!

⚠ ADVERTENCIA

¡VOLTAJE PELIGROSO!

DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS AND FOLLOW LOCK OUT AND TAG PROCEDURES BEFORE SERVICING. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITS WITH VARIABLE SPEED DRIVE, REFER TO DRIVE INSTRUCTIONS FOR CAPACITOR DISCHARGE.

COUPER TOUTES LES TENSIONS ET OUVRIRE LES SECTIONNEURS A DISTANCE, PUIS SUIVRE LES PROCEDURES DE VERROUILLAGE ET DES ETIQUETTES AVANT TOUTE INTERVENTION. VERIFIER QUE TOUTS LES CONDENSATEURS DES MOTEURS SONT DECHARGES. DANS LE CAS D'UNITES COMPORTANT DES ENTRAÎNEMENTS A VITESSE VARIABLE, SE REPORTER AUX INSTRUCTIONS DE L'ENTRAÎNEMENT POUR DECHARGER LES CONDENSATEURS.

DESCONECTE TODA LA ENERGÍA ELÉCTRICA, INCLUSO LAS DESCONEXIONES REMOTAS Y SIGA LOS PROCEDIMIENTOS DE CIERRE Y ETIQUETADO ANTES DE PROCEDER AL SERVICIO. ASEGURESE DE QUE TODOS LOS CAPACITORES DEL MOTOR HAYAN DESCARGADO EL VOLTAJE ALMACENADO. PARA LAS UNIDADES CON EJE DE DIRECCION DE VELOCIDAD VARIABLE, CONSULTE LAS INSTRUCCIONES PARA LA DESCARGA DEL CONDENSADOR.

FAILURE TO DO THE ABOVE BEFORE SERVICING COULD RESULT IN DEATH OR SERIOUS INJURY.

NE PAS RESPECTER CES MESURES DE PRECAUTION PEUT ENTRAÎNER DES BLESSURES GRAVES POUVANT ÊTRE MORTELLES.

EL NO REALIZAR LO ANTERIORMENTE INDICADO, PODRÍA OCASIONAR LA MUERTE O SERIAS LESIONES PERSONALES.

DESIGNER:	SULTHAN MOHIDDIN
ENGINEER:	M COOMBS
TRANE © DATE:	20-FEB-2024
REPLACES:	
SIMILAR TO:	
REVISION DATE:	
REVISED BY:	
APPROVED BY:	
CAD SYSTEM USED:	CREO SCHEMATICS

TRANE®

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

WSHP SCHEMATIC DIAGRAM			
400B EH W/HGR, LDS, 1PH GE/EX/DX			
MASTER NUMBER:	DRAWING NUMBER:	SHEET:	REV
	23116503	1 OF 1	A