

TRANE

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.

DRAWN BY:

M.FRITZ

TRANE© DATE:

01/17/2019

REPLACES:

4367-0373

REVISION DATE:

07/12/2019

CAD SYSTEM USED:

Pro/DIAGRAM

SIMILAR TO:

--

FILE NUMBER:

DRAWING NUMBER:

43675765

SHEET:

1 of 1

REV

B

ODYSSEY

DIAGRAM

SCHEMATIC/CONNECTION
5.00/9.96KW ELECTRIC HEAT
460/575V 3PH

MATERIAL:

MAC-TAC MR1 LABEL MATERIAL (WHITE IN COLOR)
WITH L23 L50 ADHESIVE LINER.

ALTERNATE MATERIAL:


FLEXCON VINYL V400 HW TC-160 LABEL MATERIAL
(WHITE IN COLOR) WITH V-23 90 PFW ADHESIVE LINER.

NOTES:

ALL PRINTING TO BE BLACK

SIZE:

8.25 X 10.00

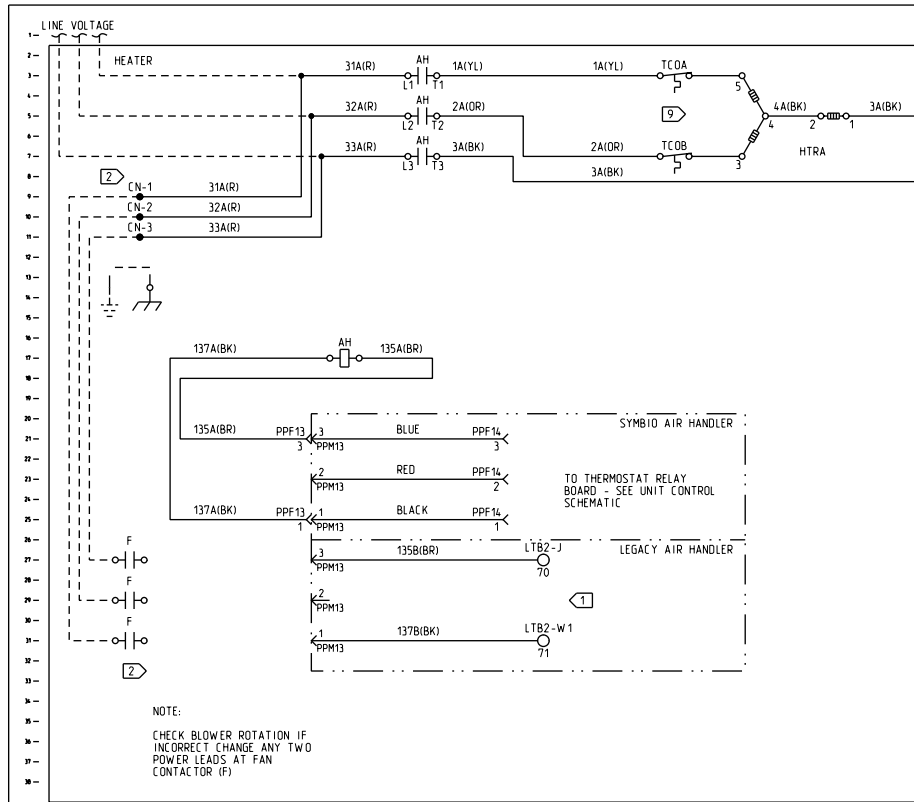

NOTE:
CHECK BLOWER ROTATION IF
INCORRECT CHANGE ANY TWO
POWER LEADS AT FAN
CONTACTOR (F)

LEGEND		
DEVICE DESIG	DESCRIPTION	LINE NUMBER
AH	CONTACTOR - HEATER	3.5.7.17
CN-1	CONNECTOR - WIRE NUT #1	9
CN-2	CONNECTOR - WIRE NUT #2	10
CN-3	CONNECTOR - WIRE NUT #3	11
F	CONTACTOR - INDOOR FAN	27.29.31
HTRA	HEATER RACK	3
LTB2	TERMINAL BLOCK - LOW VOLTAGE	27.31
TCOA	SWITCH - TEMP LIMIT	3
TCOB	SWITCH - TEMP LIMIT	7

AH - 3.5.7.17 8

ELECTRICAL RATING		
VOLTS	KW	AMPS
480	5.00	6
480	9.96	12
600	5.00	5
600	9.96	10

WIRE COLORS	
ABBR	COLOR
BK	BLACK
BR	BROWN
R	RED
YL	YELLOW
OR	ORANGE

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

PRECAUCIÓN

N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!

LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.

L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'EQUIPEMENT.

ATTENTION

UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!

LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.

SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

NOTES:

- FIELD CONNECT CONTROL LEADS AS SHOWN:
137B(BK) - LTB2-W1 (FIRST STAGE HEAT)
135B(BR) - LTB2-J (HEATER/FAN INTERLOCK)
- WHEN USING SINGLE POINT POWER ENTRY THROUGH ELECTRIC HEAT CONTROL BOX, REMOVE CONNECTORS CN-1 AND CN-2 AND CN-3 FROM THE END OF WIRES 31A(R) AND 32A(R) AND 33A(R) THEN TERMINATE THEM INTO BOX LUGS LOCATED ON THE BOTTOM OF THE INDOOR FAN CONTACTOR IN THE AIR HANDLER CONTROL BOX. SEE THE ELECTRIC HEAT INSTALLER'S GUIDE FOR INSTALLATION INSTRUCTIONS.
- UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25°C (77°F) AT ATMOSPHERIC PRESSURE. AT 50% RELATIVE HUMIDITY WITH ALL UTILITIES TURNED OFF AND AFTER A NORMAL SHUTDOWN HAS OCCURED.
- DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS.
- NUMBERS ALONG THE RIGHT SIDE OF THE SCHEMATIC DESIGNATE THE LOCATION OF CONTACTS BY THE LINE NUMBER. AN UNDERLINED NUMBER INDICATES A NORMALLY CLOSED CONTACT.
- THERMOSTAT DEVICES ARE EQUIPPED WITH AN AUTO-RESETTING THERMAL LIMIT SWITCH AND ONE-SHOT THERMAL LIMIT FUSE.

PRINTED FROM 43675765 REV B