
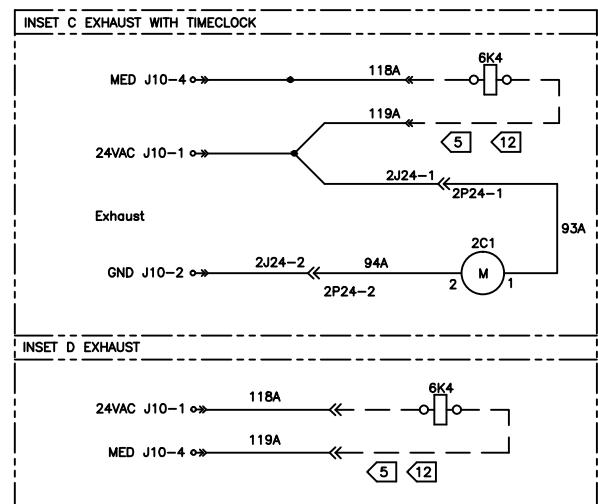


1U1 (ZN520) GRN

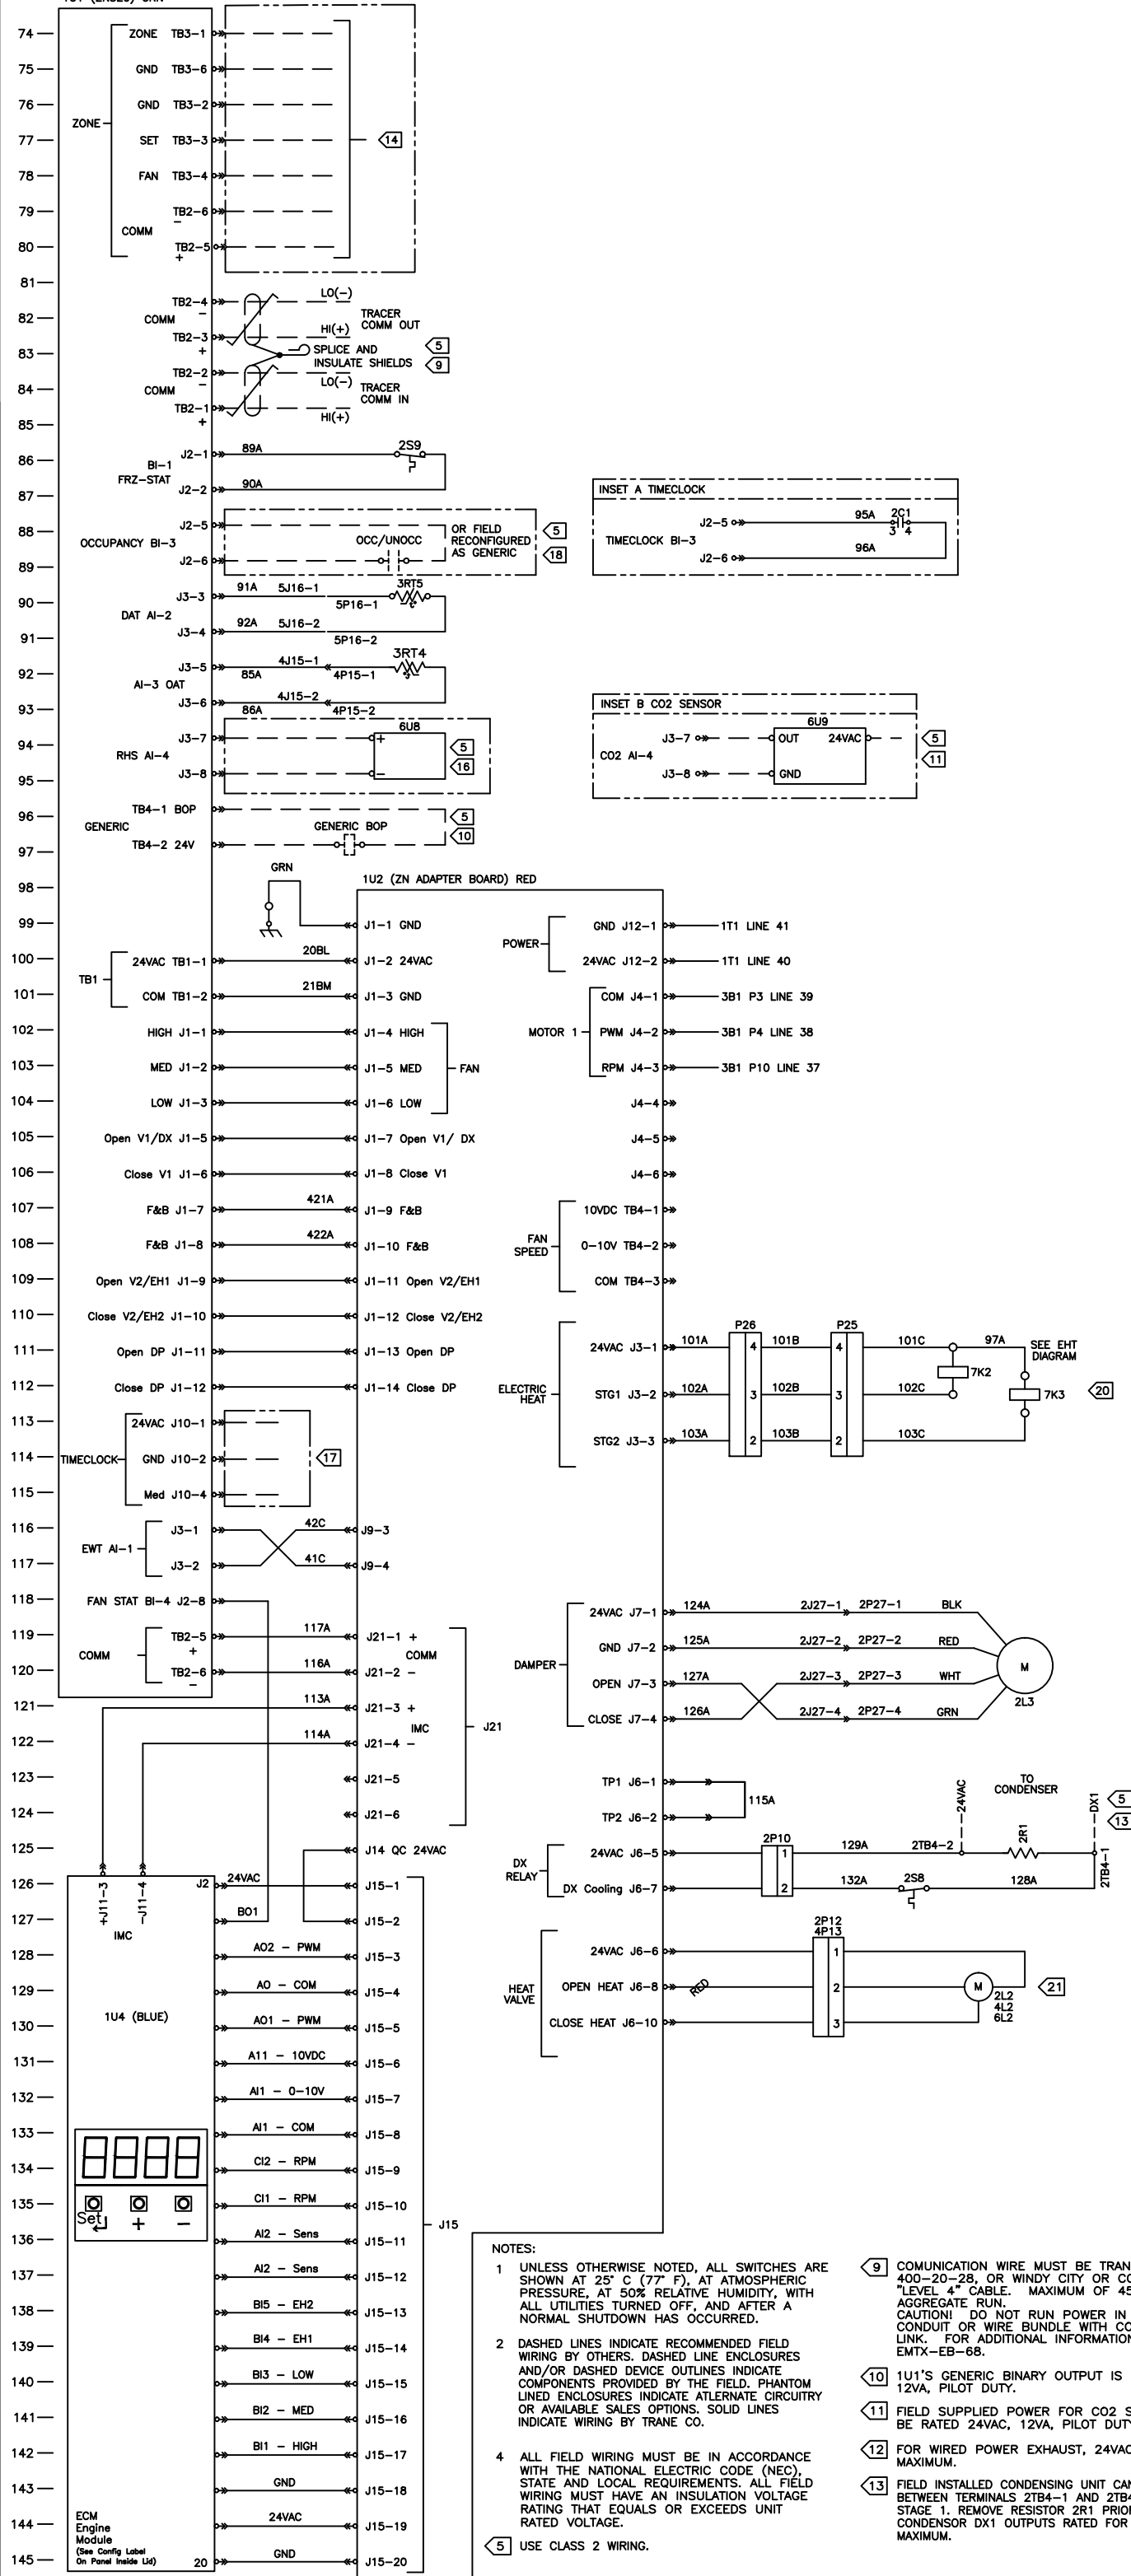

DEVICE PREFIX LOCATION CODE	
AREA	LOCATION
1	LH CONTROL PANEL
2	LH END POCKET
3	AIR SECTION
4	RH END POCKET
5	TOP ACCESS PANEL
6	FIELD INSTALLED
7	RH CONTROL BOX E-HT

LEGEND		
DEVICE DESIGNATION	DESCRIPTION	LINE NUMBER
1U1	ZN520	74
6K4	EXHAUST RELAY	75,82
2C1	TIMECLOCK	79,88
2S9	FREEZE STAT	86
3RT5	DISCHARGE AIR TEMP SNSR	90
3RT4	OUTSIDE AIR TEMP SENSOR	92
6U8	RELATIVE HUMIDITY SENSOR	94
6U9	CO2 SENSOR	94
1U2	ADAPTER BOARD	98
7K2	EH STAGE 1	111
7K3	EH STAGE 2	112
2L3	OUTSIDE AIR DAMPER ACTUATOR	120
2R1	RESISTOR; DX STG 1 TEST	125
2S8	FROST STAT	126
2L2	HEATING COIL VALVE MOTOR	129
4L2	HEATING COIL VALVE MOTOR	129
6L2	HEATING COIL VALVE MOTOR	129
1U4	ENGINE BOARD	130

- 14 SEE SHEET 2311-4274 FOR ZONE SENSOR CONNECTIONS.
- 16 WIRING SHOWN IS FOR RELATIVE HUMIDITY SENSOR SEE INSET "B" FOR CO2 SENSOR.
- 17 SEE INSET "C" FOR EXHAUST W/ TIMECLOCK CONNECTIONS. AND INSET "D" FOR EXHAUST CONNECTIONS.
- 18 WIRING SHOWN IS FOR OCCUPIED/ UNOCCUPIED. SEE INSET A FOR TIMECLOCK CONNECTIONS. SEE INSET "C" FOR EXHAUST WITH TIMECLOCK.
- 20 SEE ELECTRIC HEAT SCHEMATIC PAGE FOR ADDITIONAL ELECTRIC HEAT WIRING.
- 21 FIELD SUPPLIED ACTUATOR WIRING UTILIZES THE SAME CONNECTION POINTS AS FACTORY ACTUATOR WIRING.

REMARKS	TRANSE	4619-3719	REV
REVISION DATE	THIS DRAWING IS CONTROLLED BY THE PROJECT MANAGER AND THE PROJECT MANAGER'S OFFICE. ANY CHANGES TO THIS DRAWING MUST BE APPROVED BY THE PROJECT MANAGER. © 2000	SCHEMATIC DIAGRAM	REV
DRAWN BY		HORIZONTAL UNIT VENT	
B. SPAN/HOUR		ZNS20	
DATE	SMAJAS TO	DX COLLS	
3-MAY-2019			