

INSTALLATION INSTRUCTIONS

18-GJ30D1-1A-EN

ALL phases of this installation must comply with NATIONAL,
STATE AND LOCAL CODES

Model:
CNT06194

24 Volt Electric Heat Control for Air Handler Installations


IMPORTANT — This Document is customer property and is to remain with this unit. Please return to service information pack upon completion of work.

1. Remove the existing control.
 - a. Remove the factory wiring connections. Label wires as necessary.
 - b. Remove the 1/4" ground screw.
 - c. Push the top of the two plastic tabs outward to release the control board.
2. Install the new control in reverse order. Set dip switches per the table below.

CONFIGURATION DIP SWITCH SETTINGS

- Electronic Heat Control

Model	DS1-1	DS1-2
BAYE AAC05BK1AA	OFF	OFF
BAYE AAC05LG1AA	OFF	OFF
BAYE AAC08BK1AA	OFF	OFF
BAYE AAC08LG1AA	OFF	OFF
BAYE AAC10BK1AA	OFF	OFF
BAYE AAC10LG1AA	OFF	OFF
BAYE ABC15BK1AA	OFF	OFF
BAYE ABC20BK1AA	ON	OFF
BAYE ACC25BK1AA	ON	ON

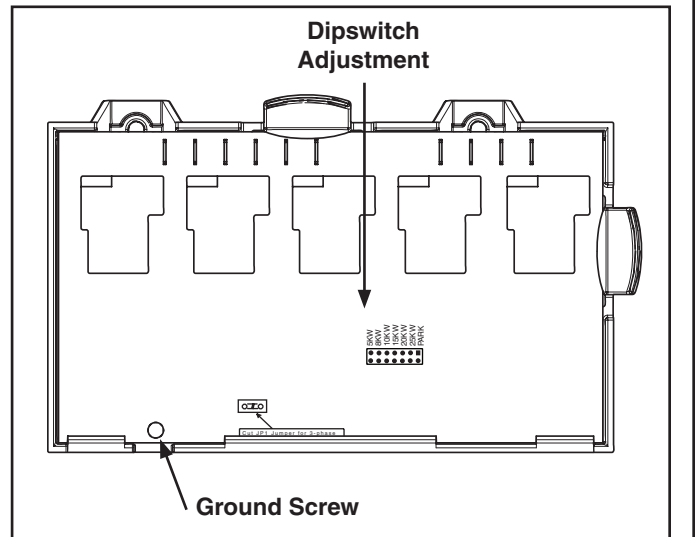

About Trane and American Standard Heating and Air Conditioning

Trane and American Standard create comfortable, energy efficient indoor environments for residential applications. For more information, please visit www.trane.com or www.americanstandardair.com

The manufacturer has a policy of continuous data improvement and it reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.