


WIRING DIAGRAM

RLY1212

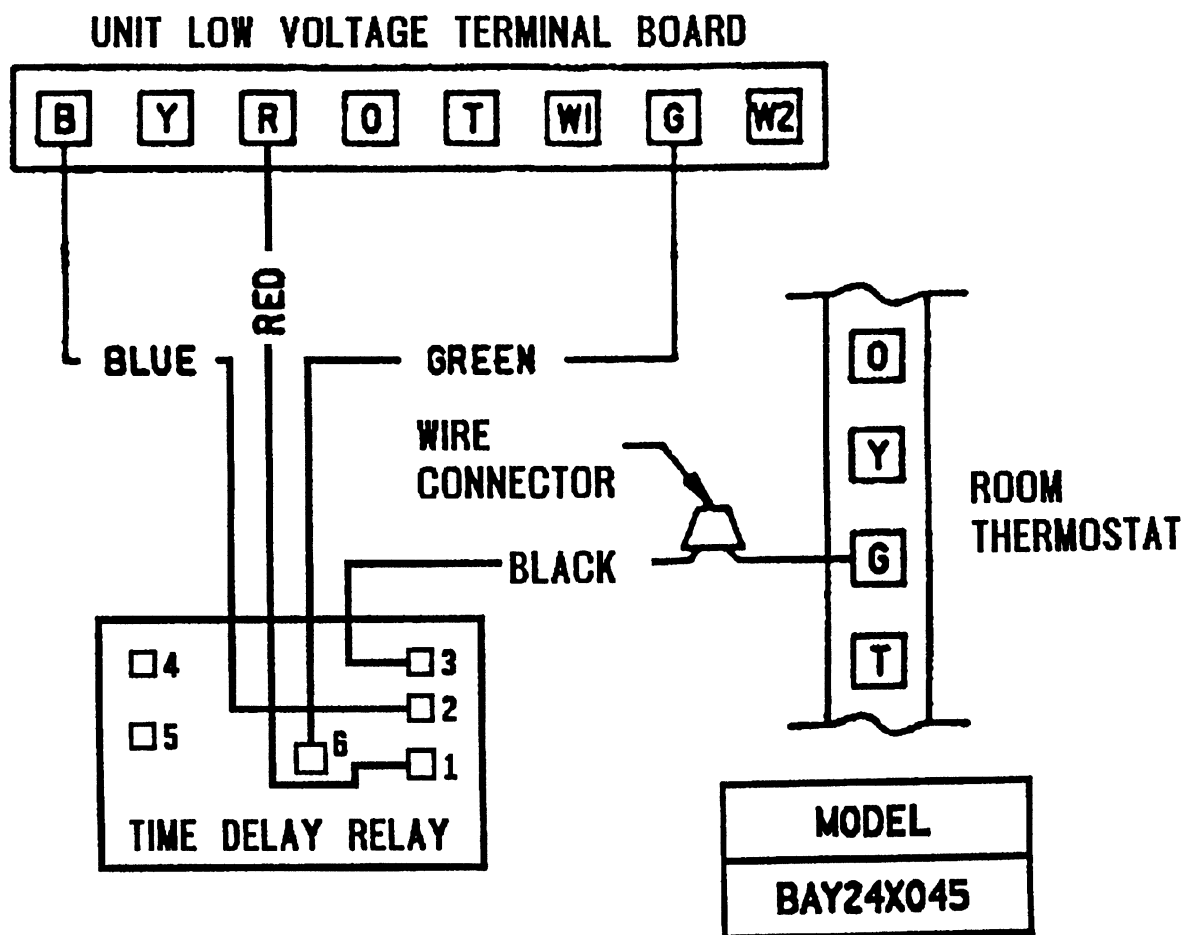

NOTES:

1. Power wiring and grounding of equipment must comply with local codes.
2. Low voltage wiring (24V.) to be No. 18 A.W.G. minimum conductor.
3. Some units have the transformer common identified as "C" rather than "B" on the low voltage terminal board.
4. "Artisan" TDR has 1/4" tab connectors instead of colored leads.