
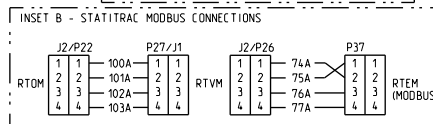








NOTES:

- 2 OPTIONAL CLOGGED FILTER SWITCH.
- 3 REQUIRED FOR OPTIONAL VENTILATION OVERRIDE.
- 4 REQUIRED FOR OPTIONAL REFERENCE ENTHALPY CONTROL.
- 5 REQUIRED FOR OPTIONAL COMPARATIVE ENTHALPY CONTROL.
- 6 WIRING SHOWN IS FOR UNITS WITHOUT OPTIONAL COMMUNICATIONS BOARD (LCI/TCI/BCI) OR DEHUMIDIFICATION. FOR OPTIONAL CONNECTIONS, SEE INSET A.
- 7 WIRING SHOWN IS FOR UNITS WITH OPTIONAL ECONOMIZER WITHOUT STATITRAC OPTION. FOR OPTIONAL CONNECTIONS, SEE INSET B.
- 8 REQUIRED FOR OPTIONAL 50% POWERED EXHAUST.
- 9 XFM2 REQUIRED FOR OPTIONAL 100% POWERED EXHAUST.
- 10 182A & 183A ARE REQUIRED FOR FRESH AIR TRACKING. FOR UNITS WITH OPTIONAL STATITRAC AND TRACS USE 182B & 183B.
- 11 CUSTOMER TO PROVIDE WIRES 408A (WHT), 409A (BLK) AND GROUND WIRE (G/Y) WHEN FIELD POWERED.
- 12 WIRE 36BS IS NOT USED FOR 50 TON UNITS.
- 13 WIRE 174A REQUIRED FOR TC (COOLING/NO HEAT) UNITS ONLY.
- 14 WIRES 64D, 65E, & 67B ARE USED ON TE (ELECTRIC HEAT) UNITS ONLY. WIRE 35A IS USED ON TC (COOLING) ONLY.
- 17 SEE APPLICABLE VARIABLE FREQUENCY DRIVE DIAGRAM FOR BALANCE OF CIRCUIT.
- 18 PLUGS LOCATED IN MAIN CONTROL PANEL.
- 19 WIRES REQUIRED FOR V.F.D. WITH BYPASS OPTION ONLY.
- 20 SENSOR EET AND WIRES 110A & 111A USED WITH OPTIONAL DEHUMIDIFICATION AND IS ATTACHED TO CIRCUIT 1 FOR 27.5-35 TON UNITS, AND TO CIRCUIT 2 FOR 40-50 TON UNITS.
- 21 WIRE 117A IS REQUIRED TO ENABLE DEHUMIDIFICATION. WIRES 141A AND 142A ARE USED WITH DEHUMIDIFICATION AND CUSTOMER INSTALLED SPACE HUMIDITY SENSOR (SHS). WIRES 112A AND 113A ARE USED WITH DEHUMIDIFICATION AND CUSTOMER INSTALLED HUMIDISTAT (HST).
- 22 WIRE 62B IS USED ON CV UNITS AND 62A IS USED ON VAV/SZVAV UNITS.
- 25 DISCONNECT WIRES 36BW AND 36BV ON HORIZONTAL UNITS.

- 26 182F & 183F ARE REQUIRED FOR FRESH AIR TRACKING. FOR UNITS WITH OPTIONAL STATITRAC AND TRAQ USE 182G & 183G.
- 27 REQUIRED FOR ULTRA LOW LEAK DAMPER.
- 28 WIRES 182C & 183C ARE REQUIRED FOR ULTRA LOW LEAK DAMPER
- 29 OPTIONAL HUMAN INTERFACE

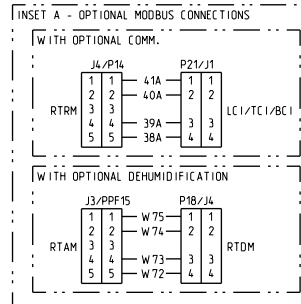


CONDENSER SECTION WIRING

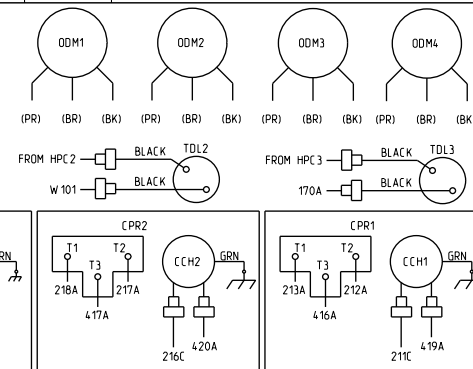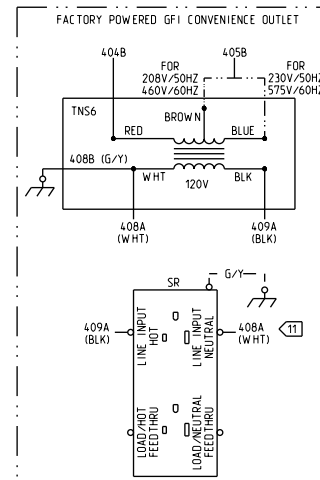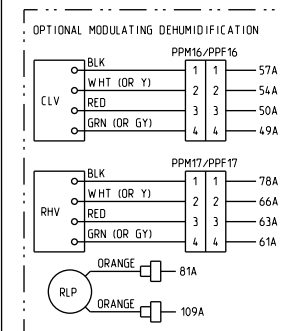






TRANE		FILE NUMBER:	DRAWING NUMBER:	SHEET:	REV
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.		1213-0291	1213-0303	1 OF 1	C
DRAWN BY:	TRANE DATE:	VOYAGER 3 RACEWAY DEVICES CONNECTION PRINT 40 & 50 TON VARIABLE AIR VOLUME - HIGH EFFICIENCY 90KW/108KW ELECTRIC HEAT/COOLING ONLY			
REPLACES:	REVISION DATE:				
CAD SYSTEM USED:	SIMILAR TO:				
D. MCCAULEY	02-19-2014				
---	11 SEPT 2015				
PRO/DETAIL	2313-1292				

HEAT SECTION WIRING


90 KW HEAT

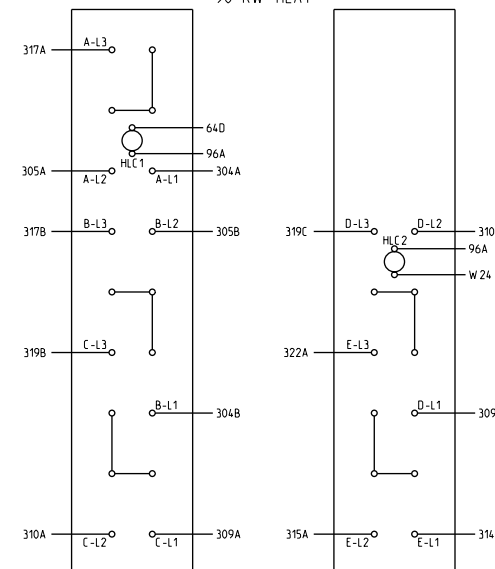

108 KW HEAT

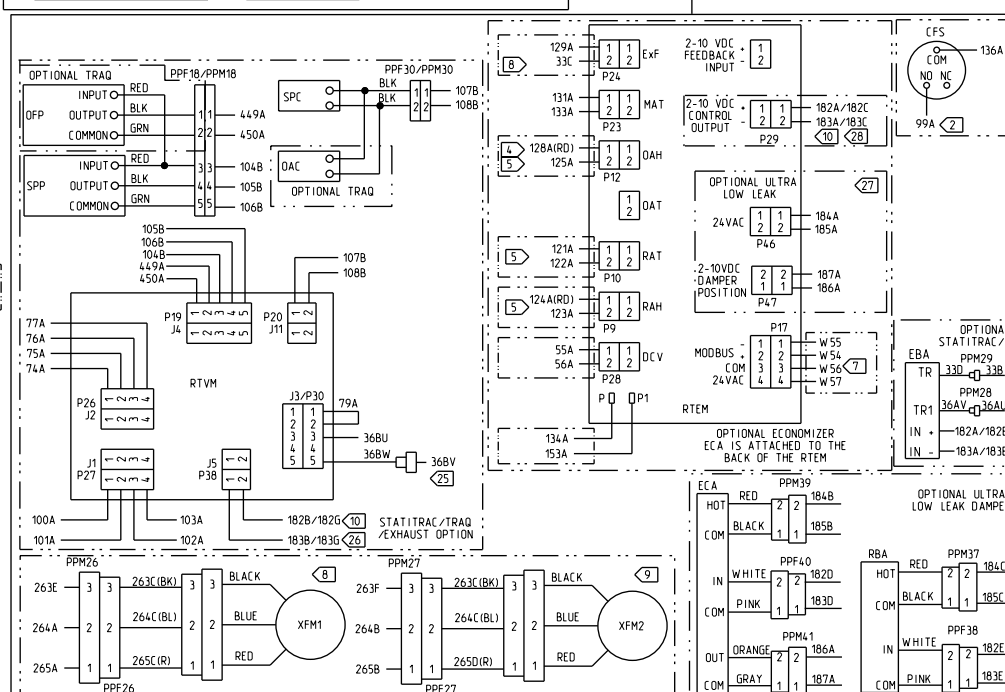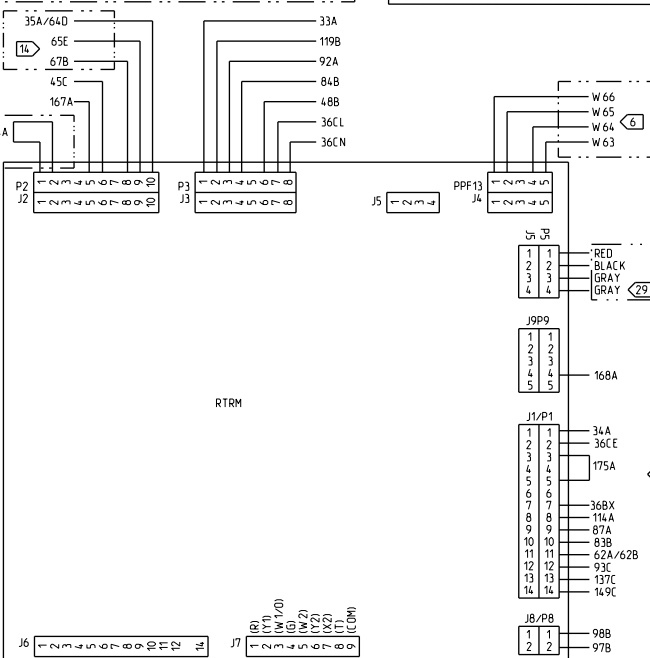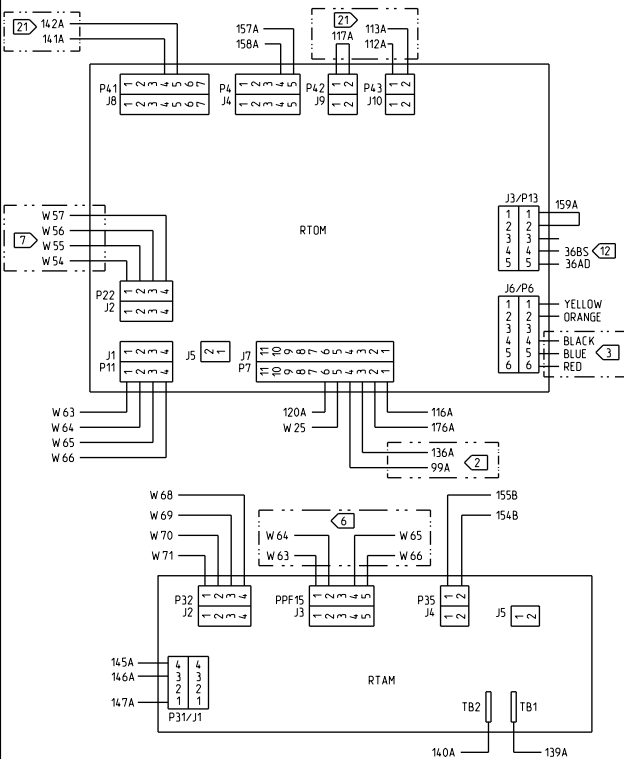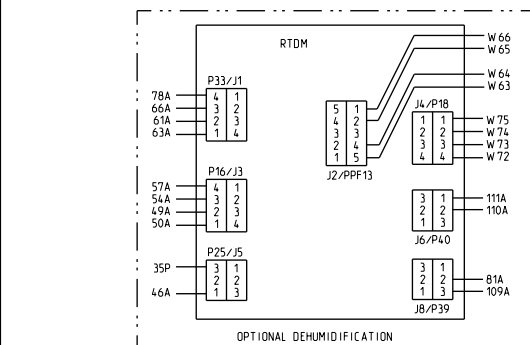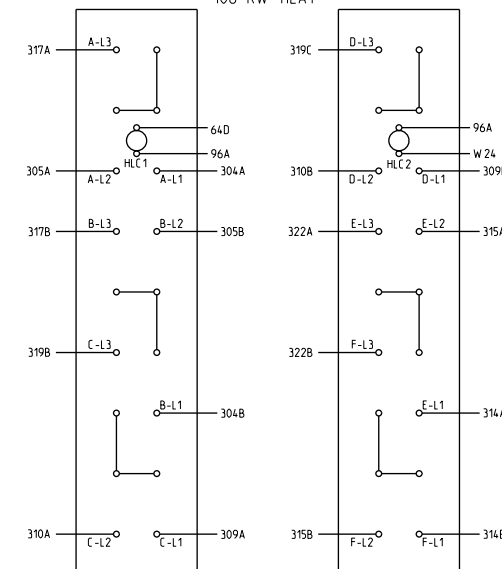

RETURN AIR SECTION WIRING

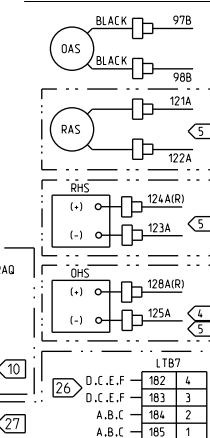

SUPPLY AIR SECTION WIRING

