


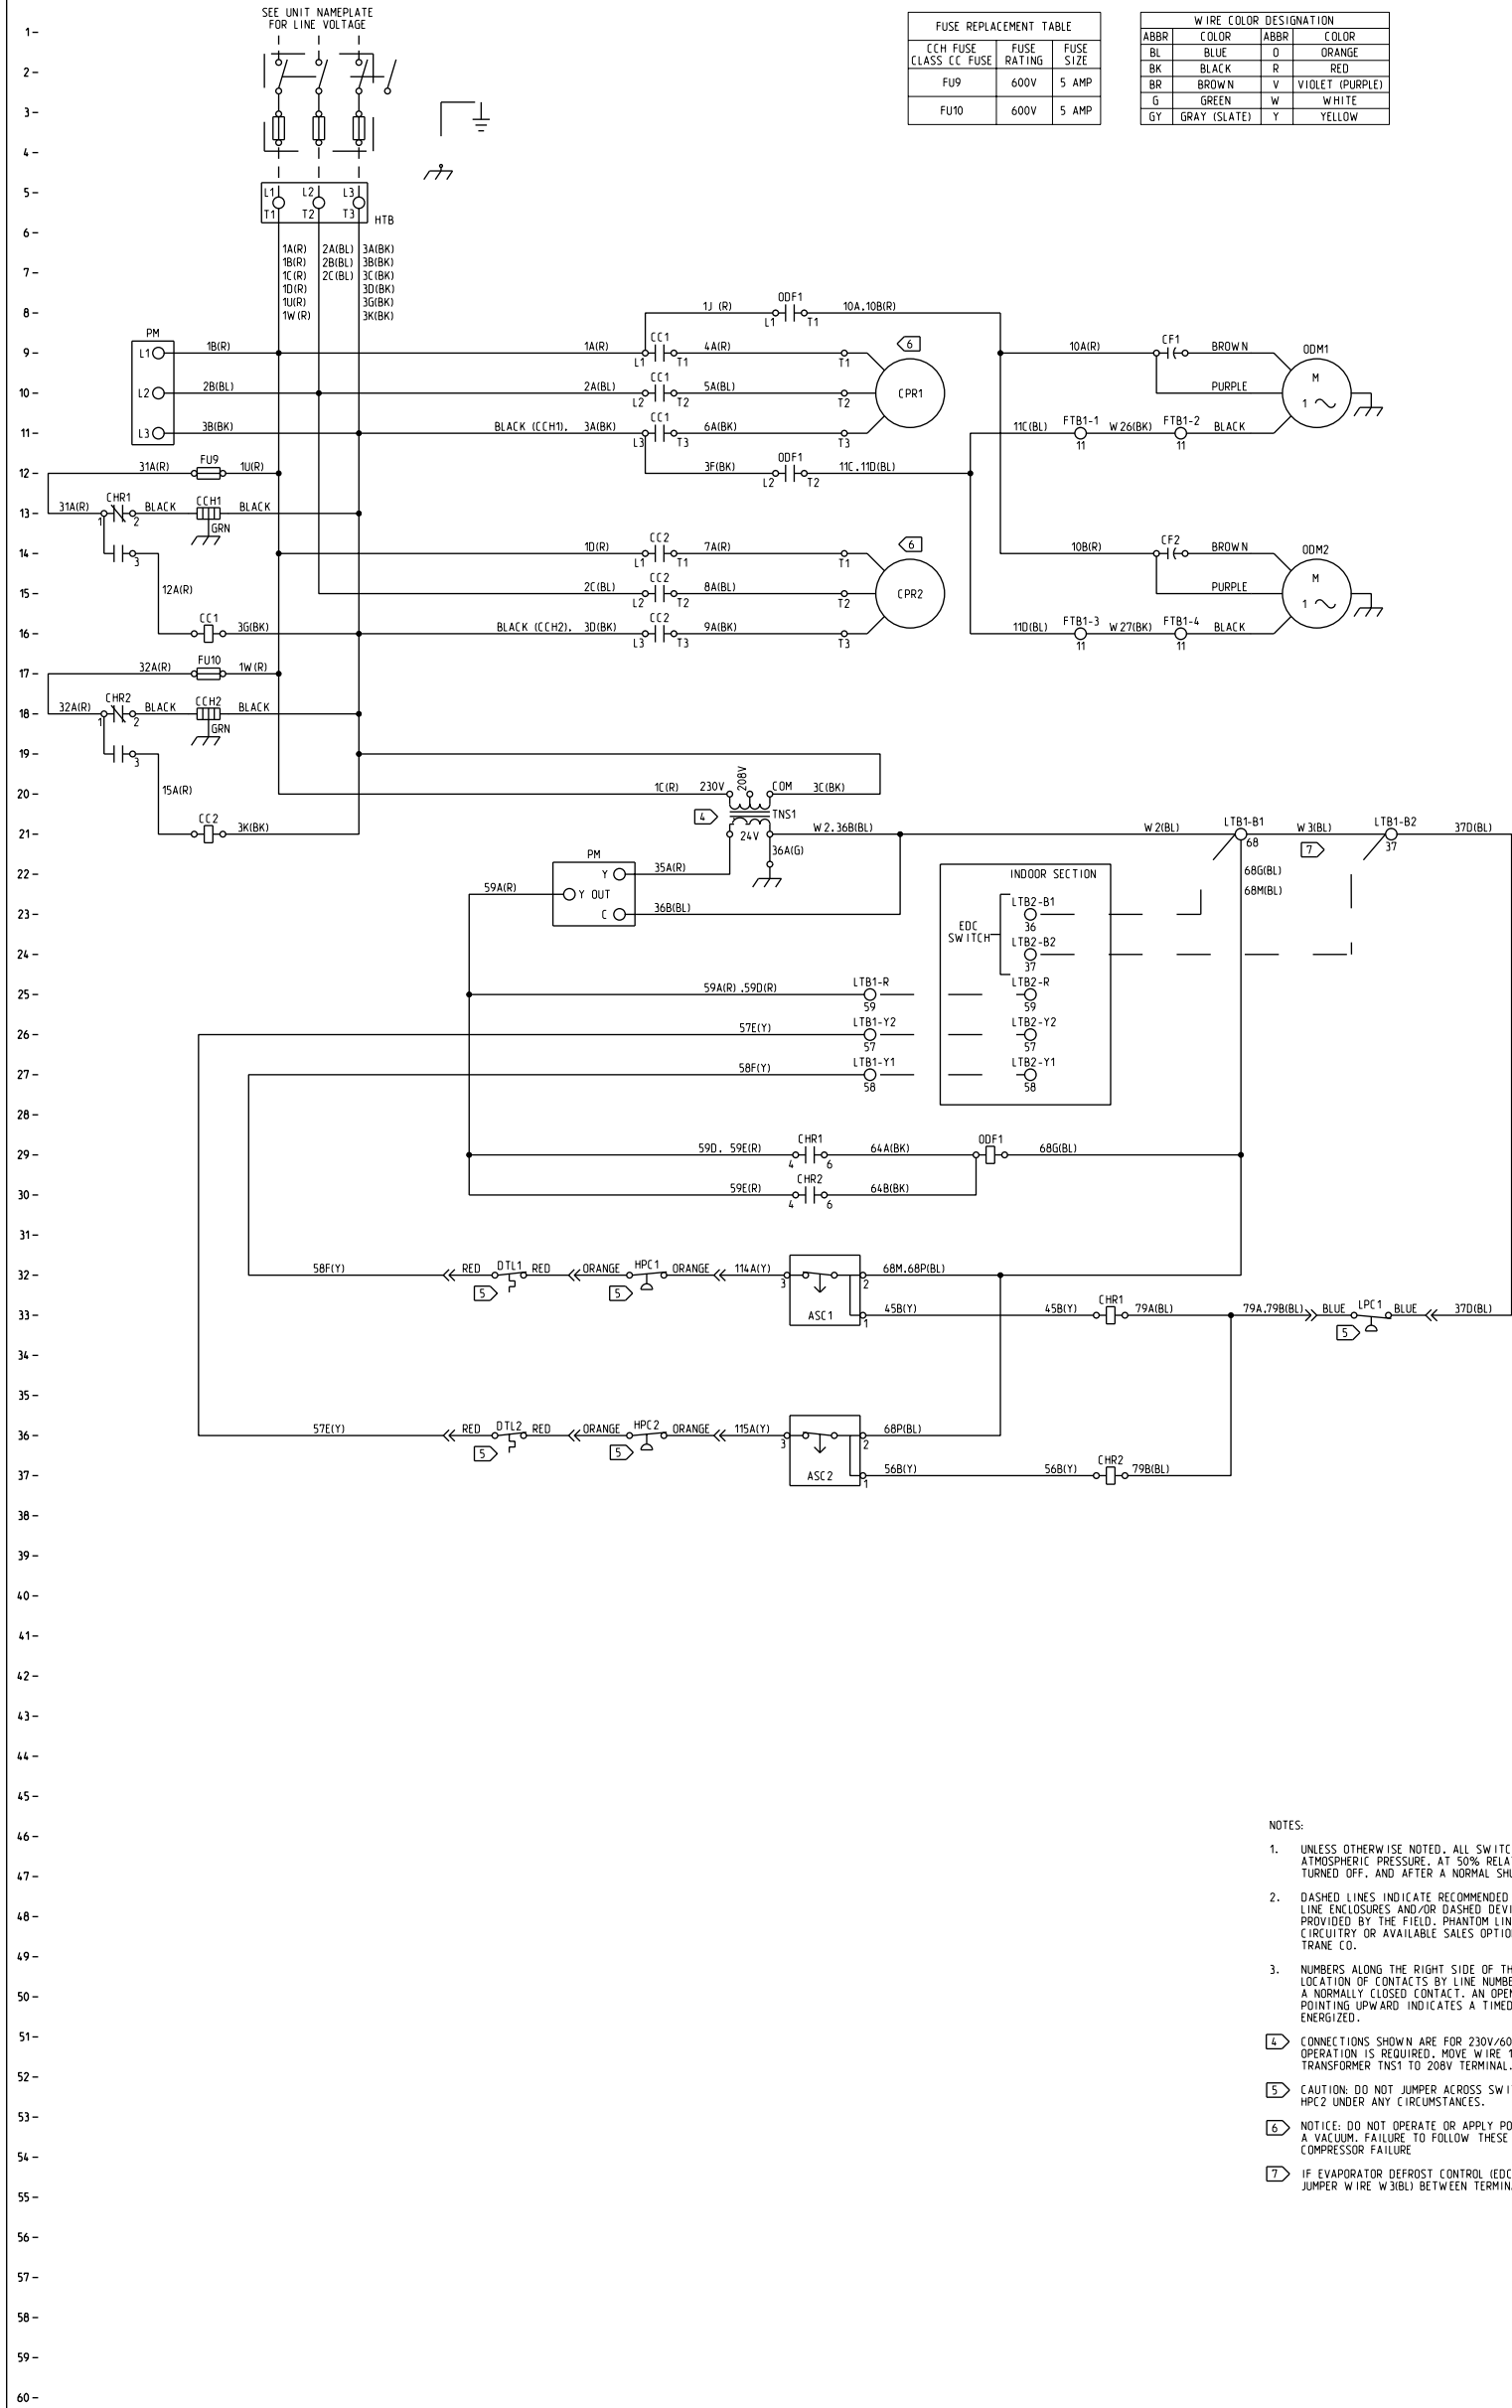

FUSE REPLACEMENT TABLE		
CCH FUSE CLASS	CC FUSE	FUSE RATING
FU9	600V	5 AMP
FU10	600V	5 AMP

WIRE COLOR DESIGNATION			
ABBR	COLOR	ABBR	COLOR
BL	BLUE	O	ORANGE
BK	BLACK	R	RED
BR	BROWN	V	VIOLET (PURPLE)
G	GREEN	W	WHITE
GY	GRAY (SLATE)	Y	YELLOW

LEGEND		
DEVICE	DESCRIPTION	LINE
ASC1	ANTI SHORT CYCLE TIMER	32
ASC2	ANTI SHORT CYCLE TIMER	36
CC1	COMPRESSOR CONTACTOR	9,10,11,16
CC2	COMPRESSOR CONTACTOR	14,15,16,21
CCH1	CRANKCASE HEATER	13
CCH2	CRANKCASE HEATER	18
CF1	OUTDOOR FAN CAPACITOR	9
CF2	OUTDOOR FAN CAPACITOR	14
CHR1	CRANKCASE HEATER RELAY	13,29,33
CHR2	CRANKCASE HEATER RELAY	18,30,37
CPR1	COMPRESSOR	10
CPR2	COMPRESSOR	15
DTL1	DISCHARGE TEMPERATURE LIMIT	32
DTL2	DISCHARGE TEMPERATURE LIMIT	36
FU9	FUSE	17
FU10	FUSE	12
HPC1	HIGH PRESSURE CUTOFF	32
HPC2	HIGH PRESSURE CUTOFF	36
LPC1	LOW PRESSURE CUTOFF	32,33
ODF1	OUTDOOR FAN CONTACTOR	8,12,29
ODM1	OUTDOOR FAN MOTOR	9
ODM2	OUTDOOR FAN MOTOR	14
PM	PHASE MONITOR	9,22
TNS1	TRANSFORMER - CONDENSER	20

WARNING

HAZARDOUS VOLTAGE!
DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS AND FOLLOW LOCK OUT AND TAG PROCEDURES BEFORE SERVICING. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITS WITH VARIABLE SPEED DRIVE, REFER TO DRIVE INSTRUCTIONS FOR CAPACITOR DISCHARGE.

FAILURE TO DO THE ABOVE BEFORE SERVICING COULD RESULT IN DEATH OR SERIOUS INJURY.

AVERTISSEMENT

TENSION DANGEREUSE!
COUPER TOUTES LES TENSIONS ET OUVRIR LES SECTIONNEURS A DISTANCE. PUIS SUIVRE LES PROCEDURES DE VERROUILLAGE ET DES ETIQUETTES AVANT TOUTE INTERVENTION. VERIFIER QUE TOUTS LES CONDENSATEURS DES MOTEURS SONT DECHARGES. DANS LE CAS D'UNITES COMPORTANT DES ENTRAINEMENTS A VITESSE VARIABLE, SE REPORTER AUX INSTRUCTIONS DE L'ENTRAINEMENT POUR DECHARGER LES CONDENSATEURS.

NE PAS RESPECTER CES MESURES DE PRECAUTION PEUT ENTRAENER DES BLESSURES GRAVES POUVANT ETRE MORTELLES.

ADVERTENCIA

¡VOLTAJE PELIGROSO!
DESC