

⚠ WARNING

HAZARDOUS VOLTAGE!

DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS AND FOLLOW LOCK OUT AND TAG PROCEDURES BEFORE SERVICING. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITS WITH VARIABLE SPEED DRIVE, REFER TO DRIVE INSTRUCTIONS FOR CAPACITOR DISCHARGE.

FAILURE TO DO THE ABOVE BEFORE SERVICING COULD RESULT IN DEATH OR SERIOUS INJURY.

⚠ AVERTISSEMENT

TENSION DANGEREUSE!

COUPER TOUTES LES TENSIONS ET OUVRIR LES SECTIONNEURS À DISTANCE. PUIS SUIVRE LES PROCÉDURES DE VERROUILLAGE ET DES ÉTIQUETTES AVANT TOUTE INTERVENTION. VÉRIFIER QUE TOUTS LES CONDENSATEURS DES MOTEURS SONT DÉCHARGÉS. DANS LE CAS D'UNITÉS COMPORTANT DES ENTRAÎNEMENTS À VITESSE VARIABLE, SE REPORTER AUX INSTRUCTIONS DE L'ENTRAÎNEMENT POUR DÉCHARGER LES CONDENSATEURS.

NE PAS RESPECTER CES MESURES DE PRÉCAUTION PEUT ENTRAÎNER DES BLESSURES GRAVES POUVANT ÊTRE MORTELLES.

⚠ ADVERTENCIA

¡VOLTAJE PELIGROSO!

DESCONECTE TODA LA ENERGÍA ELÉCTRICA, INCLUIDO LAS DESCONECIONES REMOTAS Y SIGA LOS PROCEDIMIENTOS DE CIERRE Y ETIQUETADO ANTES DE PROCEDER AL SERVICIO. ASEGÚRESE DE QUE TODOS LOS CAPACITORES DEL MOTOR HAYAN DESCARGADO EL VOLTAJE ALMACENADO. PARA LAS UNIDADES CON EJE DE DIRECCIÓN DE VELOCIDAD VARIABLE, CONSULTE LAS INSTRUCCIONES PARA LA DESCARGA DEL CONDENSADOR.

EL NO REALIZAR LO ANTERIORMENTE INDICADO, PODRÍA OCASIONAR LA MUERTE O SERIAS LESIONES PERSONALES.

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

ATTENTION

N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!

LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.


L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'EQUIPEMENT.

PRECAUCIÓN



¡UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!

LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.

SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

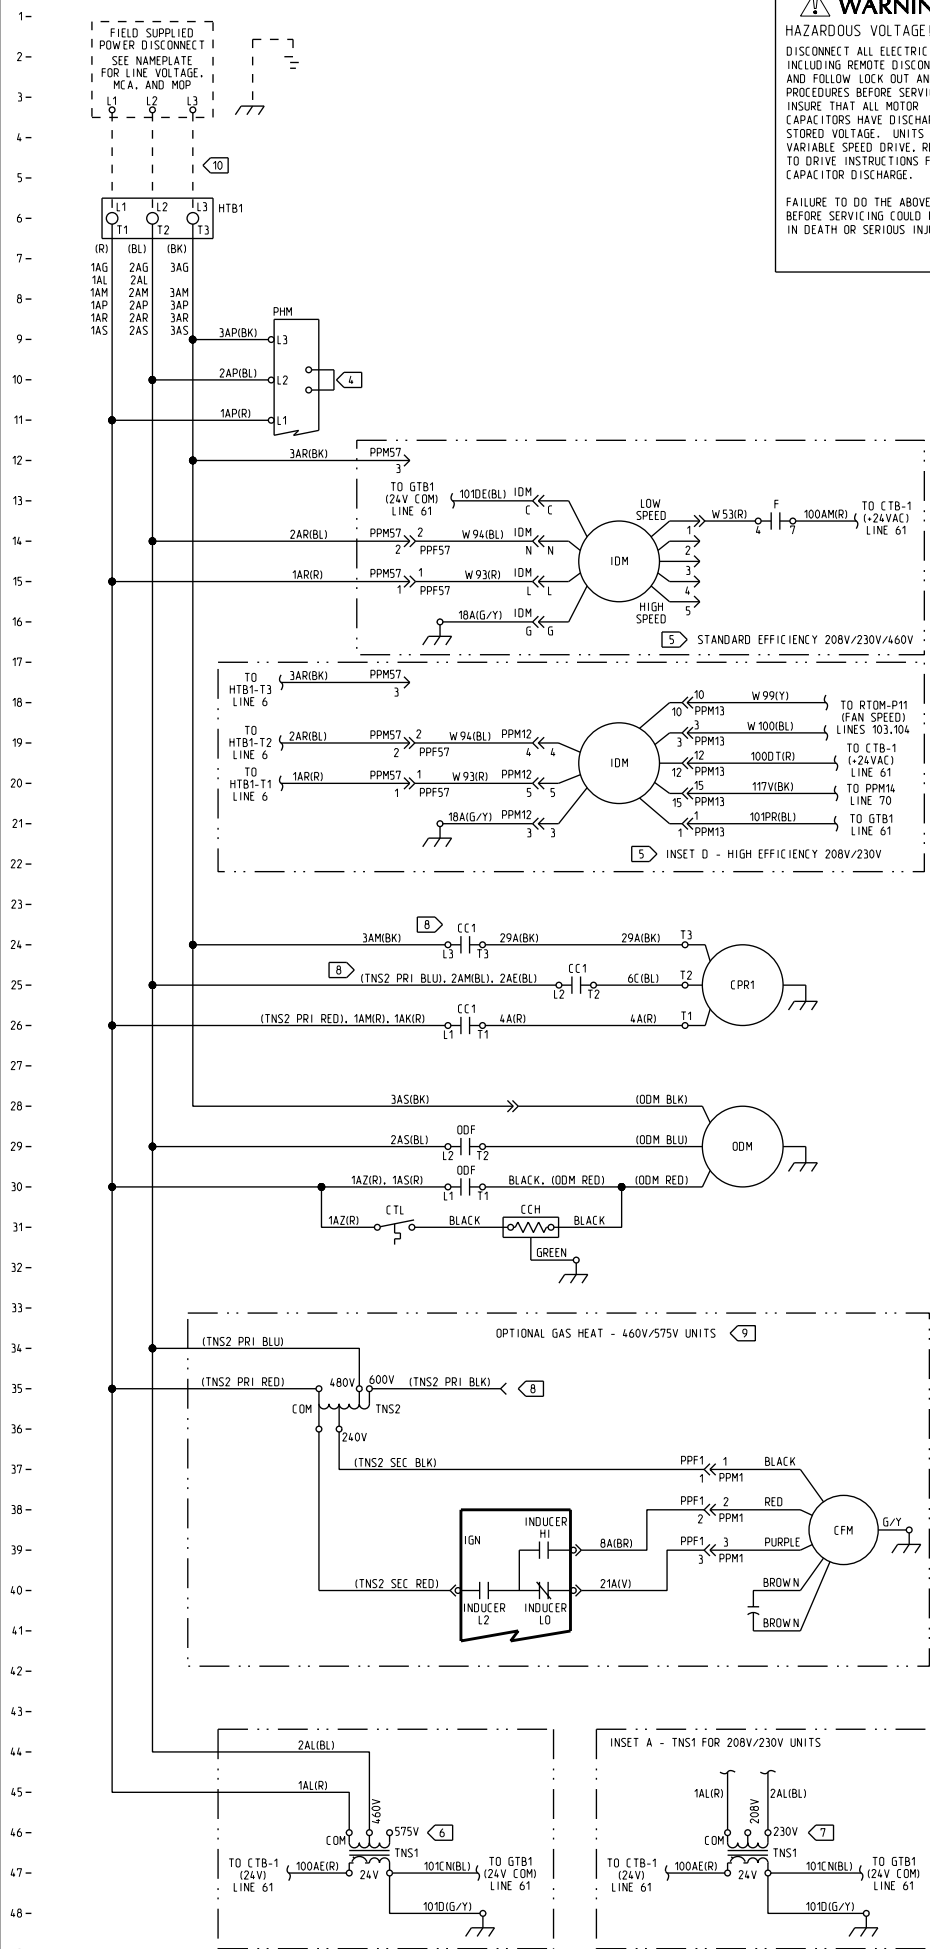

- NOTES:
- UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25°C (77°F), AT ATMOSPHERIC PRESSURE, AT 50% RELATIVE HUMIDITY, WITH ALL UTILITIES TURNED OFF, AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
 - DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS. SOLID LINE INDICATES WIRING BY TRANE CO.
 - NUMBERS ALONG THE RIGHT SIDE MARGIN OF THE SCHEMATIC DESIGNATE, BY LINE NUMBER, THE LOCATION OF CONTACTS ENERGIZED BY COIL. AN UNDERLINED NUMBER INDICATES A NORMALLY CLOSED CONTACT, AN OPEN ARROWHEAD POINTING UPWARD BELOW THE LINE NUMBER INDICATES A TIMED CONTACT WHICH BEGINS TIMING WHEN ENERGIZED.
- 4 CLIP PHM JUMPER WIRE FOR 50HZ OPERATION.
- 5 IDM CONNECTIONS SHOWN ARE FOR STANDARD EFFICIENCY 208V/230V/460V UNITS. FOR ALTERNATE WIRING, SEE: INSET B - STANDARD EFFICIENCY 575V UNITS
INSET D - HIGH EFFICIENCY 208V/230V UNITS
INSET E - HIGH EFFICIENCY 460V/575V UNITS
INSET F - HIGH EFFICIENCY W/ HIGH STATIC MOTOR OPTION 208V/230V/460V UNITS
- 6 TNS1 CONNECTIONS SHOWN ARE FOR 460V UNITS. FOR 575V OPERATION, MOVE ALL WIRES FROM THE 460V TERMINAL TO THE 575V TERMINAL. (SEE INSET A FOR 208V/230V UNITS.)
- 7 CONNECTIONS SHOWN ARE FOR 230V UNITS. FOR 208V OPERATION, MOVE ALL WIRES FROM THE 230V TERMINAL TO THE 208V TERMINAL.
- 8 TNS2 CONNECTIONS SHOWN ARE FOR 460V UNITS. FOR 575V OPERATION, DISCONNECT (TNS2 PRI BLU) FROM CC1-L2 AND CONNECT (TNS2 PRI BLK) TO CC1-L3.
- 9 FOR OPTIONAL GAS HEAT CONNECTIONS ON 208V/230V UNITS, SEE INSET C.
- 10 FOR CONNECTIONS WITH OPTIONAL THROUGH-THE-BASE-ELECTRIC, SEE DIAGRAM 43661031.
- 11 PLUG IS USED FOR FACTORY PROGRAMMING OF MOTOR

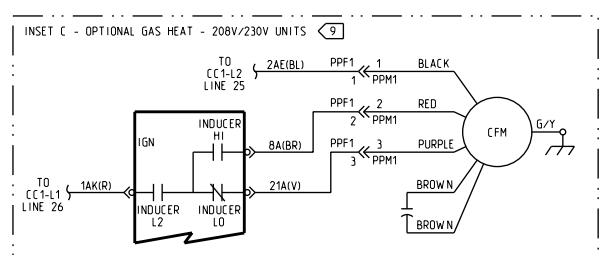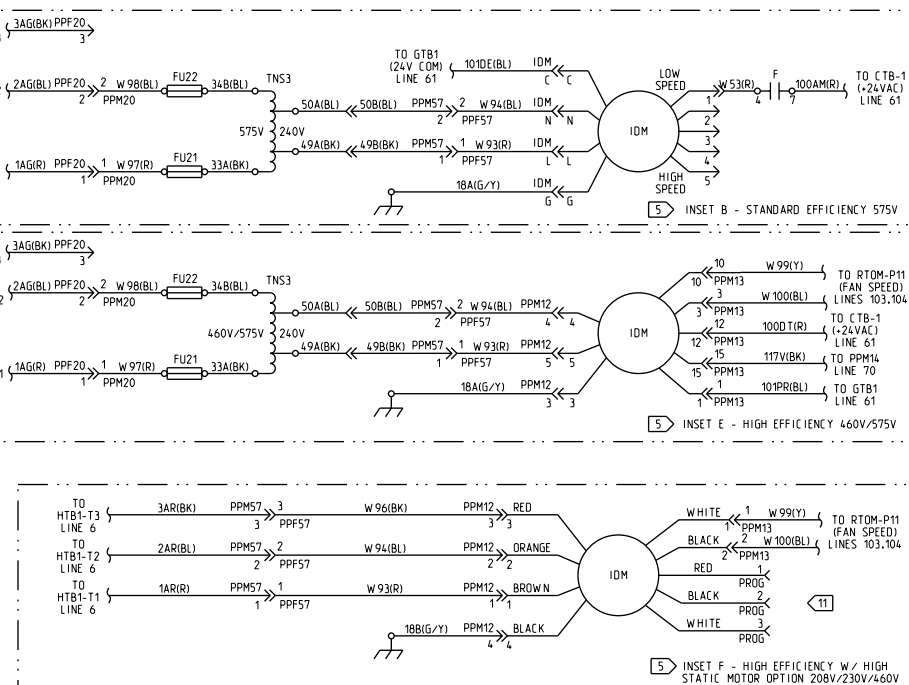

WIRE COLOR DESIGNATION			
ABBR	COLOR	ABBR	COLOR
BK	BLACK	V.(PR)	PURPLE
BL	BLUE	R	RED
BR	BROWN	TN	TAN
G	GREEN	W	WHITE
O	ORANGE	Y	YELLOW

LEGEND		
DEVICE DESIGNATION	DESCRIPTION	LINE NUMBER
CC1	CONTACTOR - COMPRESSOR	24,25,26
CCH	HEATER - CRANKCASE	31
CFM	MOTOR - COMBUSTION FAN	38
CPR1	COMPRESSOR	25
CTL	SWITCH - COIL TEMP LIMIT	31
F	RELAY, INDOOR MOTOR	13
FU21	FUSE, AUTOTRANSFORMER	15,20
FU22	FUSE, AUTOTRANSFORMER	13,18
HTB1	TERM BLOCK - HIGH VOLTAGE	6
IDM	MOTOR - INDOOR	13,19,25
IGN	MODULE - IGNITION	39
ODF	RELAY - OD FAN	29,30
ODM	MOTOR - OD FAN	29
PHM	MODULE - PHASE MONITOR	9
TNS1	TRANSFORMER - 24V CONTROLS	46
TNS2	AUTOTRANSFORMER - IGN	35
TNS3	AUTOTRANSFORMER, IDM	13,18

TRANE

THIS DRAWING IS PROPERTY OF TRANE AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF TRANE.

DRAWN BY: K. EDWARDS
CHECKED BY: J. HARRIS
REVISIONS: 07/19/2017
SIMILAR TO: --

FILE NUMBER: 1232083
DRAWING NUMBER: 1232083
SHEET: 1 OF 1
REV: G

POWER, HEAT PUMP
3-5 TON