


LEGEND	
DEVICE DESIGNATION	DESCRIPTION
3F20	FUSEBLOCK
3F21	FUSEBLOCK
3F22	FUSEBLOCK
3F23	FUSEBLOCK
3F24	FUSEBLOCK
3F25	FUSEBLOCK
3KF31	HEAT CONTROLS
3QA25	CONTACTOR - HEAT CKT A
3QA26	CONTACTOR - HEAT CKT B
3QA27	CONTACTOR - HEAT CKT C
3QA28	CONTACTOR - HEAT CKT D
3QA29	CONTACTOR - HEAT CKT E
3QA30	CONTACTOR - HEAT CKT F
3QA31	CONTACTOR - BACK - UP
3QA32	CONTACTOR - BACK - UP
3QA33	CONTACTOR - BACK - UP
3QA34	CONTACTOR - BACK - UP
3QA35	CONTACTOR - BACK - UP
3QA36	CONTACTOR - BACK - UP
3QB4	MANUAL DISCONNECT - ELECTRIC HEAT
3XD16	TERMINAL BLOCK - 115V
3XD17	TERMINAL BLOCK - 115V COM
3XD5	TERMINAL BLOCK

CLASS T FUSE REPLACEMENT TABLE		
ELECTRIC HEAT FUSES: 3F20-3F25		
CLASS T (x3 EA)		
KW	VOLTAGE	FUSE
60	200V / 230V	60
	460V	50
	575V	40
90 & 120	200V / 230V	60
	460V	60
	575V	50
150	460V	60
	575V	50
	460V	60
190	575V	50

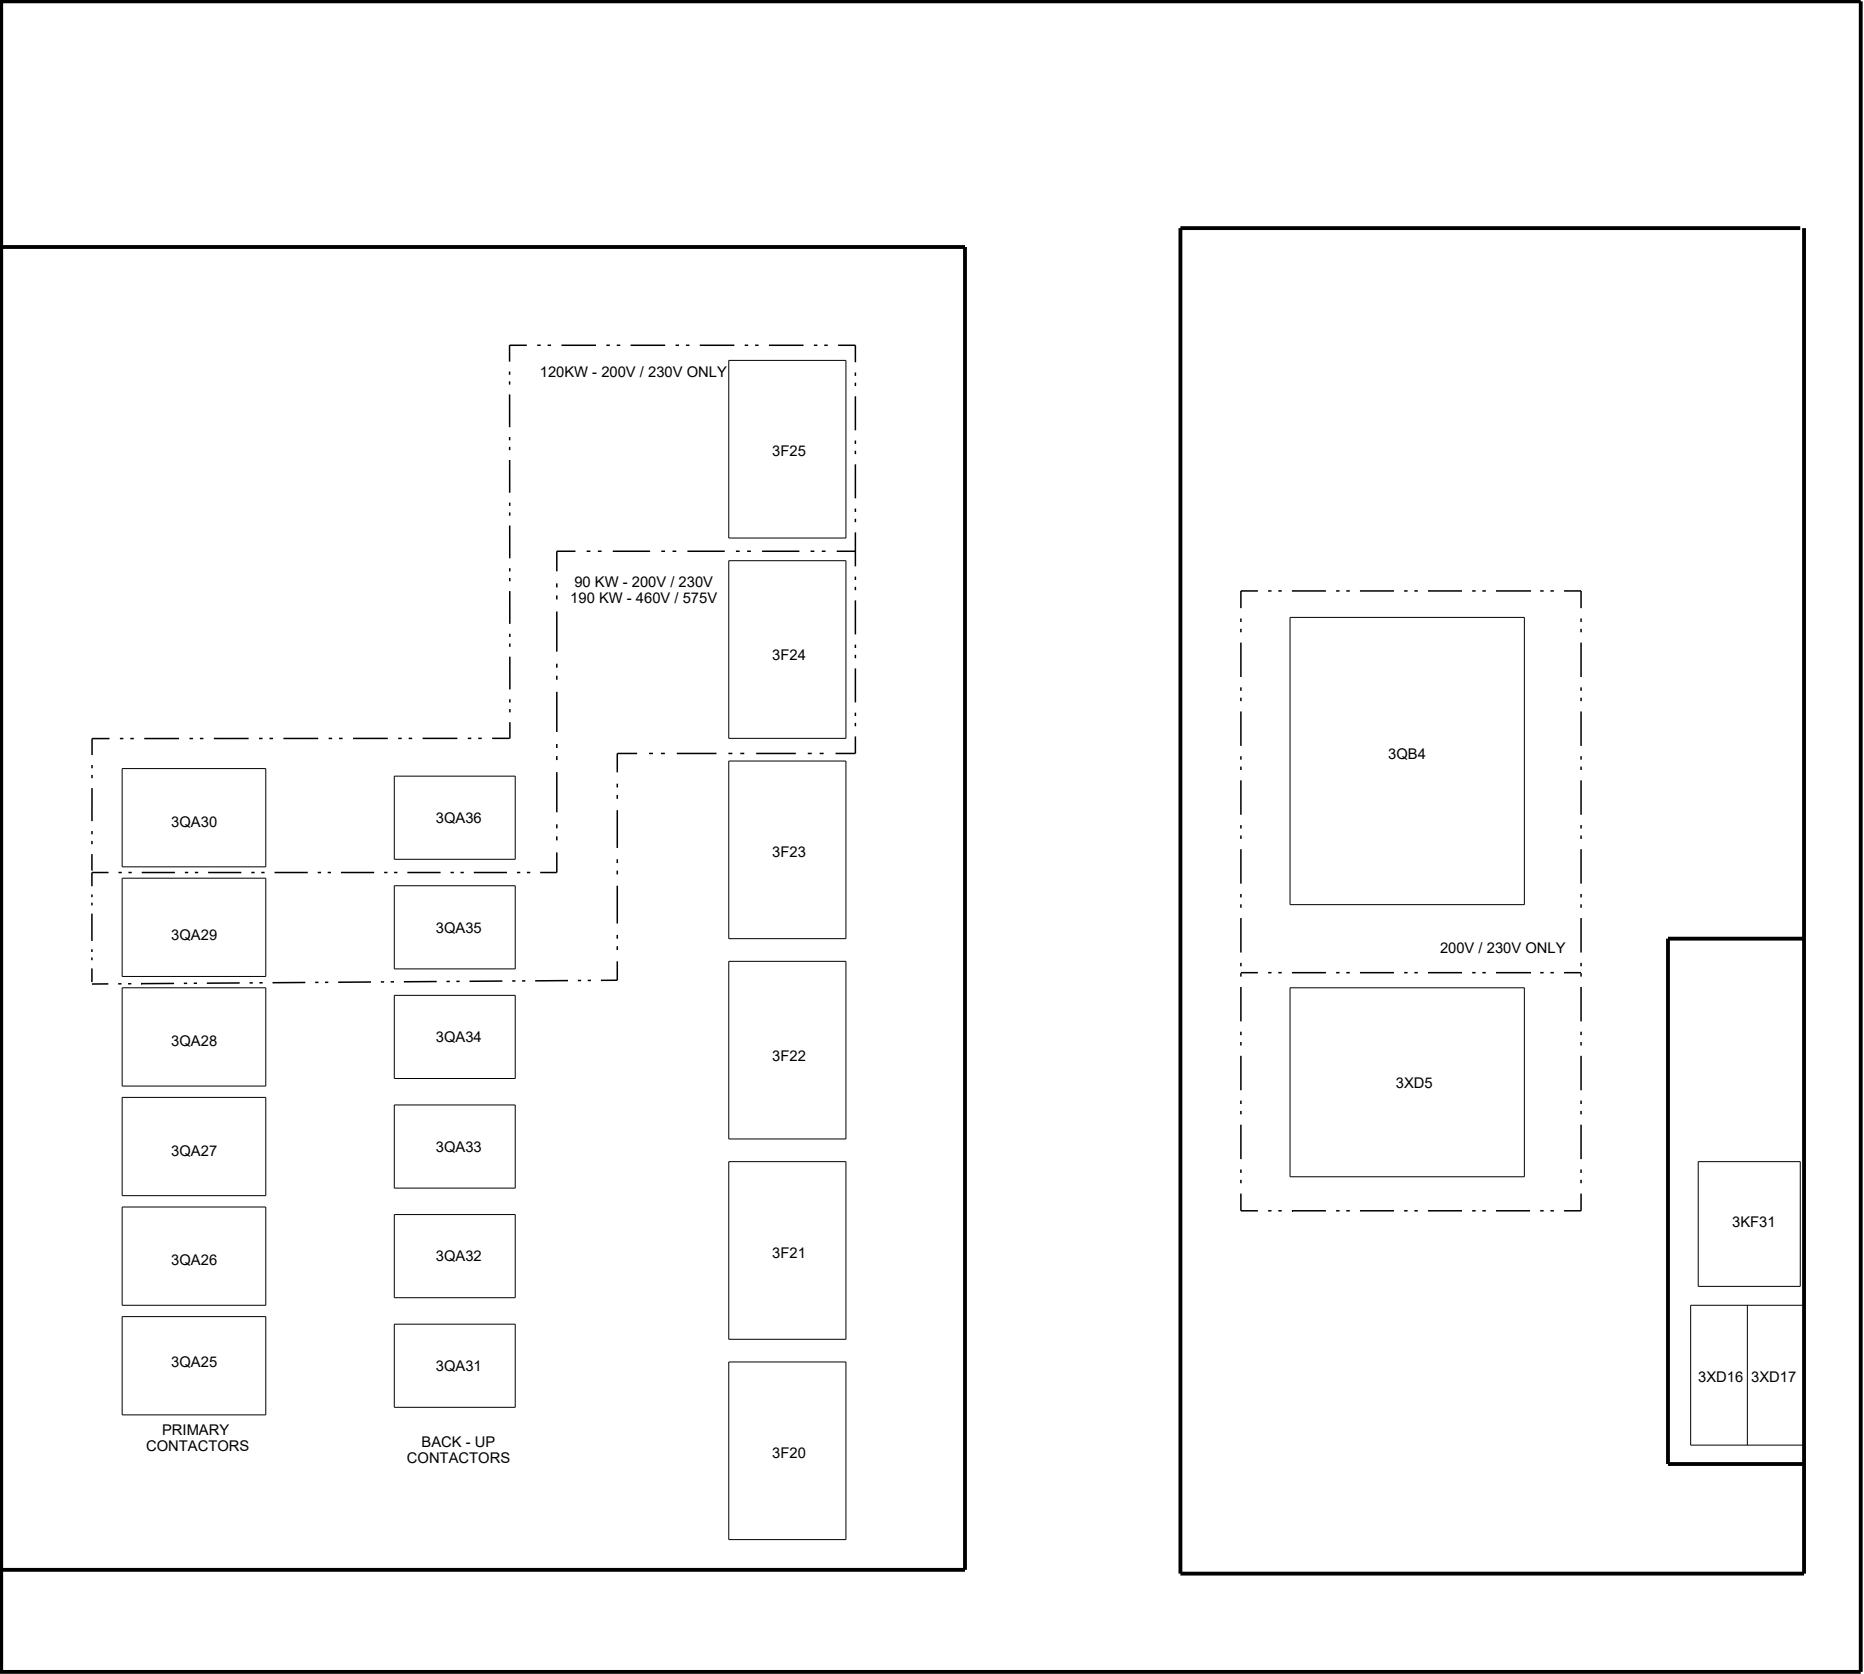

NOTES:
1. SOME COMPONENTS SHOWN ARE OPTIONAL AND MAY NOT BE PRESENT. SEE UNIT SCHEMATIC FOR OPTIONAL UNIT CONFIGURATION.

DESIGNER: D.CONDIE	TRANE ® THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.	INTELLIPAK		
ENGINEER: L. D'ALBANI		DIAGRAM		
TRANE © DATE: 08-JUN-18		COMPONENT LAYOUT - ELECTRIC HEAT PANEL		
REPLACES: --		60 & 90KW - 200V / 230V		
SIMILAR TO: --		120KW - ALL VOLTAGES 150 KW & 190 KW - 460V / 575V		
REVISION DATE: 07/17/2018				
REVISED BY: ALVA WAELDE	MASTER NUMBER:	DRAWING NUMBER:	SHEET:	REV
APPROVED BY: L. D'ALBANI		12132855	1 OF 1	B
CAD SYSTEM USED: PRO/ DIAGRAM	IEC DESIGN COMPLIANT			