
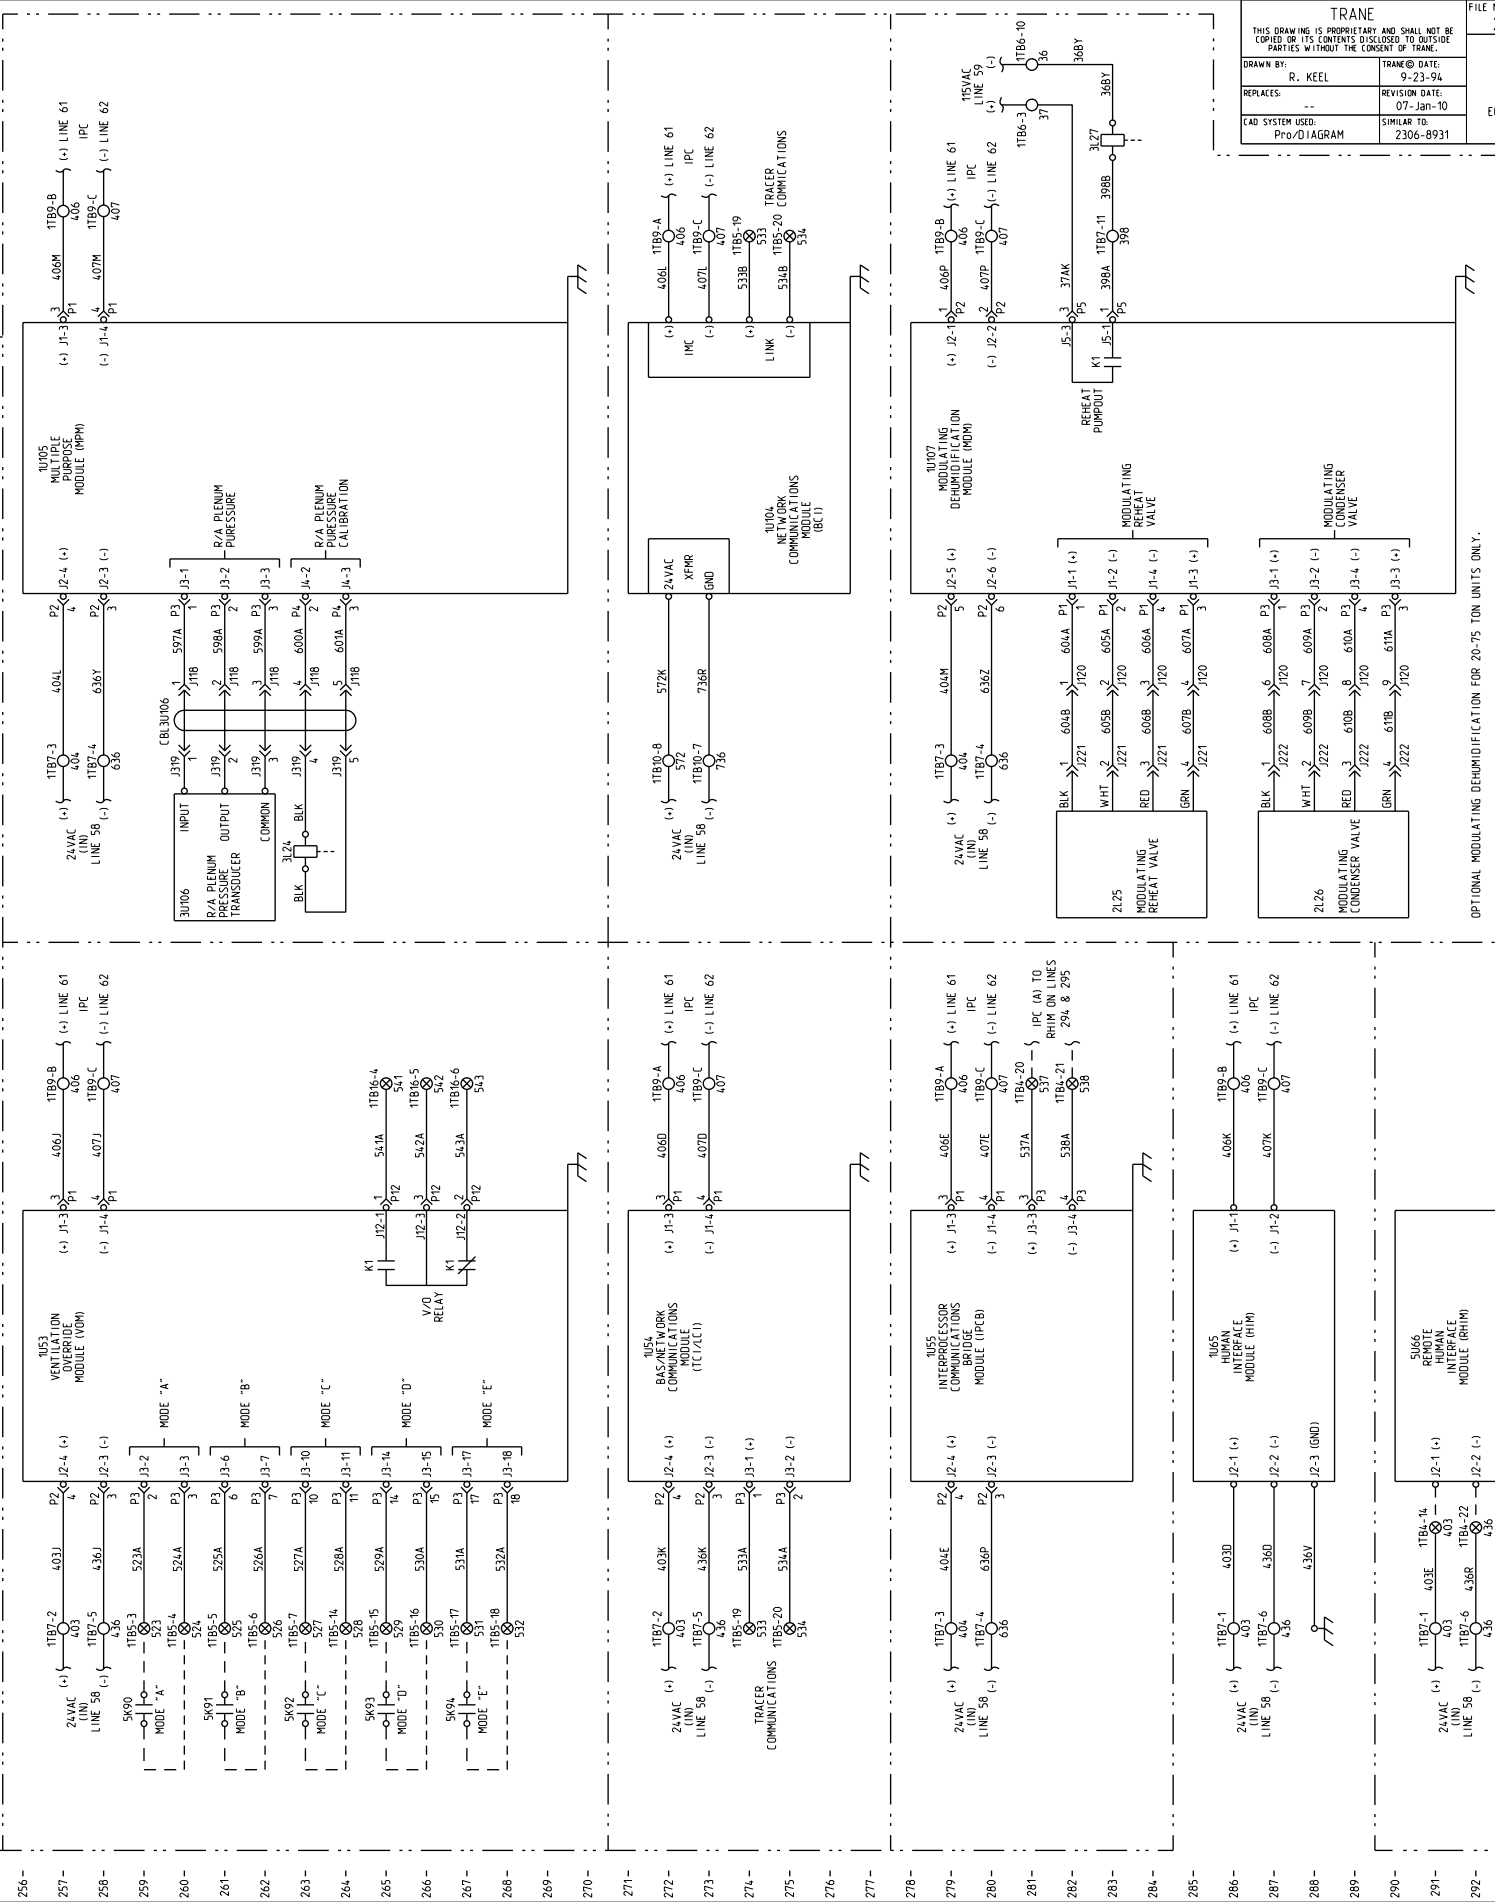
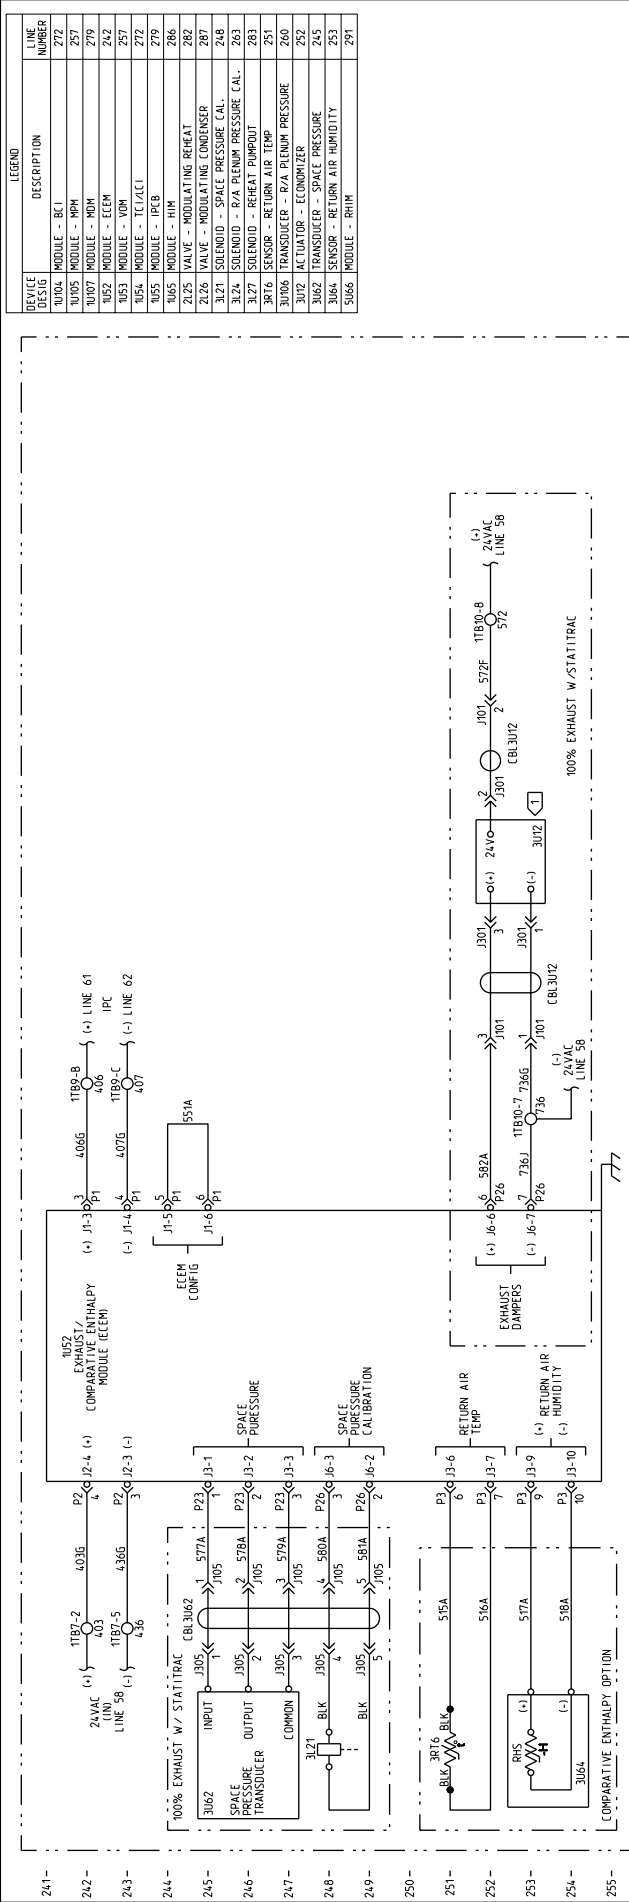
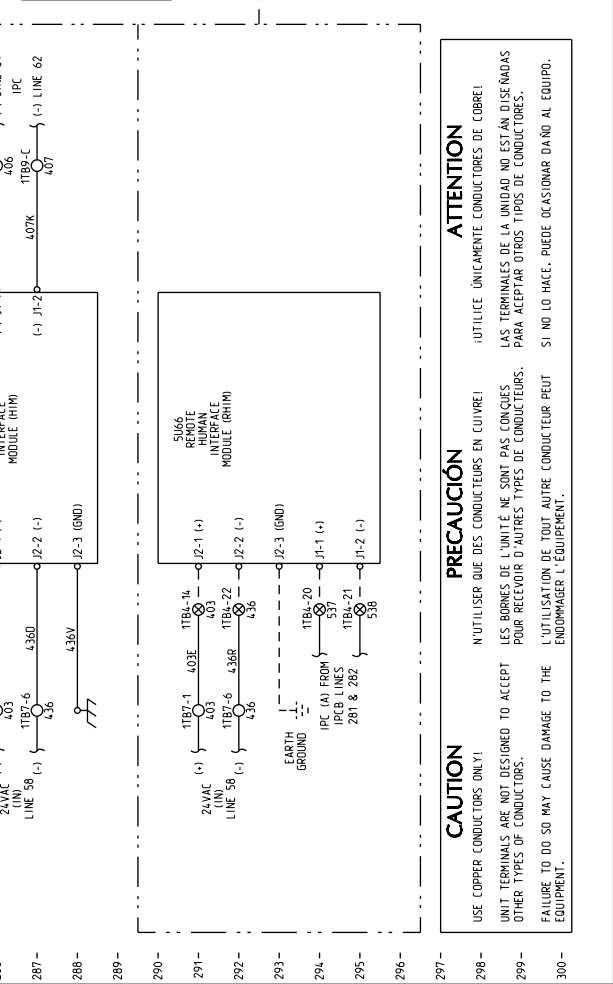


TRANE		FILE NUMBER: 2307-3896	DRAWING NUMBER: 2307-3894	SHEET: 1 OF 1	REV H
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.		ROOFTOP PACKAGED AIR CONDITIONER			
DRAWN BY: R. KEEL		SCHEMATIC WIRING DIAGRAM			
TRANE® DATE: 9-23-94		ROOFTOP UCM			
REPLACES:	REVISION DATE:	ECC, VO, TCI, LCI, IPCB, HI, RHI, MPH, BCI & MDM MODULES			
--	07-Jan-10	20-130 TON			
CAD SYSTEM USED: Pro/CDIGRAM	SIMILAR TO: 2306-8931				

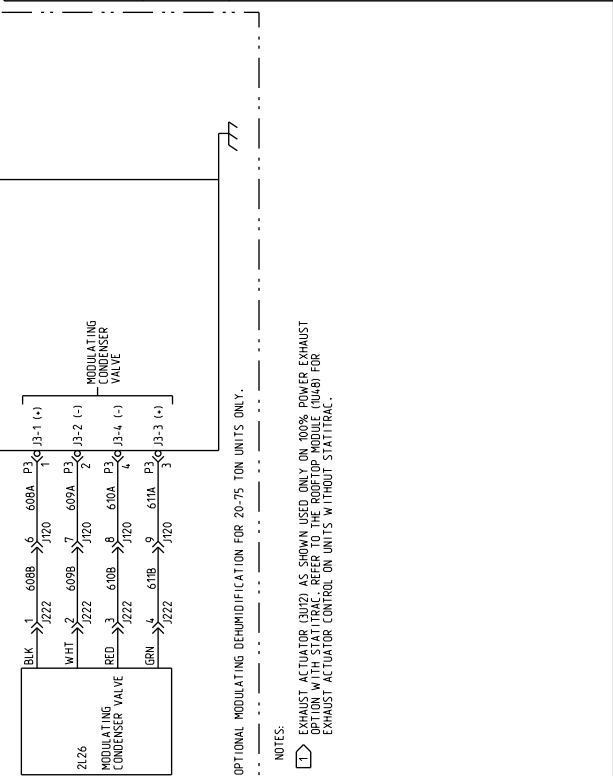

CAUTION
USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT
FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

PRECAUCIÓN
NÚTILICE UNICAMENTE CONDUCTORES DE COBRE!
LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS
PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.
SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

ATTENTION
N'UTILISEZ UNICAMENTE CONDUCTEURS DE COBRE!
LES TERMINALES DE L'UNITÉ NE SONT PAS CONÇUES
POUR RECEVOIR D'AUTRES TIPOES DE CONDUCTEURS.