
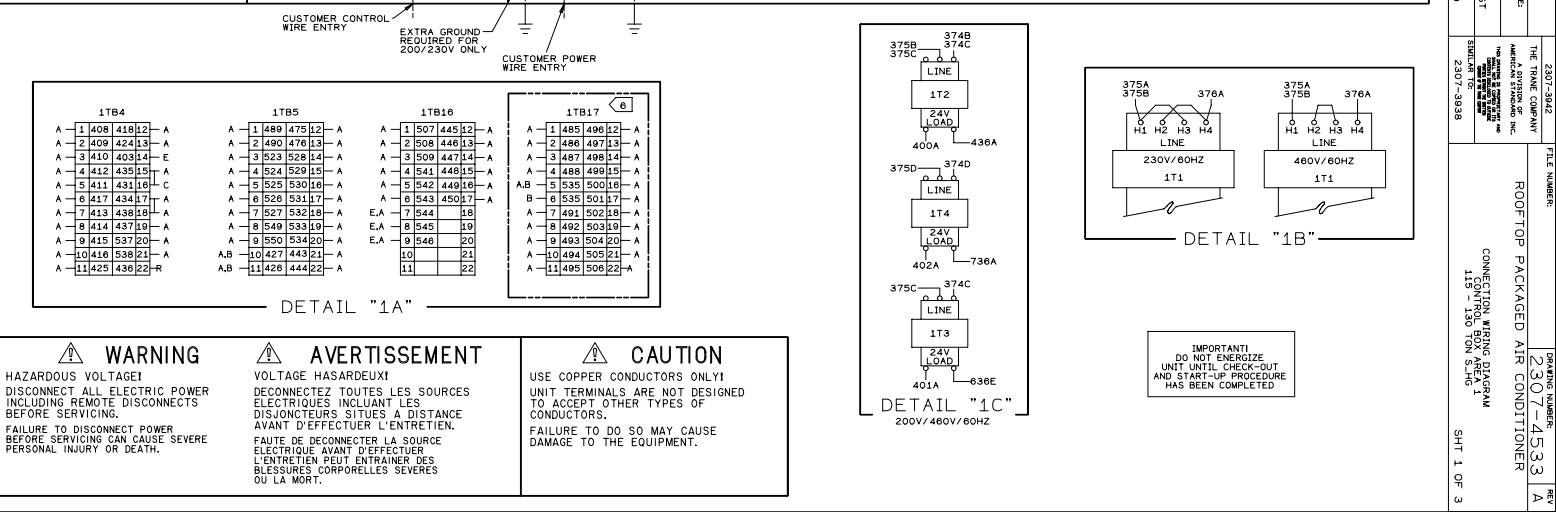


MAIN CONTROL BOX

NOTES:

- 200V/60HZ OR 575V/60HZ TRANSFORMER SHOWN. SEE DETAIL "1B" FOR OTHER VOLTAGE CONNECTIONS.
- JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
- 1CB2, 1K17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL EXHAUST AIR FAN.
- 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
- WHEN HIGH DUCT TEMP T-STAT (1S16 - 3S17) IS ORDERED JUMPER IS REMOVED.
- 230V/60HZ OR 575V/60HZ TRANSFORMERS SHOWN. SEE DETAIL "1C" FOR 200V/60HZ OR 460V/60HZ CONNECTIONS.
- 1F55, 1F56, 1J74 AND ASSOCIATED WIRING USED ON CONVENIENCE OUTLET OPTION ONLY.
- ON 1TB10-8 USE WIRE 572E ON 100% EXHAUST UNITS W/O STATITRAC. USE 572F ON 100% EXHAUST UNITS W/ STATITRAC.
- ON 1K17 AUX SWITCH USE WIRES 573C & 576A ON UNITS WITH 100% EXHAUST W/O STATITRAC ONLY.

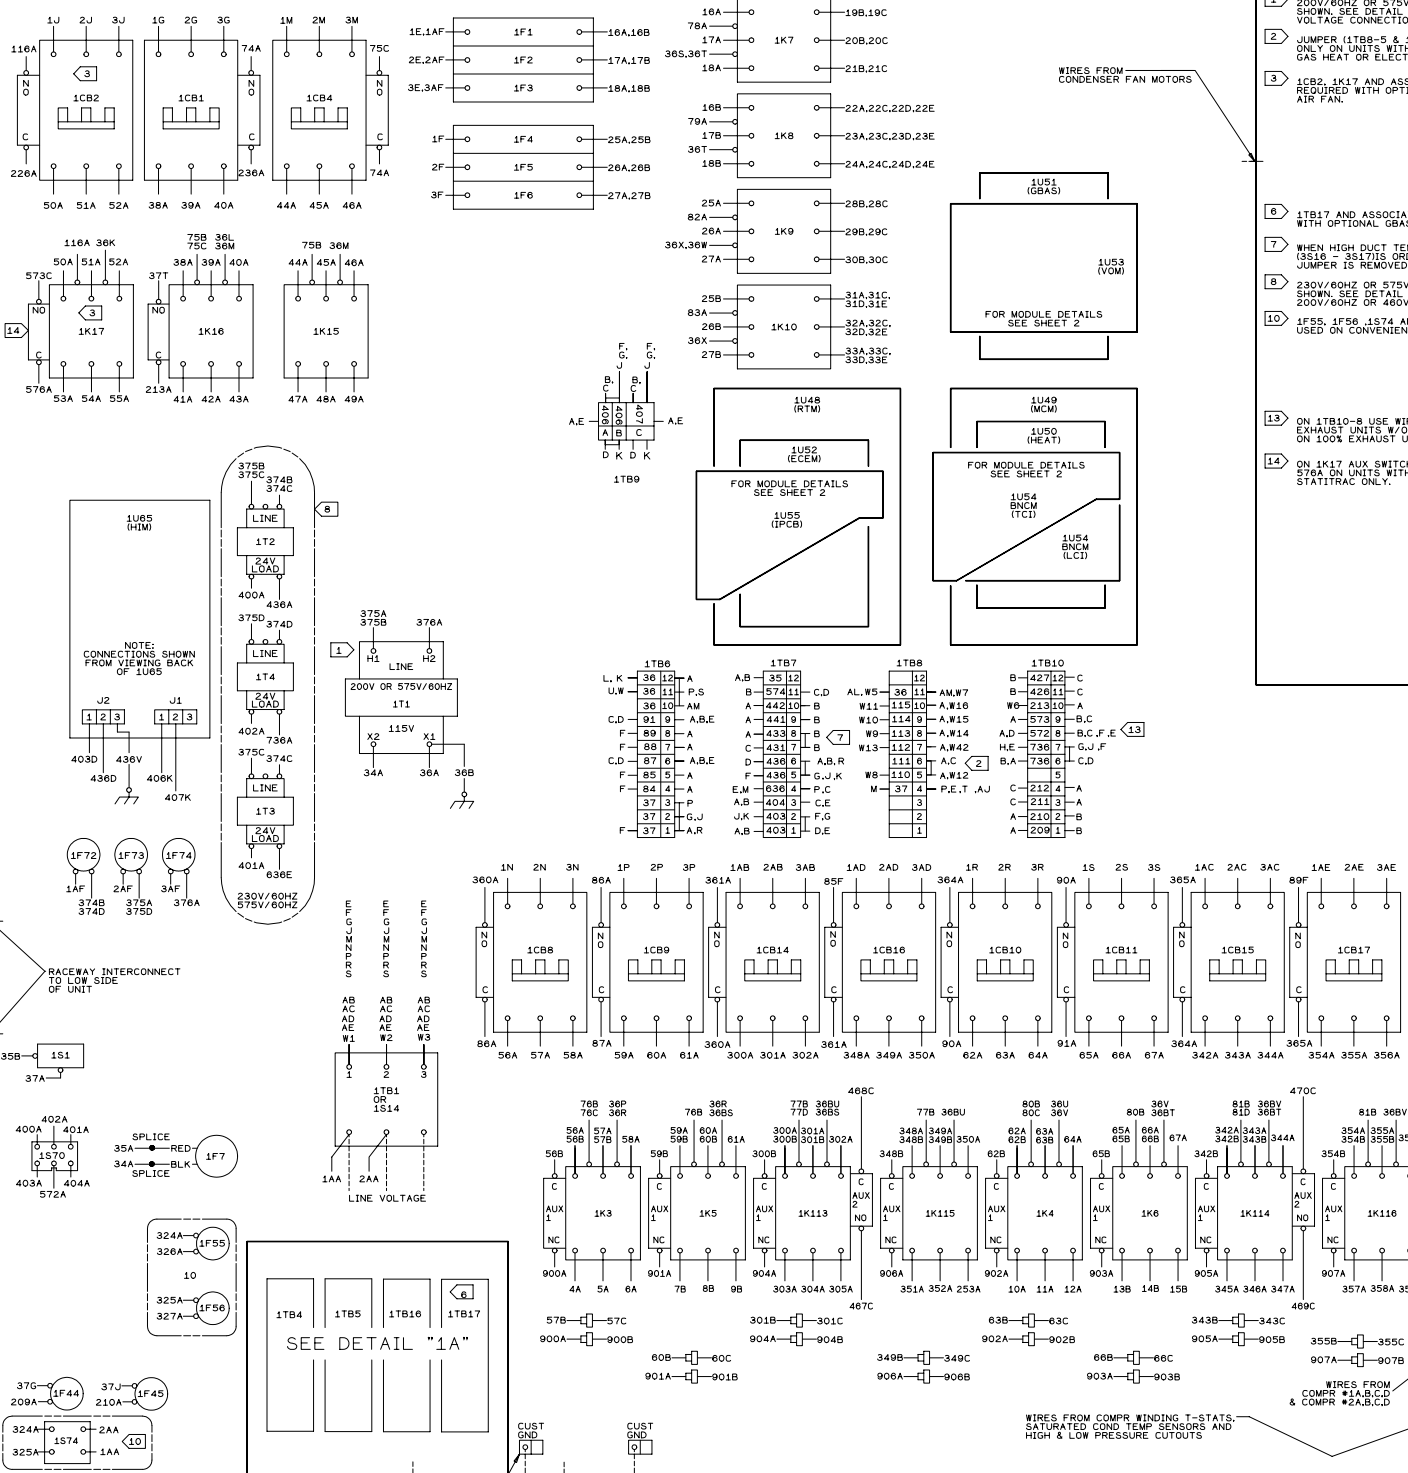

METAL PLATE 10 X 15

REF. DES.

REVISION DATE

THE TRANE COMPANY

AMERICAN STANDARD INC.

CONNECTION WIRING DIAGRAM

110 - 100 (N) 8/10

REV

2307-3938

2307-4533

A

SH1 1 OF 3