


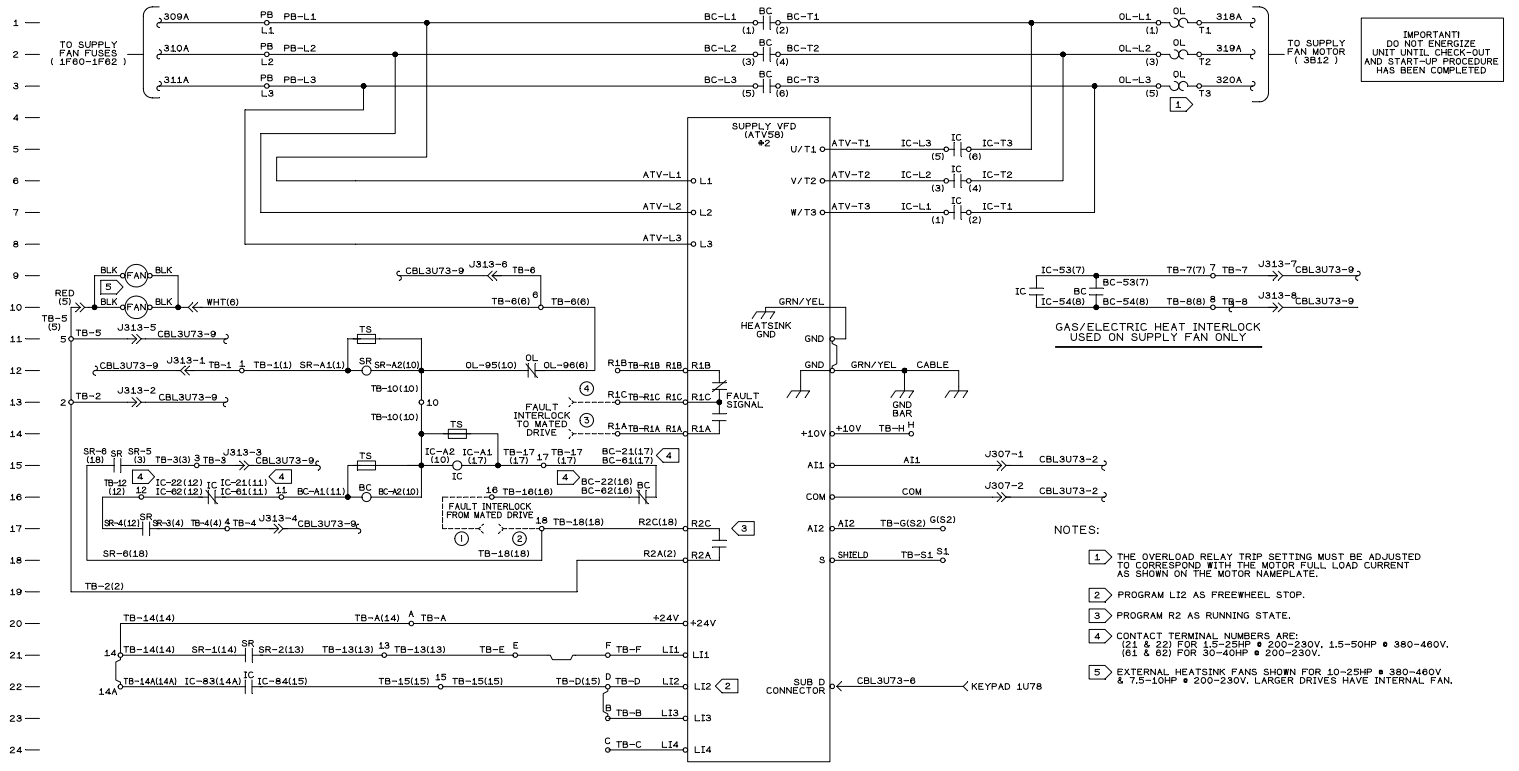

| ABBREVIATIONS |                          |
|---------------|--------------------------|
| BC            | BYPASS CONTACTOR         |
| FAN           | HEATSINK FAN             |
| IC            | ISOLATION CONTACTOR      |
| OL            | OVERLOAD                 |
| PB            | POWER BLOCK              |
| SR            | START RELAY              |
| TB            | TERMINAL BLOCK           |
| TS            | TRANSIENT SUPPRESSOR     |
| VFD           | VARIABLE FREQUENCY DRIVE |

| DEVICE PREFIX LOCATION CODE |                               |
|-----------------------------|-------------------------------|
| AREA                        | LOCATION                      |
| 1                           | INSIDE UNIT CONTROL BOX       |
| 2                           | CONDENSER SECTION             |
| 3                           | AIR HANDLER SECTION           |
| 4                           | HEATING SECTION               |
| 5                           | EXTERNAL FIELD MOUNTED DEVICE |

**WARNING**


HAZARDOUS VOLTAGE!  
DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS BEFORE SERVICING.  
FAILURE TO DISCONNECT POWER BEFORE SERVICING CAN CAUSE SEVERE PERSONAL INJURY OR DEATH.

**AVERTISSEMENT**

VOLTAGE HASARDEUX!  
DECONNECTEZ TOUTES LES SOURCES ELECTRIQUES INCLUANT LES DISJONCTEURS SITUES A DISTANCE AVANT D'EXECUTER L'ENTRETIEN.  
FAUTE DE DECONNECTER LA SOURCE ELECTRIQUE AVANT D'EXECUTER L'ENTRETIEN PEUT ENTRAÎNER DES BLESSURES CORPORELLES SEVERES OU LA MORT.

**CAUTION**

USE COPPER CONDUCTORS ONLY!  
UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.  
FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

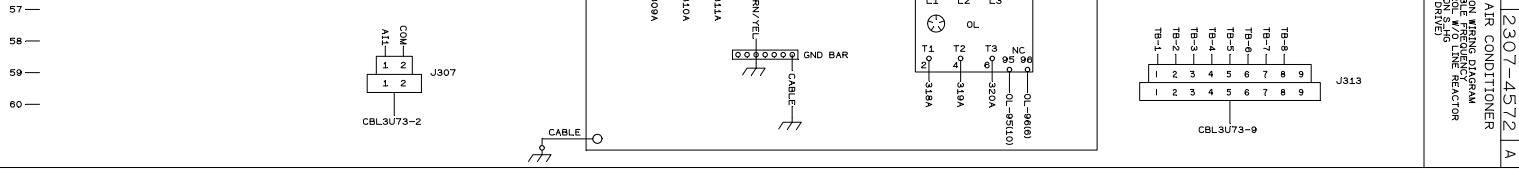

| 10 X 15 METAL PLATE                         |                                  |
|---------------------------------------------|----------------------------------|
| REVISION DATE                               | 2307-4358                        |
| THE TRANE COMPANY                           | FILE NUMBER                      |
| 2307-4572                                   | 2307-4572                        |
| SCHEMATIC & CONNECTION WIRING DIAGRAM       | ROOFTOP PACKAGED AIR CONDITIONER |
| DRIVE WITH BYPASS CONTROL & NO LINE REACTOR | 3U73-9 DRIVE                     |