

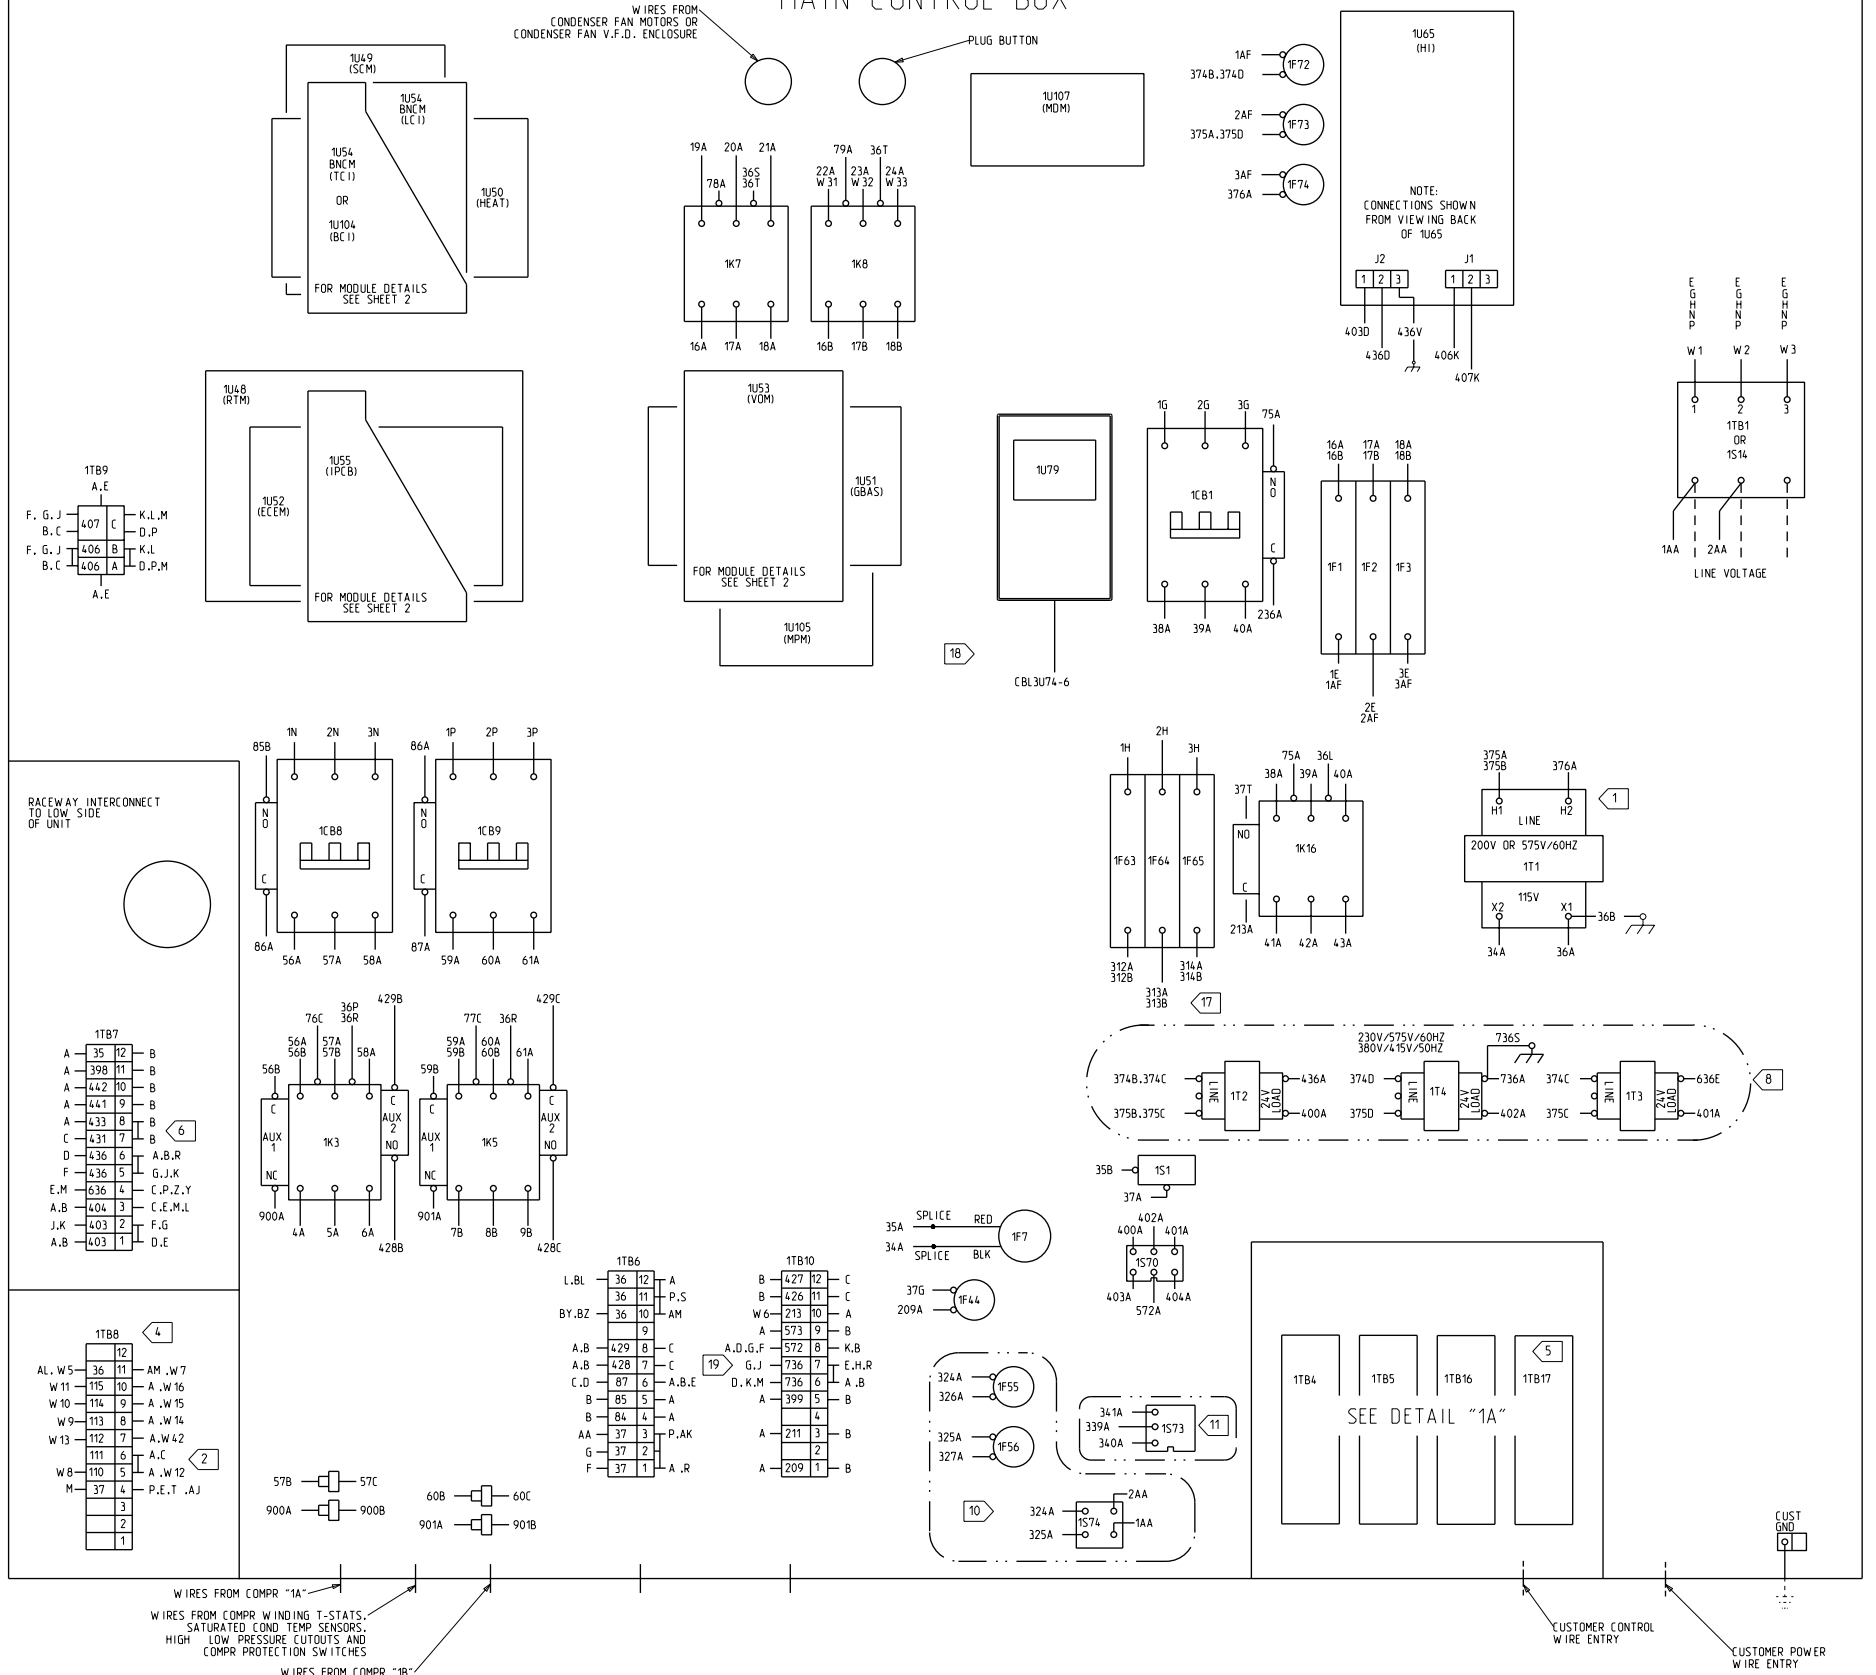


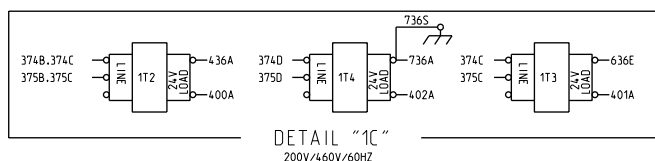

- 1 200V/60HZ OR 575V/60HZ TRANSFORMER (1T1) SHOWN. SEE DETAIL "1B" FOR OTHER VOLTAGE CONNECTIONS.
- 2 JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
- 3
- 4 1TB8 AND ASSOCIATED WIRING REQUIRED WITH ALL HEATING OPTIONS.
- 5 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
- 6 WHEN HIGH DUCT TEMP T-STAT (3516 - 3517) IS ORDERED JUMPER IS REMOVED.
- 7
- 8 230V/60HZ, 380V/50HZ, 415V/50HZ OR 575V/60HZ TRANSFORMERS SHOWN. SEE DETAIL "1C" FOR 200V/60HZ OR 460V/60HZ CONNECTIONS.
- 9 JUMPER INSTALLED ONLY ON UNITS WITHOUT ECONOMIZER OPTION.
- 10 1F55, 1F56, 1574 AND ASSOCIATED WIRING USED ON CONVENIENCE OUTLET OPTION ONLY.



DETAIL "1C"
200V/460V/60HZ

⚠ WARNING
HAZARDOUS VOLTAGE!
DISCONNECT ALL ELECTRIC POWER
INCLUDING REMOTE DISCONNECTS.
BEFORE SERVICING.

FAILURE TO DISCONNECT POWER
BEFORE SERVICING CAN CAUSE
SEVERE PERSONAL INJURY OR
DEATH.

⚠ Avertissement

VOLTAGE HASARDEUX!
DECONNECTEZ TOUTES LES SOURCES
ELECTRIQUES INCLUANT LES DISJONCTEURS
SITUÉS A DISTANCE AVANT D'EFFECTUER
L'ENTRETIEN.

**FAUTE DE DECONNECTER LA SOURCE
ELECTRIQUE AVANT D'EFFECTUER
L'ENTRETIEN PEUT ENTRAÎNER DES BLESSURES
CORPORELLES SEVERES OU LA MORT.**

CAUTION

USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED
TO ACCEPT OTHER TYPES OF
CONDUCTORS.

**FAILURE TO DO SO MAY CAUSE
DAMAGE TO THE EQUIPMENT.**

10 X 15 METAL PLATE

TRANE

FILE NUMBER: 2207

2000

DR.

AWING NUN
2207

NUMBER: 71404

SH

HEIGHT: 1330

REV