

⚠ WARNING

AVERTISSEMENT
TENSION DANGEREUSE!

ADVERTENCIA

HAZARDOUS VOLTAGE: DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS BEFORE WORKING ON THE MOTOR. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITE WITH VARIABLE SPEED DRIVE, REEFER CAPACITORS ARE A HAZARD FOR CAPACITOR DISCHARGE. FAILURE TO DO THE ABOVE BEFORE SPRAYING COULD RESULT IN DEATH OR SERIOUS INJURY.

CAUTION DANGER/PELIGRO: COUPER TOUTES LES TENSIONS ET SURVEILLER LES SECTIONNÉS A DISTANCE, EN S'ASSURANT D'AVANT TOUTE INTERVENTION, VÉRIFIER QUE TOUTES LES CONDENSATEURS DES MOTEURS SONT DÉCHARGÉS. DANS LE CAS D'UNES COMPARTEMENTS DES ENTRAÎNEMENTS A VITESSE VARIABLE, LES CONDENSATEURS SONT DES DANGERS POUR LES OPÉRATEURS. NE PAS RESPECTER CES MESURES DE PRÉCAUTION PEUT ENTRAÎNER DES BLESSURES GRAVES POUVANT ÊTRE MORTELLES.

¡VOLTAGE PELIGROSO! DESCONECTE TODA LA ENERGÍA ELÉCTRICA, INCLUIDO LOS DESCONECTORES REMOTE Y TRABAJA EN EL MOTOR. ASEGÚRASE DE QUE TODOS LOS CONDENSADORES DEL MOTOR HAYAN DESCARGADO EL VOLTAJE ALMACENADO. PARA LAS UNIDADES CON ELE DE VARIACIÓN DE VELOCIDAD, LOS CONDENSADORES SON UN DANGERO PARA LOS OPERARIOS. NO CONSULTAR LAS INSTRUCCIONES PARA LA DESCARGA DEL CONDENSADOR, LO REALIZAR O LO ADECUADO INICIAO, PODRIA CAUSAR LA MUERTE O SERIAS LESIONES PERSONALES.

NOTICE





PALETTE TO DO THE ABOVE COULD RESULT IN EQUIPMENT DAMAGE.	USE COPPER CONDUCTORS ONLY! UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.	N'UTILISER QUE DES CONDUCTEURS EN CUivre! LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.	NO SECURE THE INSTRUCTIONS ANTERIORES PUEDE PROVOCAR DAÑOS EN EL EQUIPO.
--	--	--	---

AVIS

¡UTILÍCE UNICAMENTE CONDUCTORES DE COBRE!
LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS
PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.
NO SECUR LAS INSTRUCCIONES ANTERIORES PUEDE
PROVOCAR DAÑOS EN EL EQUIPO.

NOTES:
 1 HEAT MODULE 1U34 SHOWN FOR ELECTRIC HEAT CONNECTIONS SHOWN IN (PARENTHESES) ARE ADDITIONAL CONNECTIONS REQUIRED FOR STEAM/HOT WATER HEAT.

2 EITHER LCI-1 OR BCI-1 IS INSTALLED IN THIS LOCATION BASED ON MODEL NUMBER SELECTION.

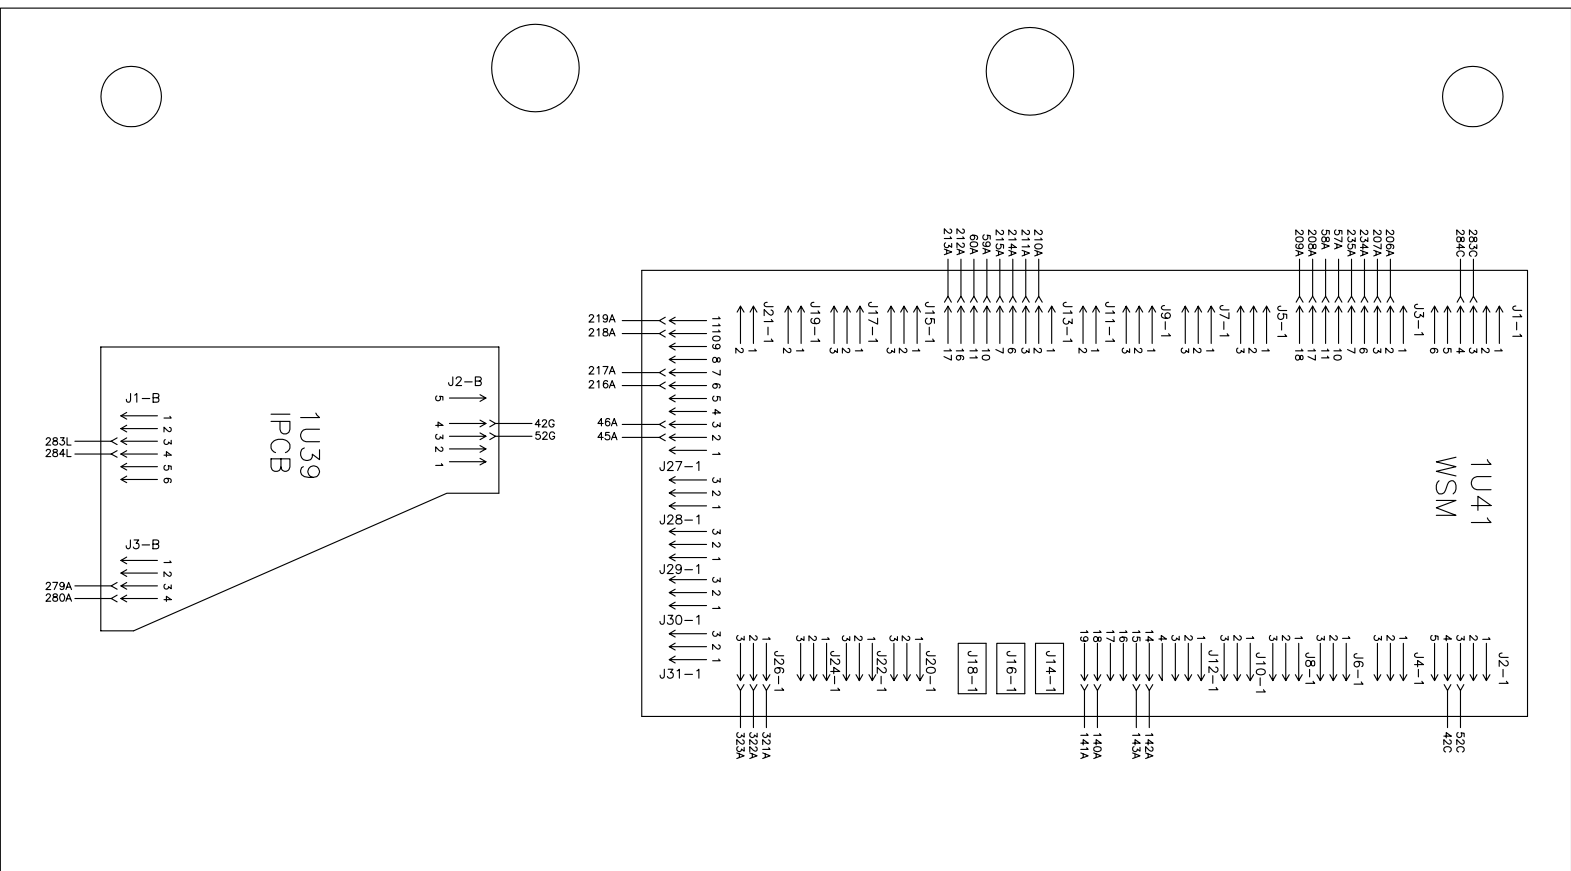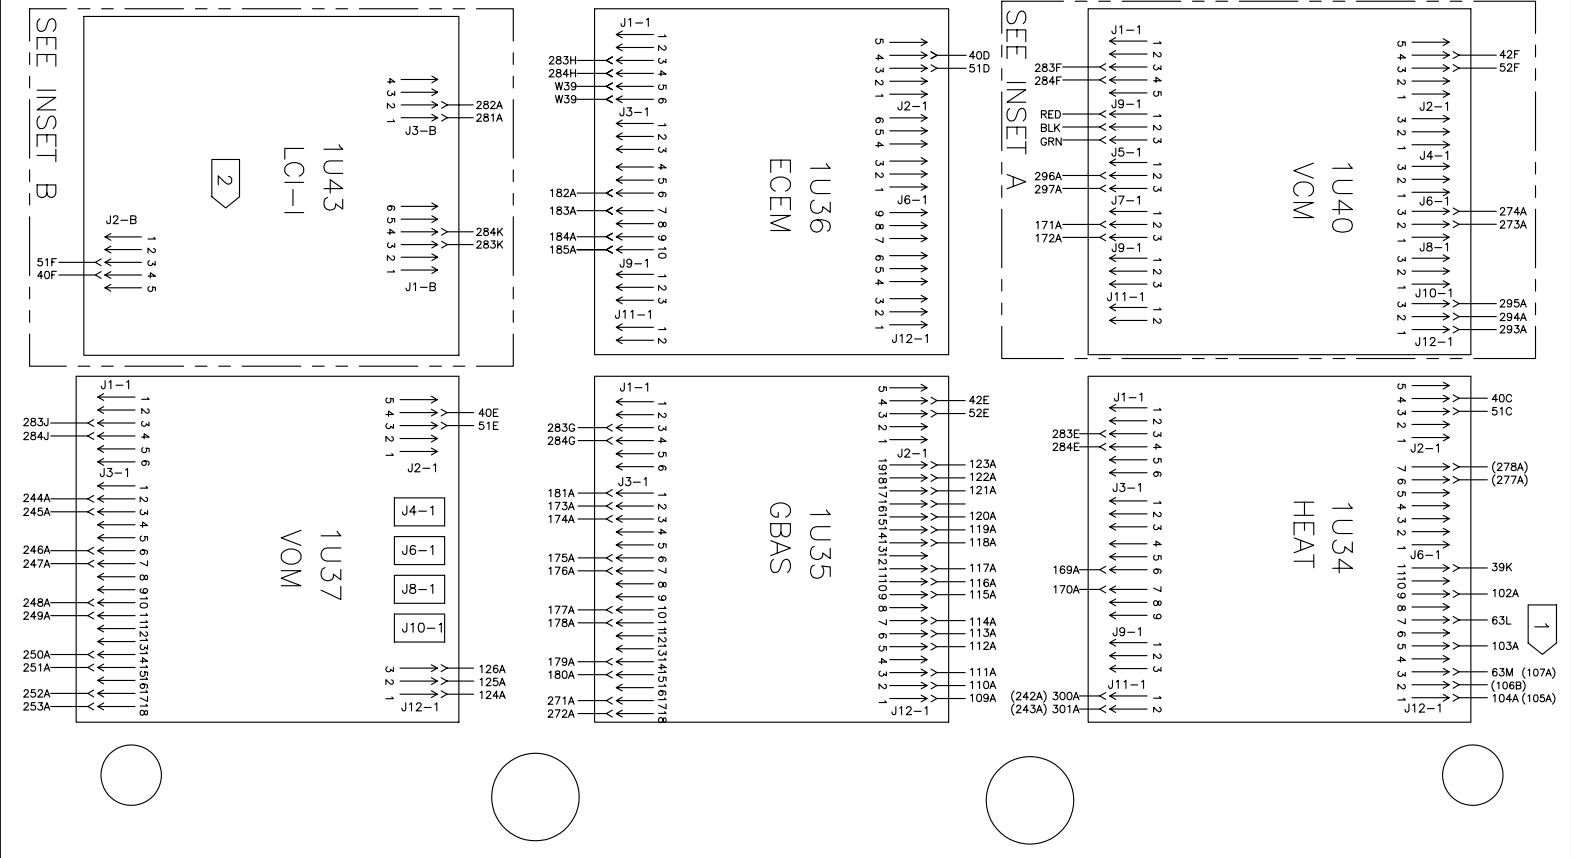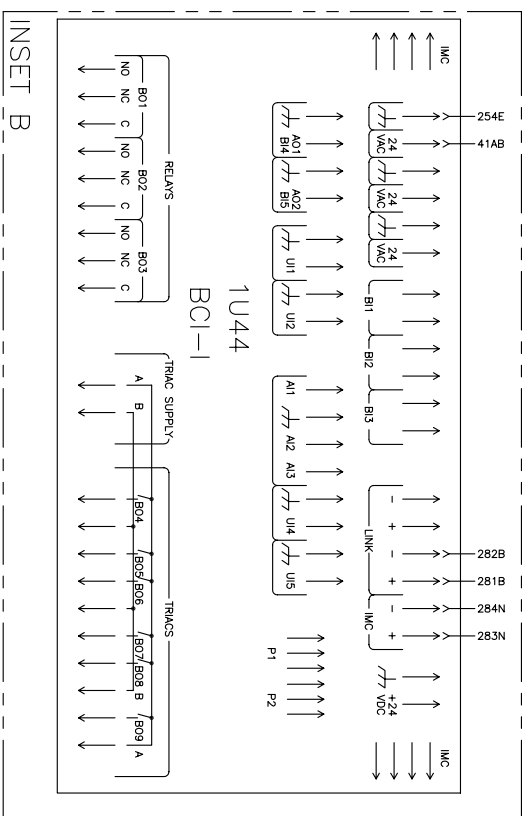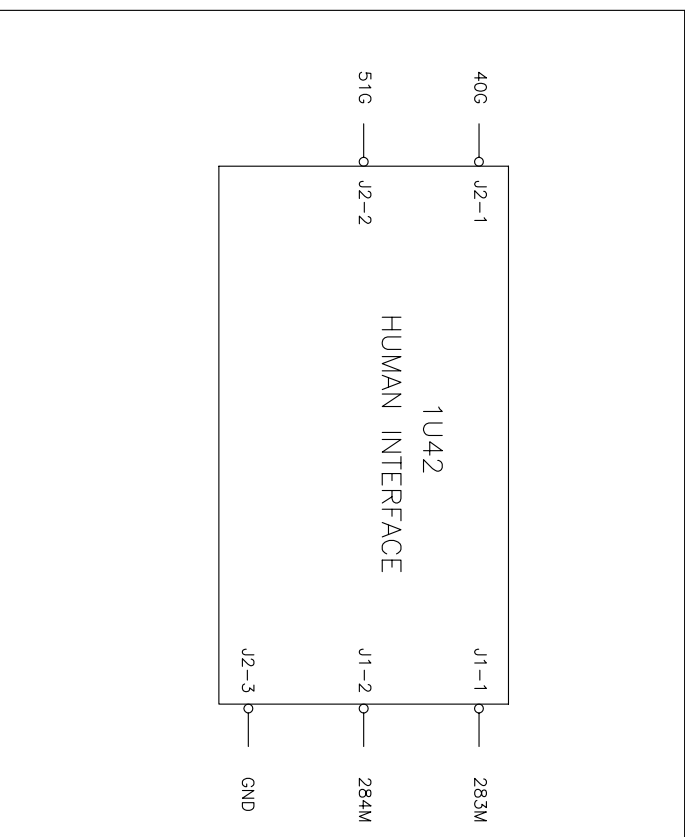

CN SC5960 29-JUN-09 J. GRIMES	THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE	DRAWN BY: G. HURT © TRANE DATE: 30-SEP-98	DO NOT SCALE PRINT  THIRD ANGLE PROJECTION
		CONNECTION DIAGRAM CSC W/VFD & VFD W/BYPASS 460V/60HZ/3PH S*WF 85 TON	