



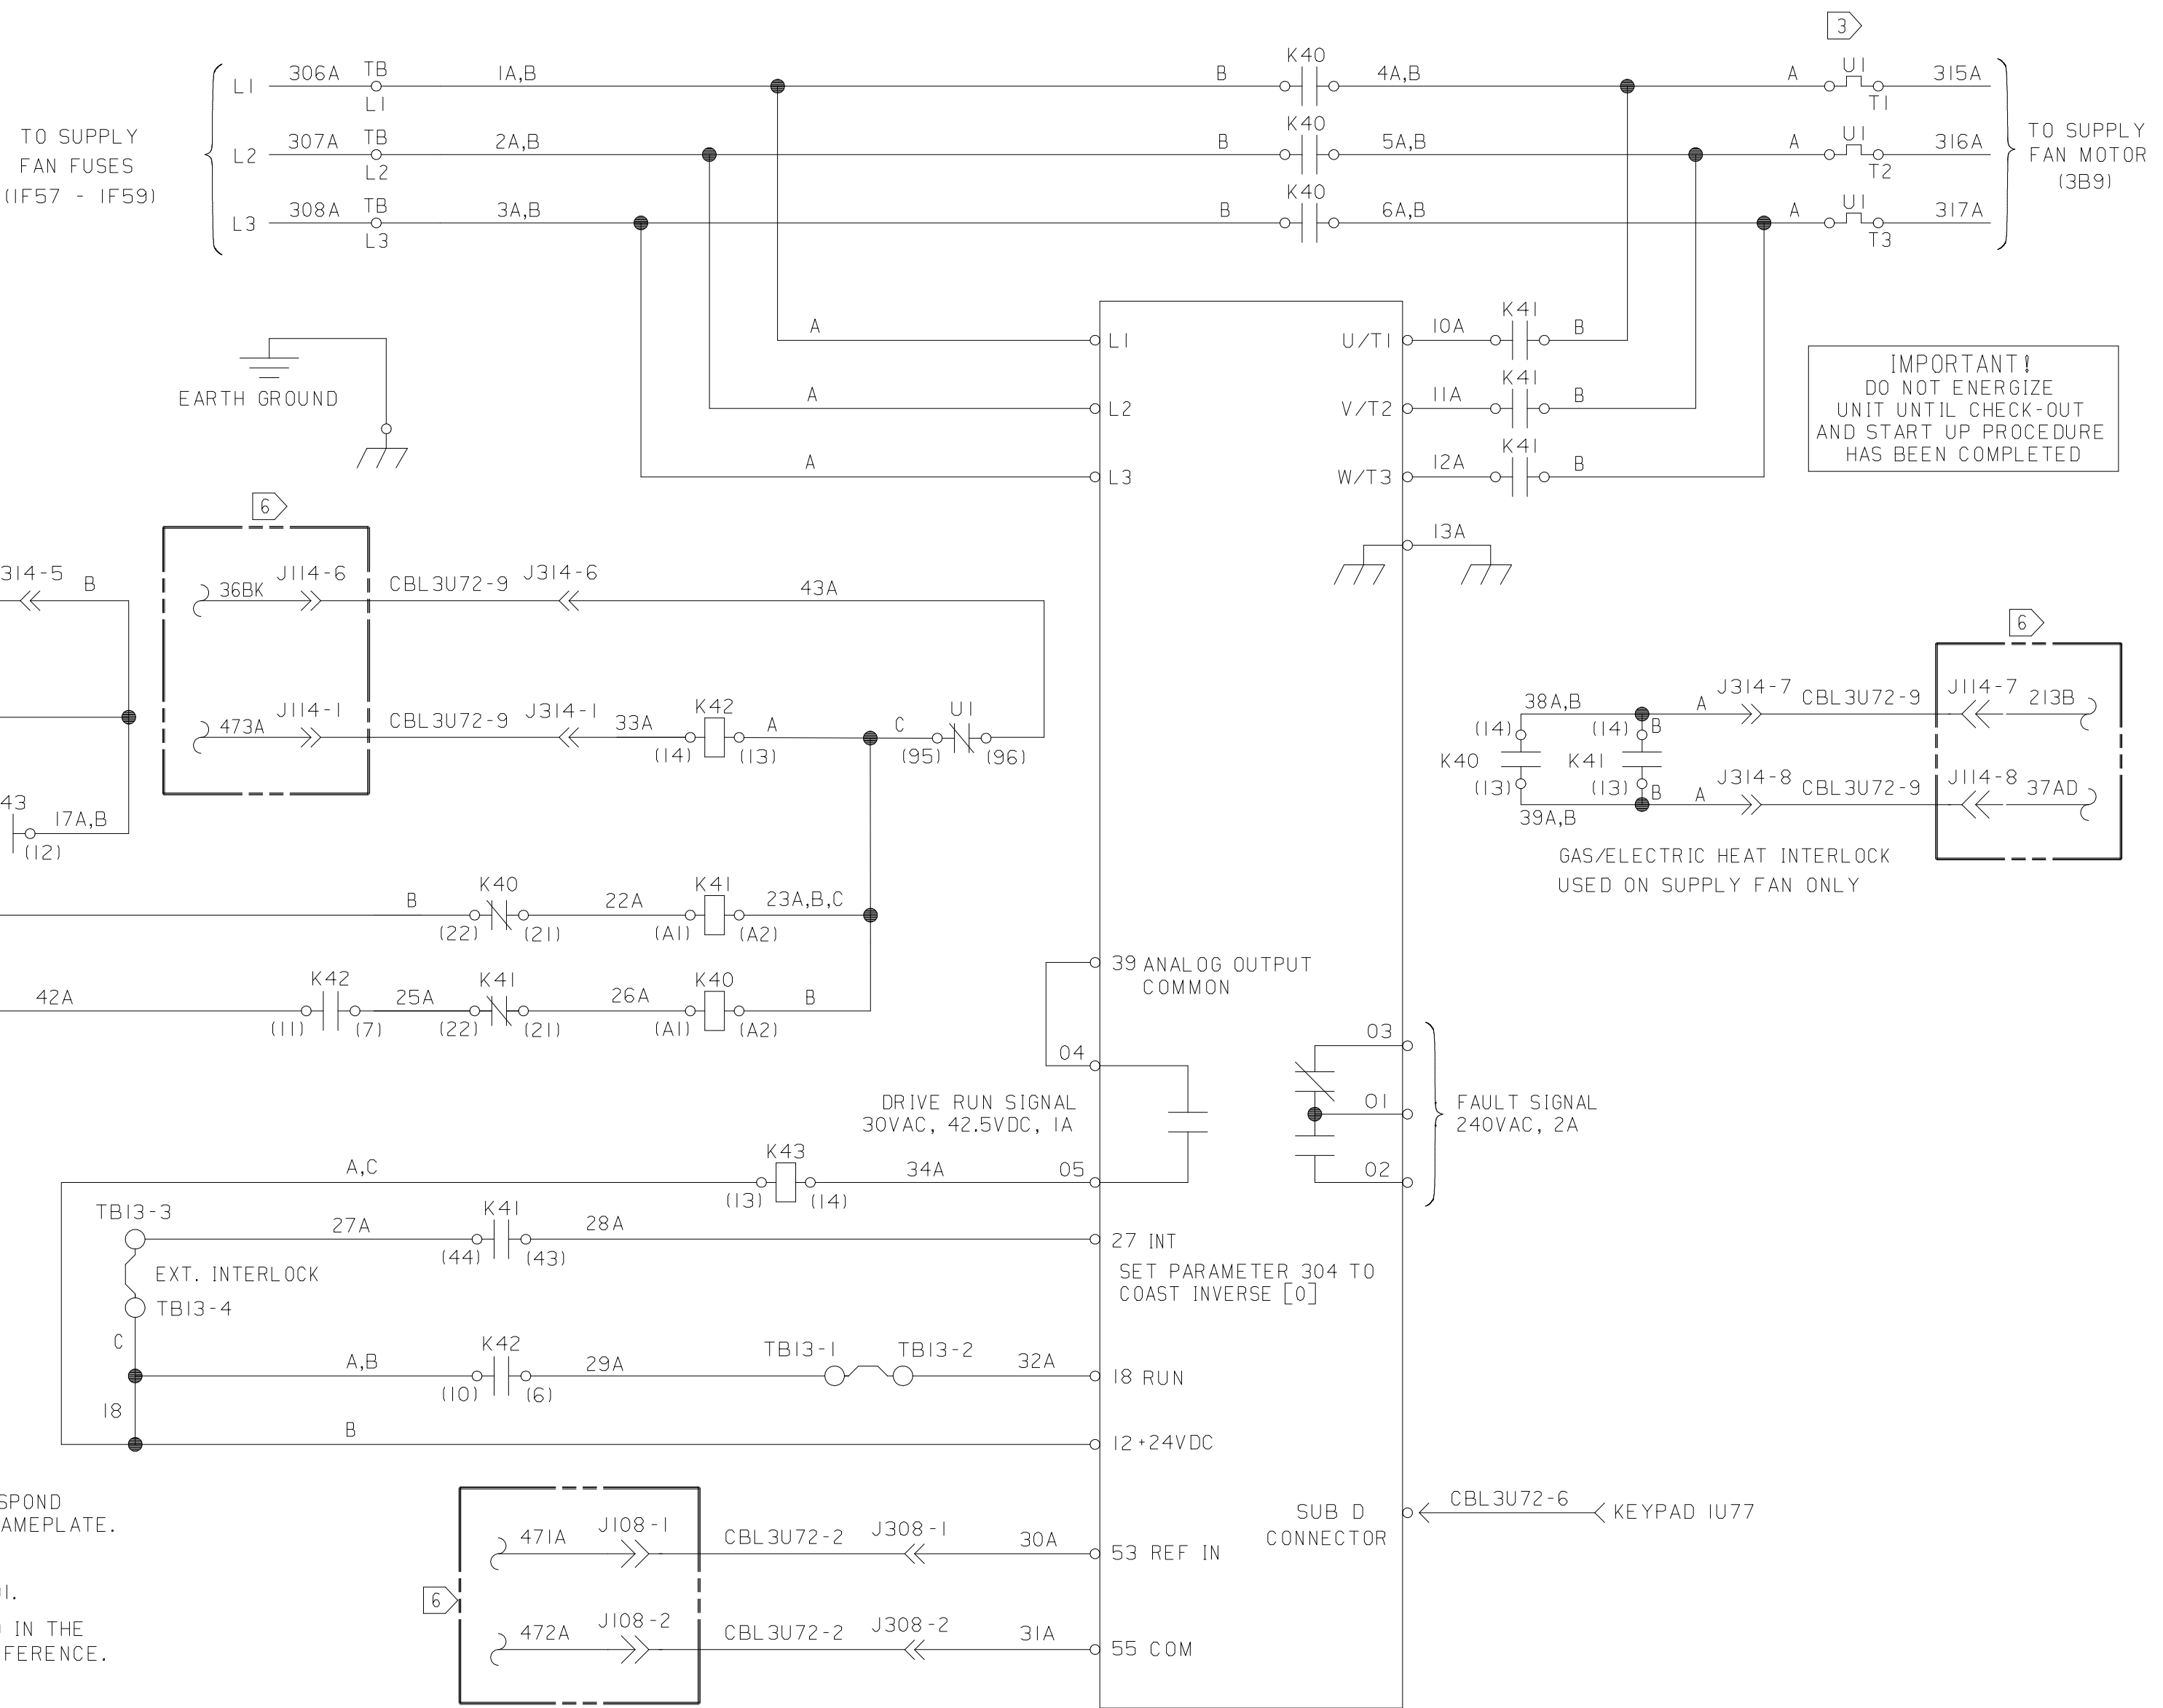

- 1 UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25° C (77° F), AT ATMOSPHERIC PRESSURE, AT 50% RELATIVE HUMIDITY, WITH ALL UTILITIES TURNED OFF, AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
- 2 ALL FIELD WIRING MUST BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC), STATE AND LOCAL REQUIREMENTS.
- 3 THE OVERLOAD RELAY TRIP SETTING MUST BE ADJUSTED TO CORRESPOND WITH THE MOTOR FULL LOAD CURRENT AS SHOWN ON THE MOTOR NAMEPLATE.
- 4 THIS PANEL LAYOUT IS APPLICABLE TO FIGURE 1 OF XI31070391
- 5 INSET A LAYOUT IS APPLICABLE TO FIGURES 2 AND 3 OF XI31070391.
- 6 J108, J114, I572 & ASSOCIATED WIRING CONNECTIONS ARE LOCATED IN THE MAIN UNIT CONTROL BOX. SCHEMATIC WIRING SHOWN HERE FOR REFERENCE.

DEVICE PREFIX LOCATION GUIDE	
AREA	LOCATION
1	INSIDE UNIT CONTROL BOX
2	CONDENSER SECTION
3	AIR HANDLER SECTION
4	HEATING SECTION
5	EXTERNAL FIELD MOUNTED DEVICE

(SEE NOTE 4)

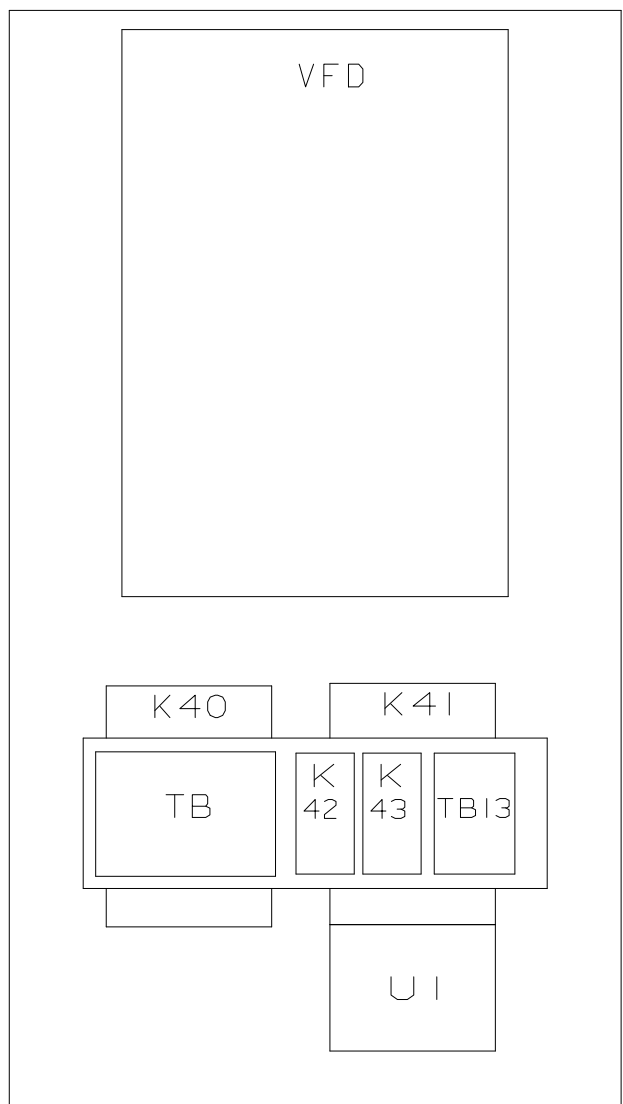

TRANE A DIVISION OF AMERICAN STANDARD INC. ALL RIGHTS RESERVED THIS DRAWING IS PROPERTY OF TRANE AND SHALL NOT BE COPIED OR ITS CONTENTS REPRODUCED WITHOUT THE WRITTEN CONSENT OF TRANE	
DRAWN BY: P. BRUCE JR.	DATE: 08/01/03
REPLACES:	REVISION DATE:
CA0055	SIMILAR TO: 2307-4569

FILE NUMBER:

DRAWING NUMBER:
2309-3199

REV
C

SCHEMATIC AND CONNECTION DIAGRAM
SUPPLY FAN VARIABLE FREQUENCY
DRIVE W/ BYPASS CONTROL