
NOTES:

11 WIRING SHOWN IS FOR 460V. 415V OR 380V. FOR 575V MOVE ALL WIRES FROM 460V TERMINAL TO 575V TERMINAL ON TNS1.

14 HEATER HTRC IS USED FOR 54 KW ONLY.

16 WIRE 36M IS ONLY USED ON 40-50 TON UNITS.

• • LEGEND • •		
DEVICE DESIGNATION	DESCRIPTION	LINE NUMBER
AH	ELECTRIC HEAT CONTACTOR	109
BH	ELECTRIC HEAT CONTACTOR	110
FU11	ELECTRIC HEAT FUSE	70
FU12	ELECTRIC HEAT FUSE	71
FU13	ELECTRIC HEAT FUSE	72
FU14	ELECTRIC HEAT FUSE	80
FU15	ELECTRIC HEAT FUSE	81
FU16	ELECTRIC HEAT FUSE	82
HLC1	HIGH LIMIT CUTOUT #1	109
HTRA	ELECTRIC HEAT ELEMENT	71
HTRB	ELECTRIC HEAT ELEMENT	81
HTRC	ELECTRIC HEAT ELEMENT	81
ODF34	OUTDOOR FAN RELAY #34	105
RTRM	REFRIGERATION MODULE	104
TNS1	CONTROL POWER TRANSFORMER	102

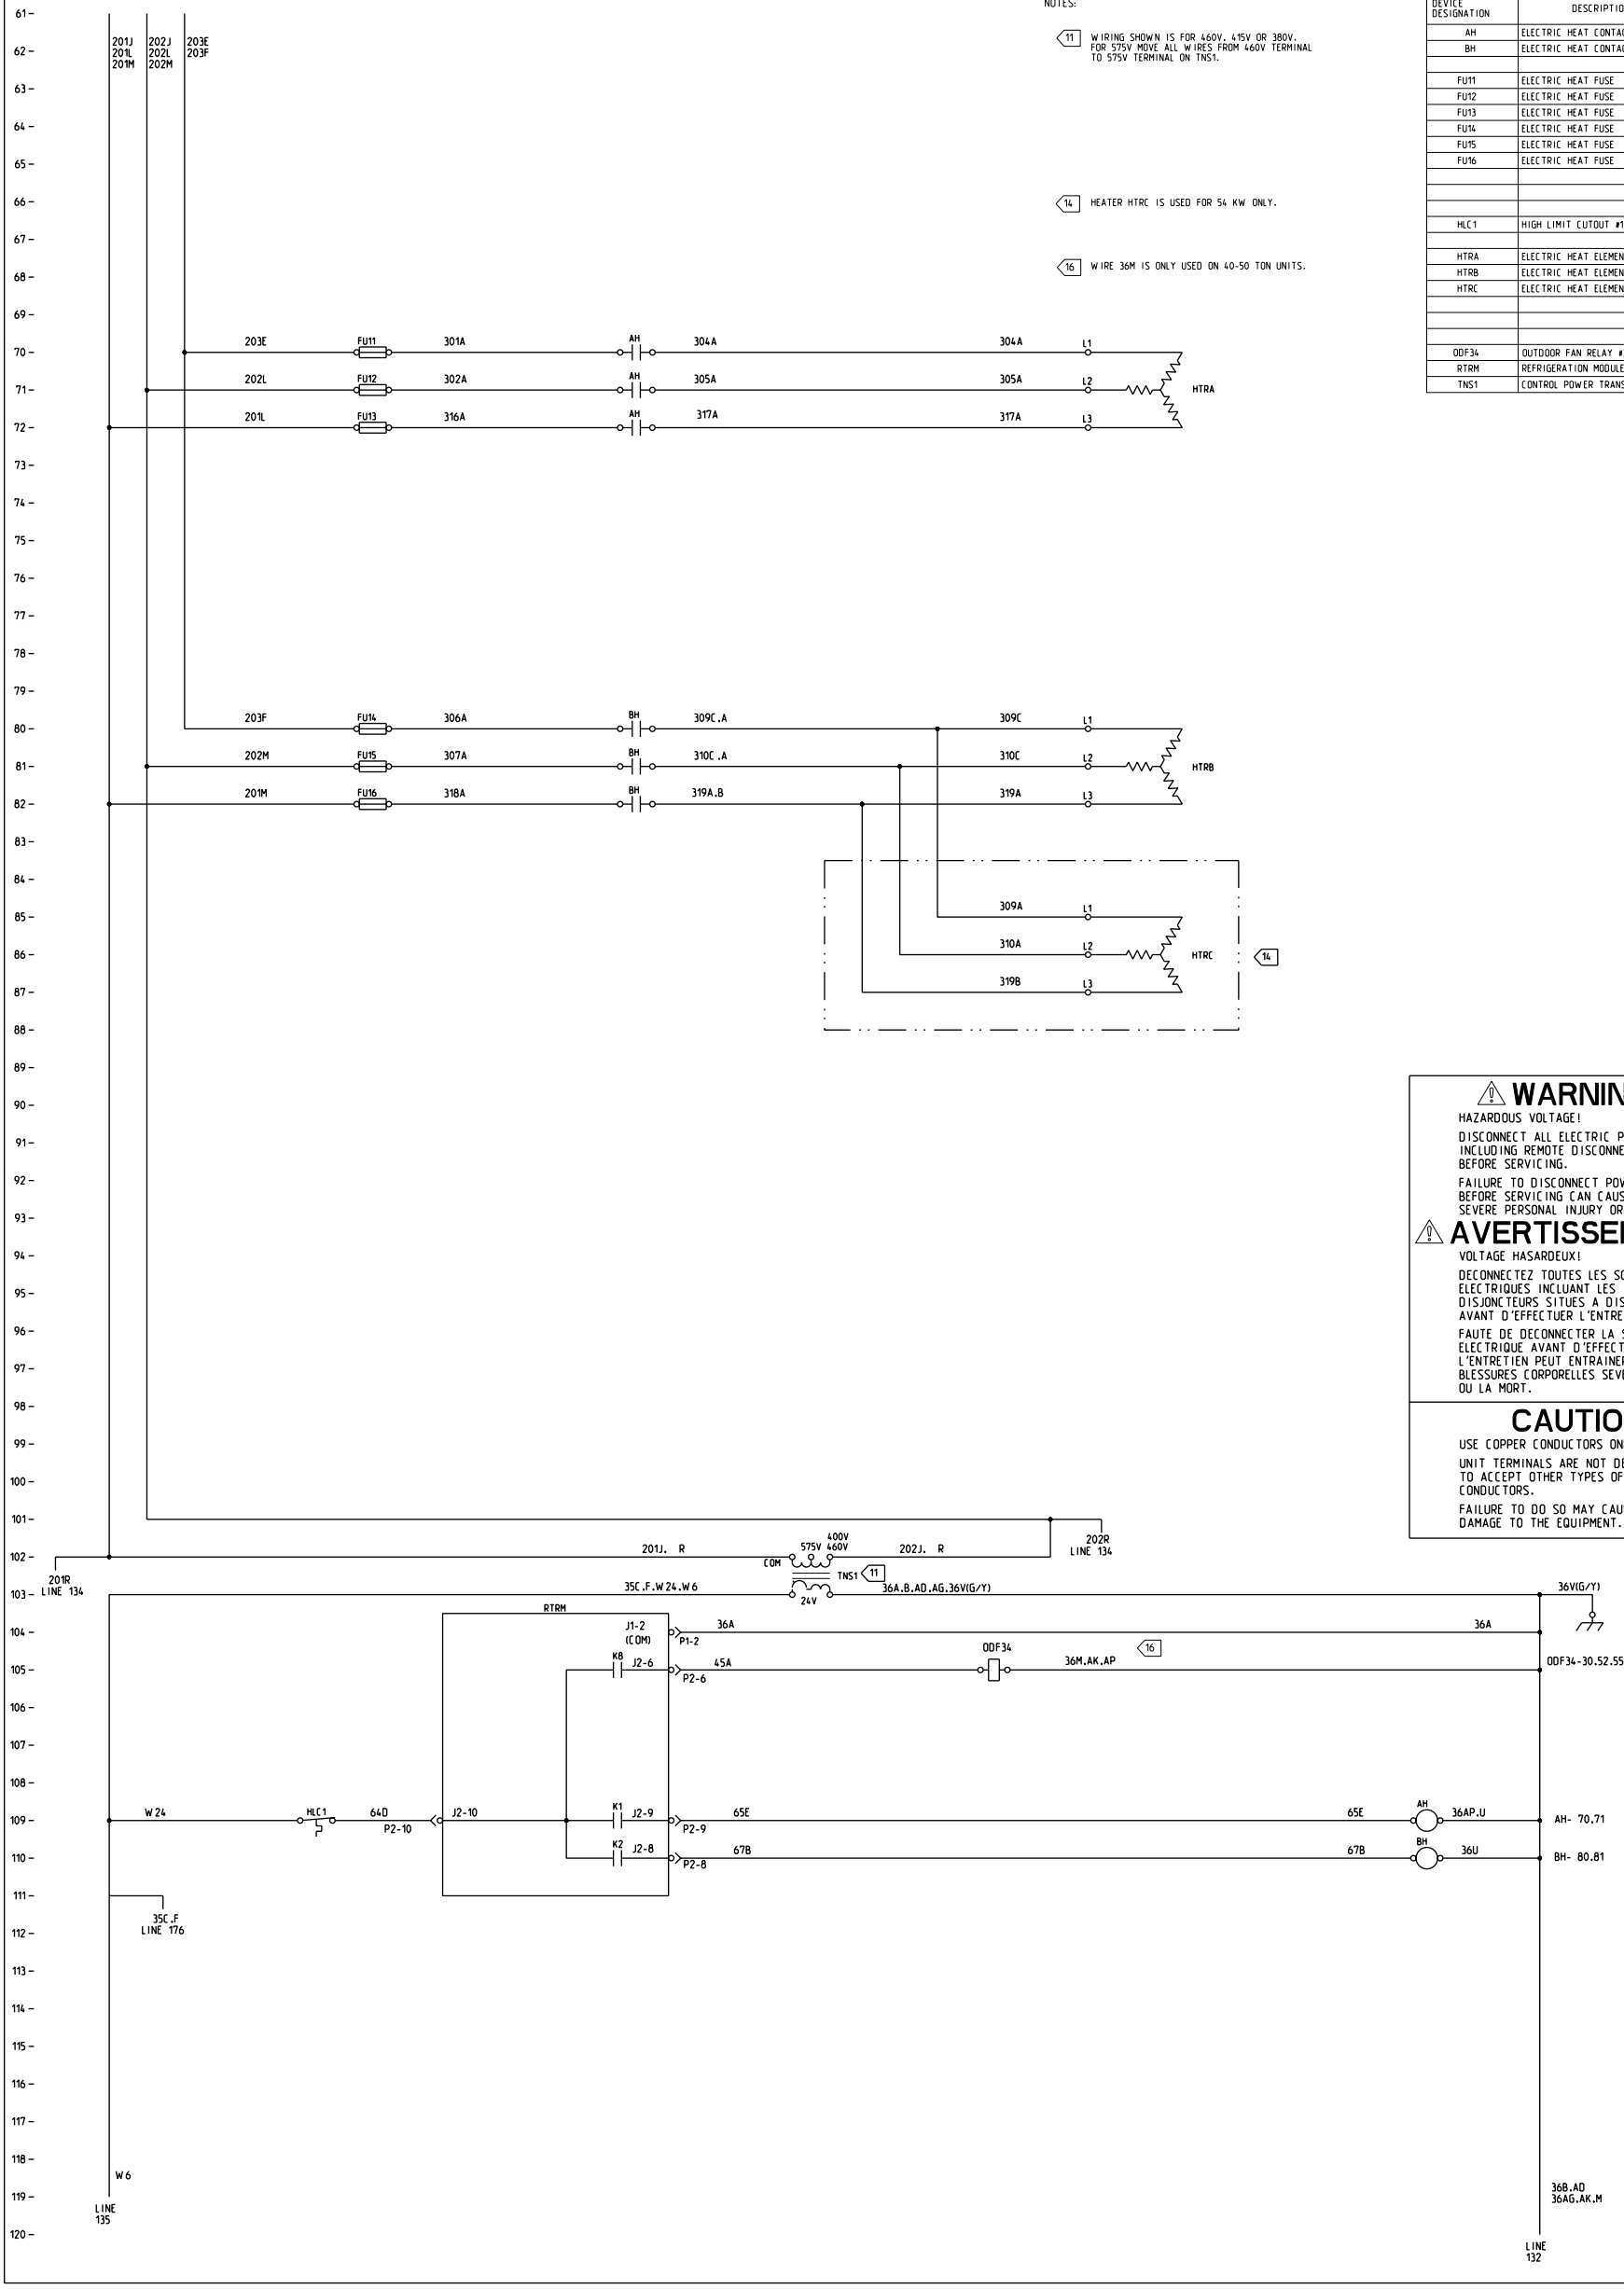

⚠ WARNING

HAZARDOUS VOLTAGE!

DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS BEFORE SERVICING.

FAILURE TO DISCONNECT POWER BEFORE SERVICING CAN CAUSE SEVERE PERSONAL INJURY OR DEATH.

⚠ AVERTISSEMENT

VOLTAGE HASARDEUX!

DECONNECTEZ TOUTES LES SOURCES ELECTRIQUES INCLUANT LES DISJONCTEURS SITUES A DISTANCE AVANT D'EFFECTUER L'ENTRETIEN.

FAUTE DE DECONNECTER LA SOURCE ELECTRIQUE AVANT D'EFFECTUER L'ENTRETIEN PEUT ENTRAINER DES BLESSURES CORPORELLES SEVERES OU LA MORT.

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

METAL PLATE 11 X 17

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.

TRANE

DRAWN BY: D. GOUTAM
TRANE® DATE: 11-30-07
REPLACES:
REVISION DATE:
CAD SYSTEM USED: PRO-E
SIMILAR TO: 2307-4393

FILE NUMBER: 2309-3413
DRAWING NUMBER: 2309-3417
SHEET: 1 OF 1
REV: A

VOYAGER 3
POWER SCHEMATIC
FOR 36 AND 54 KW ELECTRIC HEAT
380/575 VOLTS