


FAILURE TO DO THE ABOVE BEFORE
SERVICING COULD RESULT IN DEATH OR
SERIOUS INJURY.

NE PAS RESPECTER CES MESURES DE
PRÉCAUTION PEUT ENTRAÎNER DES
BLESSURES GRAVES POUVANT ÊTRE
MORTELLLES.

EL NO REALIZAR LO ANTERIORMENTE
INDICADO, PODRÍA OCASIONAR LA MUERTE
O SERIAS LESIONES PERSONALES.

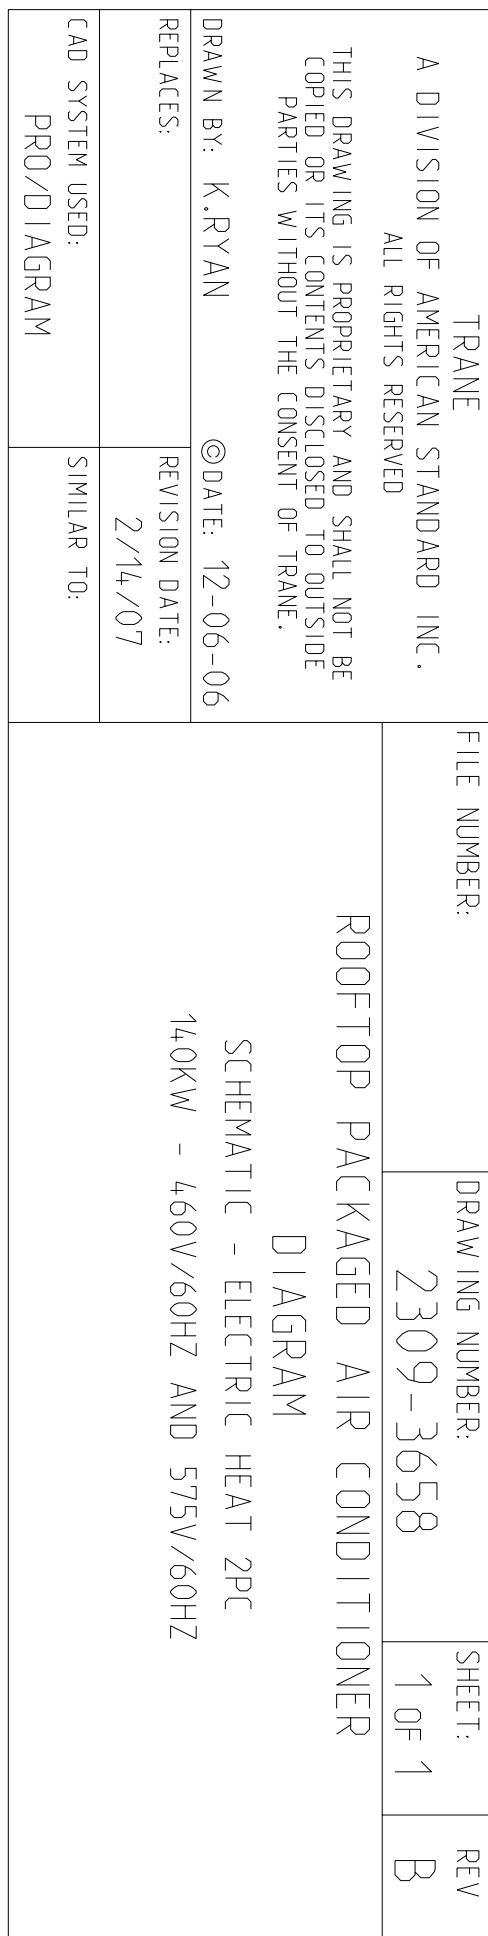

- | DEVICE PREFIX LOCATION CODE | |
|-----------------------------|------------------------------|
| AREA | LOCATION |
| 1 | INSIDE UNIT CONTROL BOX |
| 2 | CONDENSER SECTION |
| 3 | INSIDE SECONDARY CONTROL BOX |
| 4 | HEAT/EXTENDED CASING SECTION |
| 5 | SUPPLY FAN SECTION |
| 6 | EVAP SECTION |
| 7 | DAMPER/FILTERS SECTION |
| 8 | EXHAUST/RETURN FAN SECTION |
| 9 | EXTERNAL FIELD MTD DEVICE |

CONTACTOR COIL LOCATIONS		
REF DES	DESCRIPTION	LINE NO.
1K5	CONTACTOR - SUPPLY FAN	84
4K15-4K18	CONTACTOR - PRIMARY	40,43,44,47
4K23-4K25	CONTACTOR - SECONDARY	51,52,53

LEGEND		
DEVICE DESIG	DESCRIPTION	LINE NUMBER
1S1/1TB1	UNIT DISCONN/TERM BLOCK	9
1U6	MODULE - HEAT	37
4CB10	CIRCUIT BREAKER	27
4CB7	CIRCUIT BREAKER	24
4CB8	CIRCUIT BREAKER	21
4CB9	CIRCUIT BREAKER	18
4HR7	HEATER ELEMENT ASSEMBLY	17,20,23,26
4S22	SWITCH - HIGH LIMIT (DISC)	51
4S23	SWITCH - HIGH LIMIT (LINEAR)	51
5U16	V.F.D. - SUPPLY FAN	34