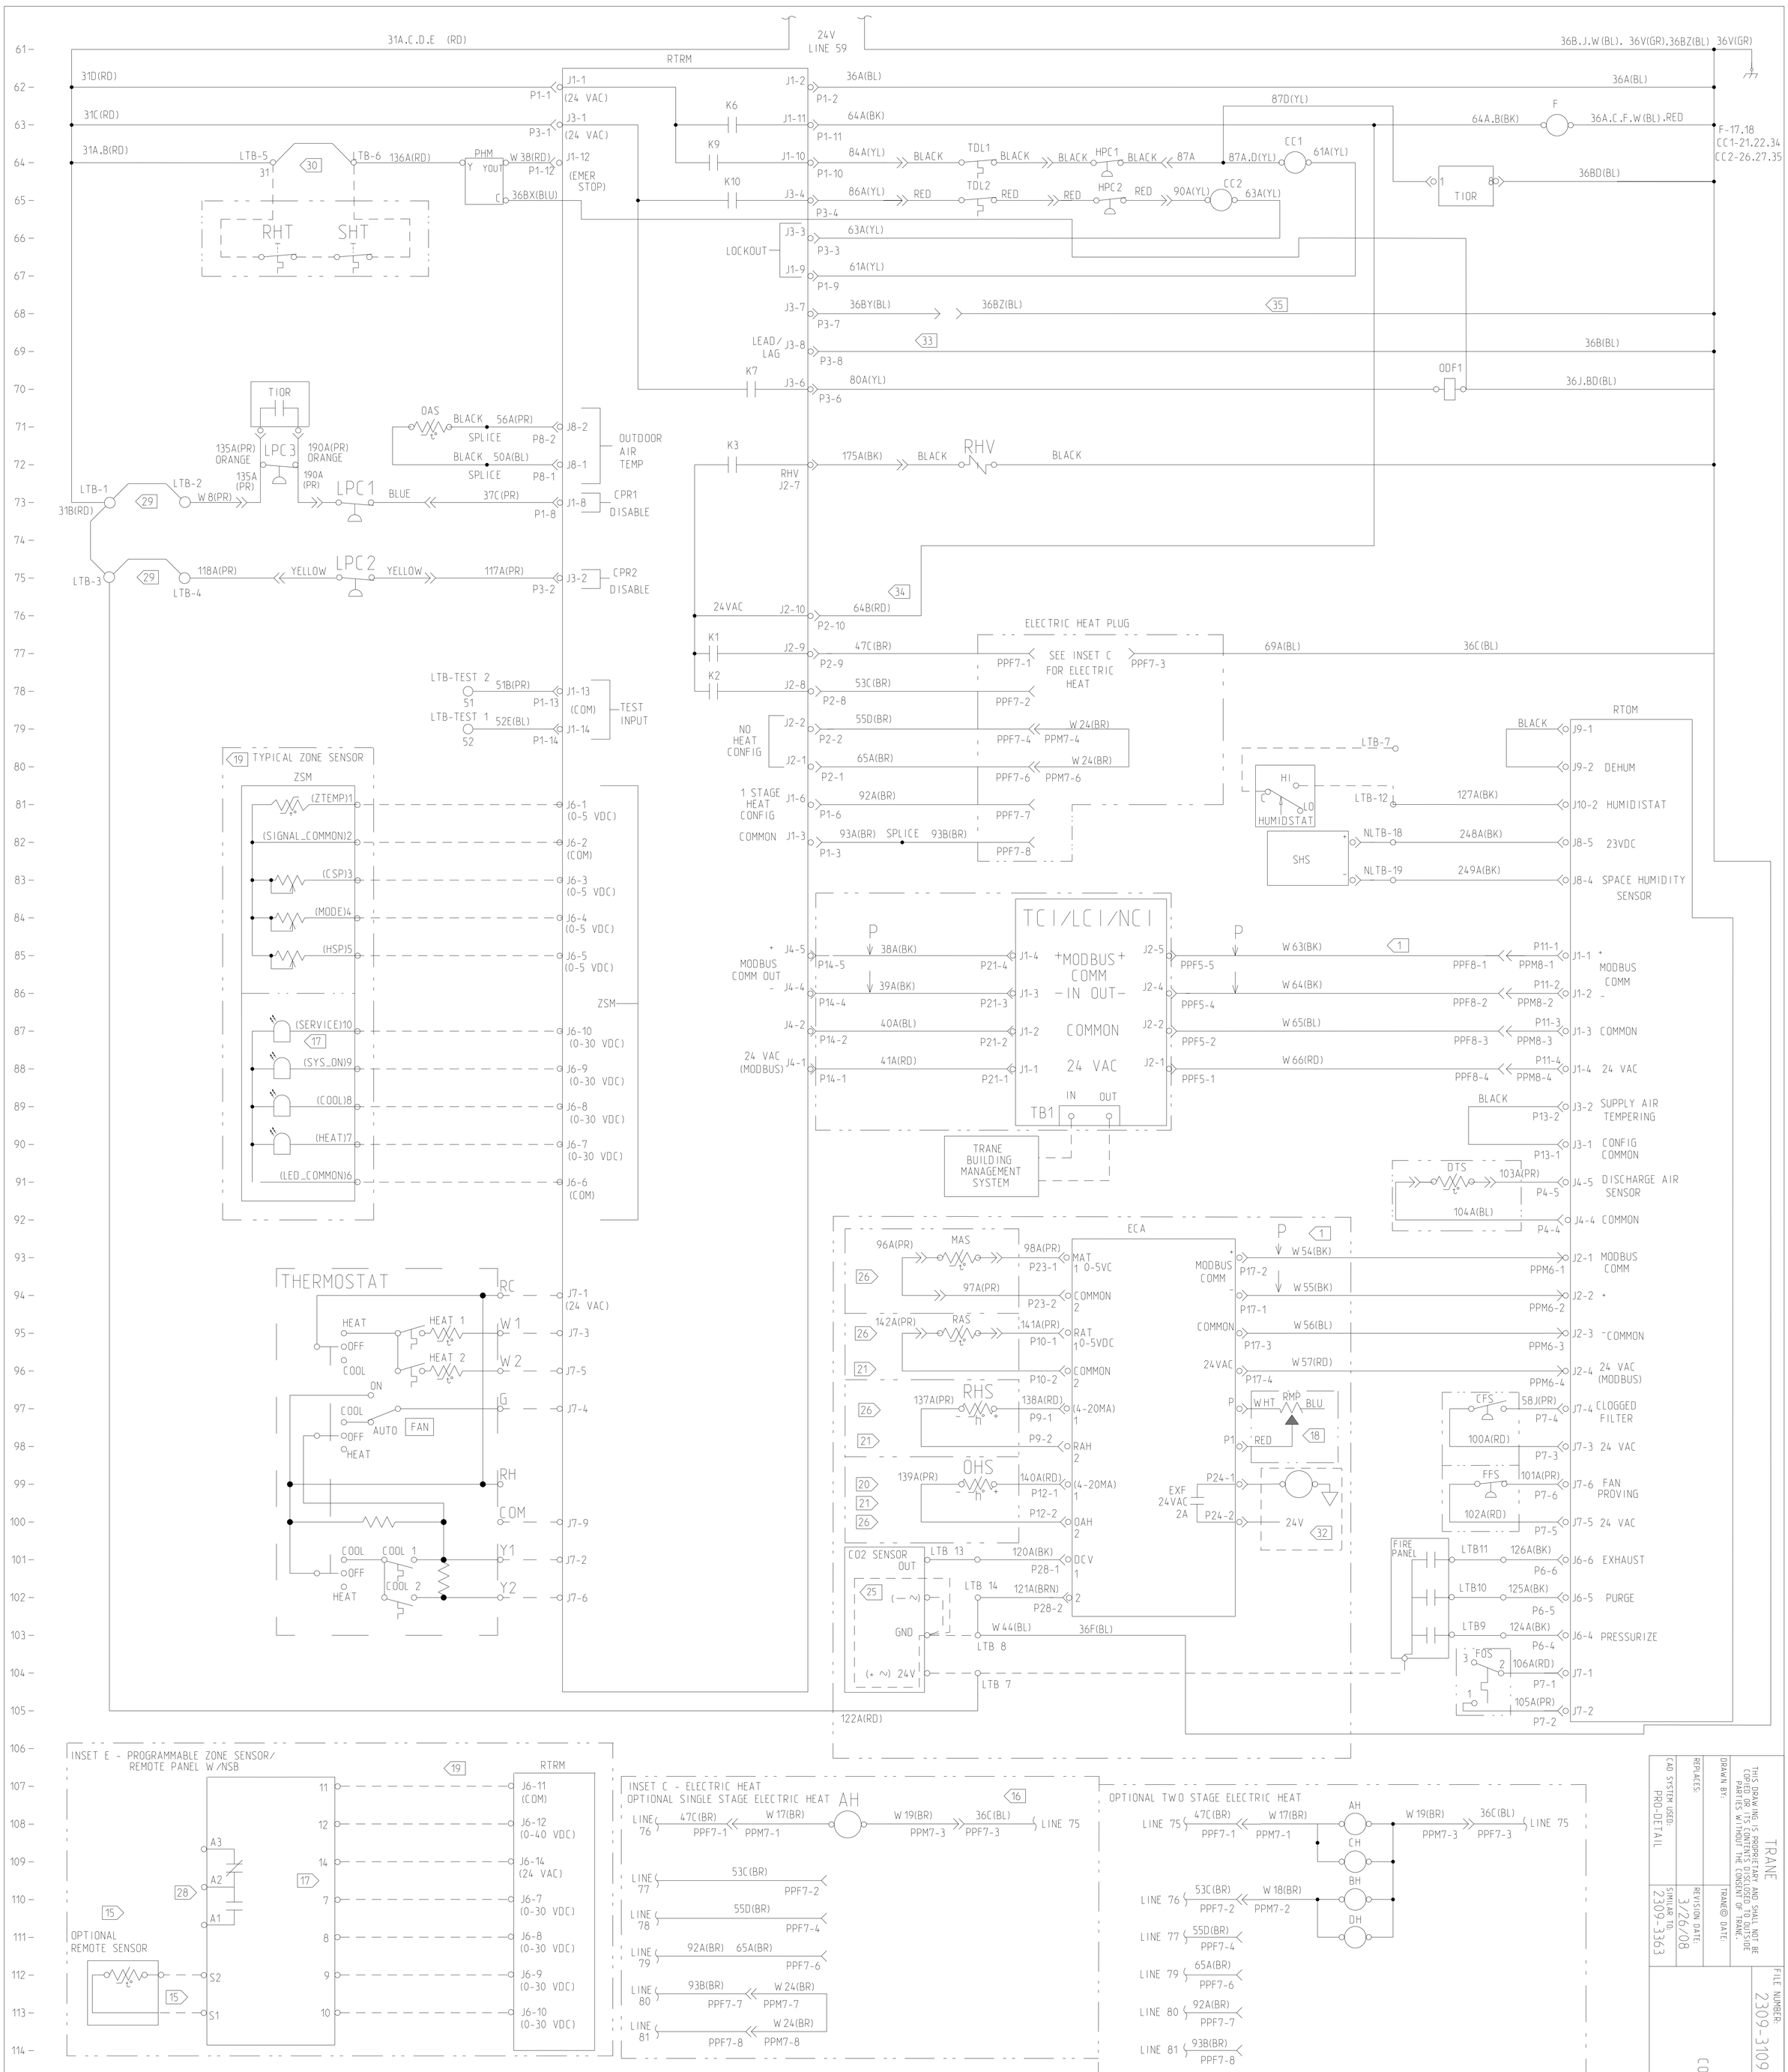

NOTES:

1. ALL UNITS SHIP WITH AN OPTIONS HARNESS ROUTED FROM THE CONTROL BOX TO THE RETURN AIR SECTION. DO NOT CONNECT THE OPTIONS HARNESS PPF5 TO THE RTRM IF NO OPTIONS ARE INSTALLED. DO NOT CONNECT OPTIONS HARNESS PPM8 TO THE RTOM IF NO ECA IS INSTALLED. REFER TO ACCOMPANYING LITERATURE FOR CONNECTION / COMBINATION OF OPTIONAL COMPONENTS.
15. INSTALL OPTIONAL REMOTE SENSOR TO TERMINALS S1 AND S2 WHEN REQUIRED. SEE PROGRAMMABLE ZONE SENSOR / REMOTE PANEL W/ NSB LITERATURE FOR OPTION CONFIGURATION.
16. SEE APPLICABLE HEATING SECTION DIAGRAM FOR BALANCE OF CIRCUIT WHEN OPTIONAL ELECTRIC HEAT IS REQUIRED. HEAT CONTACTORS AND ASSOCIATED WIRING USED ONLY WITH THE FOLLOWING ELECTRIC HEAT OPTIONS:
   AH - ALL CH - 54 AND 72 KW
   BH - 36, 54 AND 72 KW DH - 72 KW
17. TERMINALS 7.8.9 AND 10 ARE FOR OPTIONAL INDICATORS.
18. WHEN OPTIONAL REMOTE MINIMUM POSITION POTENTOMETER IS REQUIRED AND WIRE AS SHOWN.
19. INSET E IS FOR OPTIONAL PROGRAMMABLE ZONE SENSOR.
20. REQUIRED FOR OPTIONAL REFERENCE ENTHALPY CONTROL.
21. REQUIRED FOR OPTIONAL COMPARATIVE ENTHALPY CONTROL.
25. 0-10 VDC Duct Mounted Sensor Only.
26. OPTIONAL MAS, RAS, RHS, OHS AND ASSOCIATED WIRING NOT USED WITH MOTORIZED OUTSIDE AIR.
28. AUXILIARY RELAY ENERGIZED DURING OCCUPIED PERIODS.
29. TO DISABLE COMPRESSORS, REMOVE JUMPERS AND CONNECT FIELD SUPPLIED CONTROL DEVICE.
30. TO SHUT DOWN THE UNIT FOR EMERGENCY STOP, REMOVE JUMPER AND INSTALL FIELD SUPPLIED DEVICE.
32. POWER EXHAUST OUTPUT FOR FIELD SUPPLIED DEVICE.
33. TO ENABLE COMPRESSOR LEAD/LAG OPERATION, CUT WIRE 36B.
34. SEE CONNECTION DIAGRAM FOR DETAIL ABOUT RTRM J1 CONNECTION.
35. CONNECT WIRES 36BY AND 36BZ TO ENABLE 3 STAGE COOLING ONLY ON HIGH EFFICIENCY SHORT ORIFICE UNITS.

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.

TRANE

CAD SYSTEM USED: PRO-DETAIL	DRAWN BY:
REPLACES:	TRANE® DATE:
SIMILAR TO: 2309-3363	REVISION DATE: 3/26/08

FILE NUMBER: 2309-3109
DRAWING NUMBER: 2313-0066
SHEET: 1 OF 1
REV: B

DIAGRAM
200.208 - 575V
CONTROL - MICRO PROCESSOR
TC 151E, 181E, 241E
DEHUMIDIFICATION

NAME:CLKF8 OBJECT:2309_3109 DATE:29-Aug-08 14:57:15