


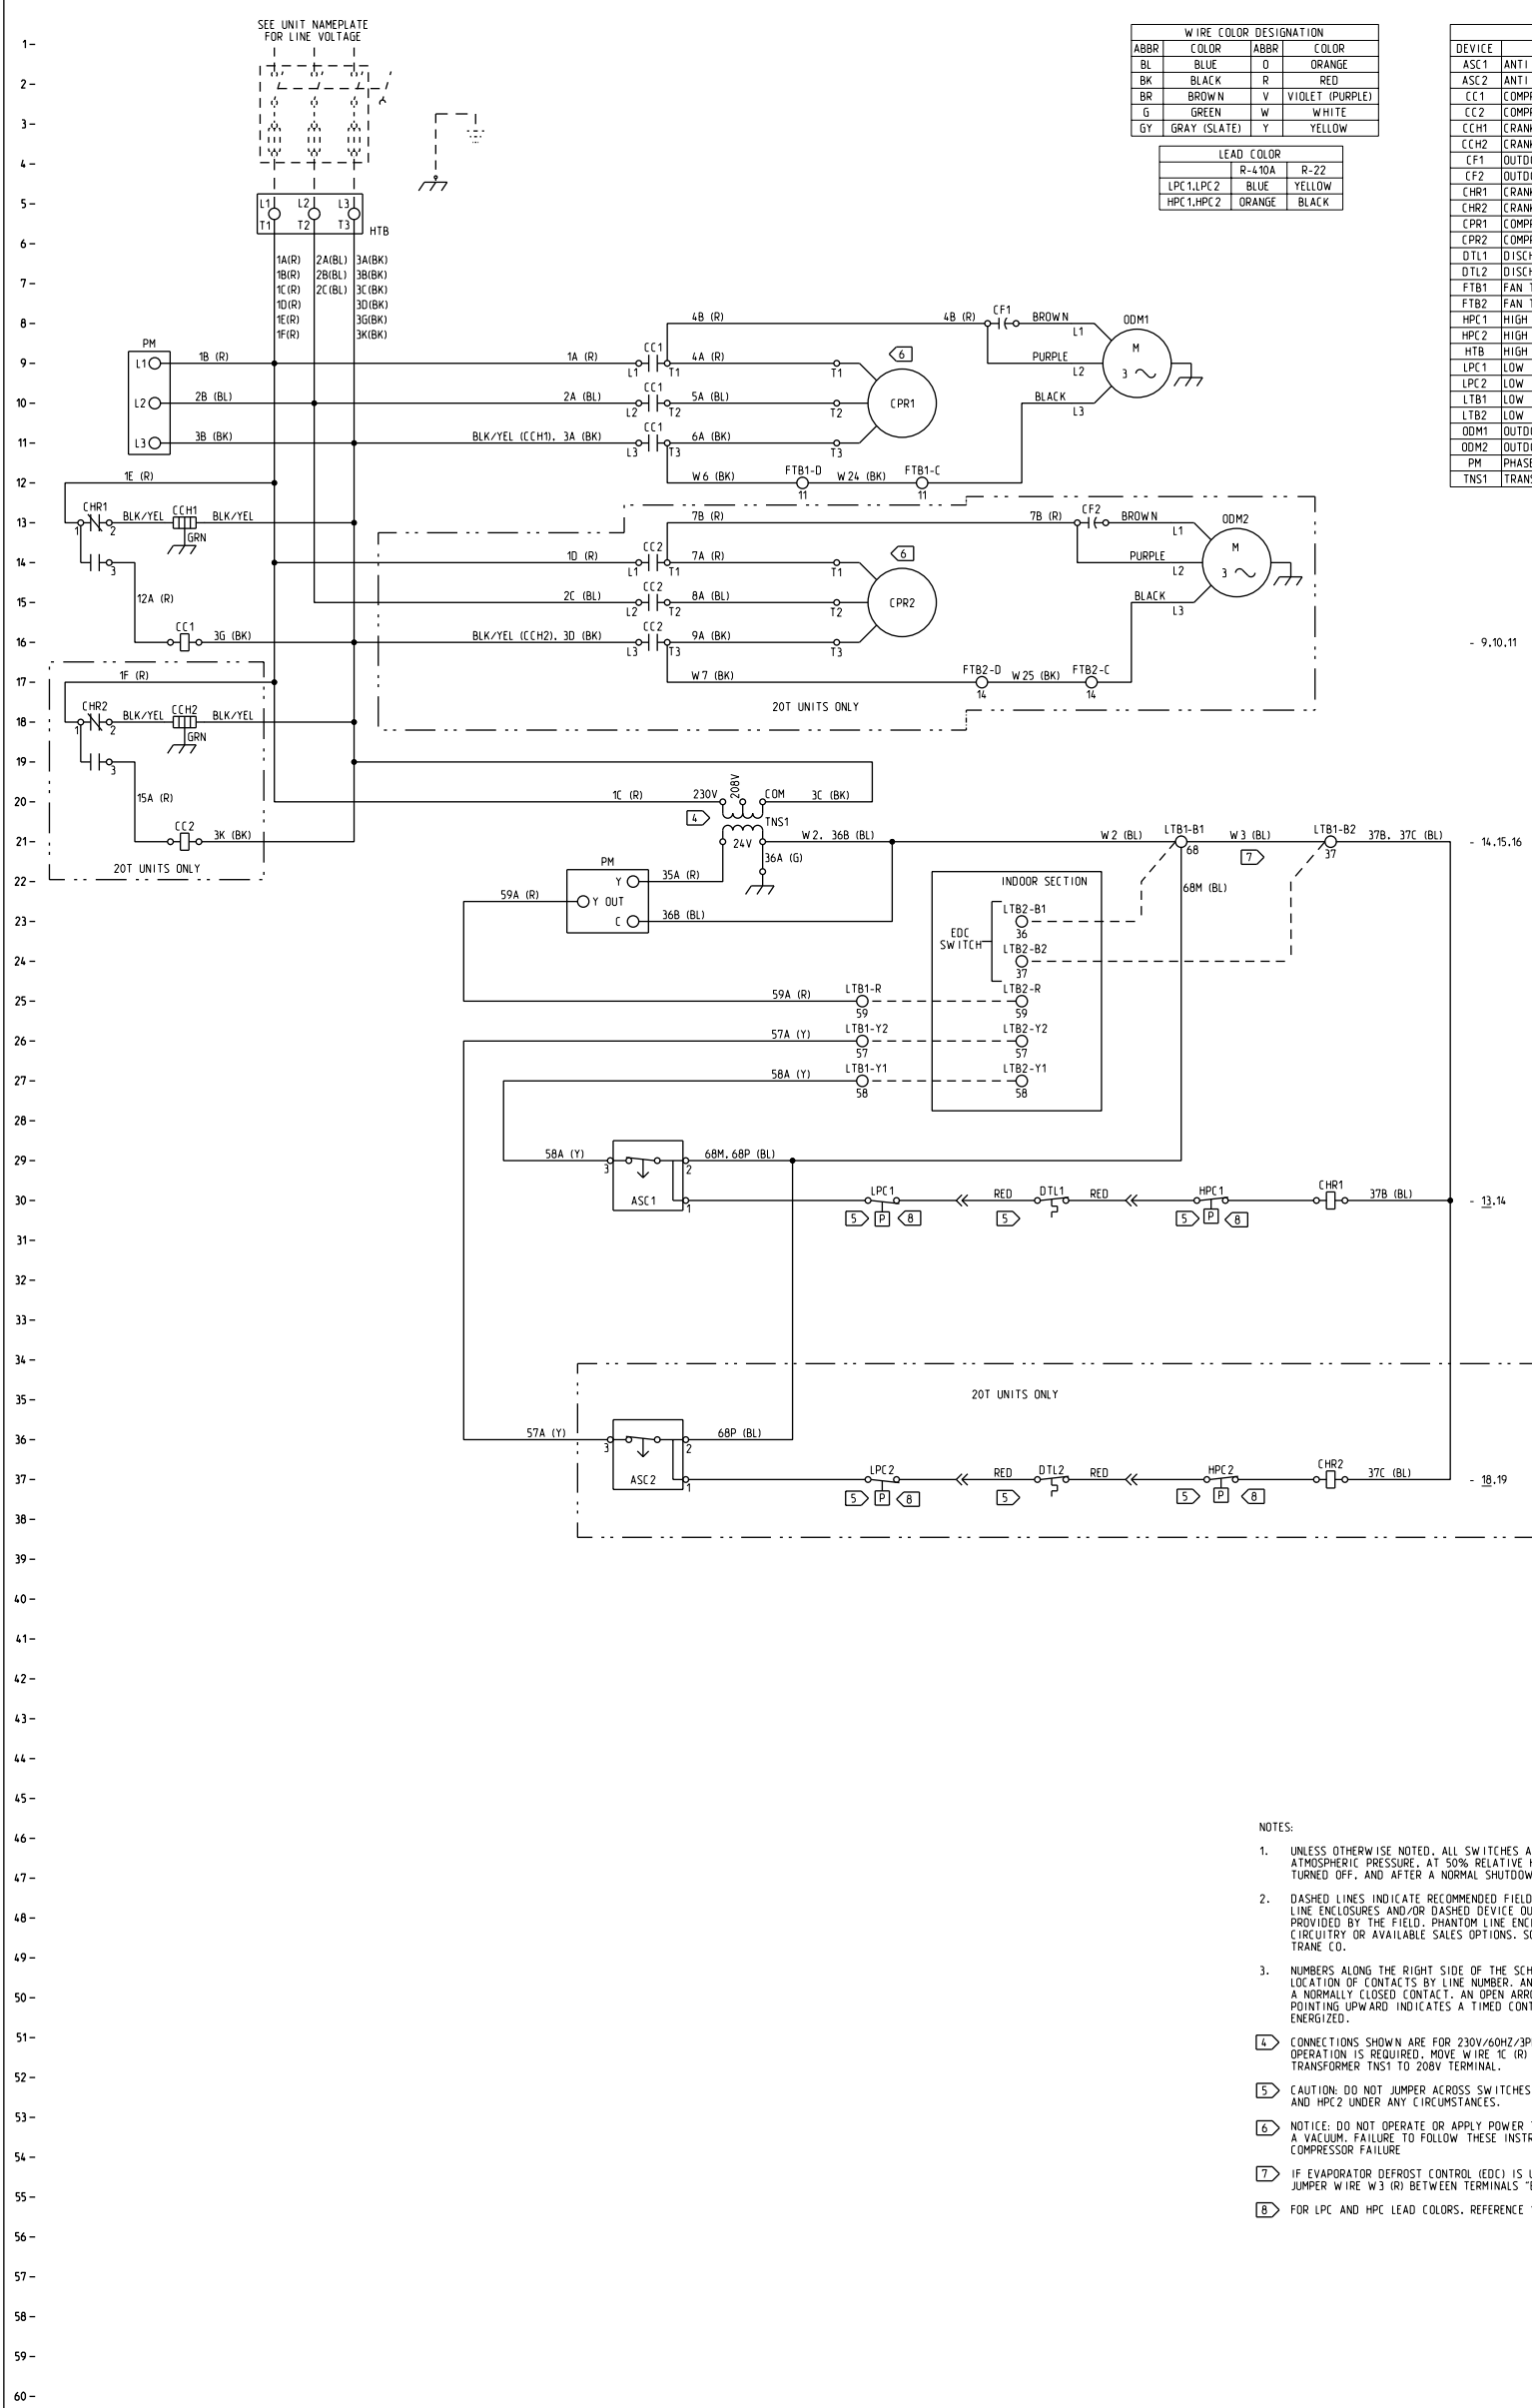

WIRE COLOR DESIGNATION			
ABBR	COLOR	ABBR	COLOR
BL	BLUE	O	ORANGE
BK	BLACK	R	RED
BR	BROWN	V	VIOLET (PURPLE)
G	GREEN	W	WHITE
GY	GRAY (SLATE)	Y	YELLOW

LEAD COLOR	
R-410A	R-22
LPC1,LPC2	BLUE YELLOW
HPC1,HPC2	ORANGE BLACK

LEGEND		
DEVICE	DESCRIPTION	LINE
ASC1	ANTI SHORT CYCLE TIMER	29
ASC2	ANTI SHORT CYCLE TIMER	36
CC1	COMPRESSOR CONTACTOR	9,10,11,16
CC2	COMPRESSOR CONTACTOR	14,15,16,21
CCH1	CRANKCASE HEATER	13
CCH2	CRANKCASE HEATER	18
CF1	OUTDOOR FAN CAPACITOR	8
CF2	OUTDOOR FAN CAPACITOR	13
CHR1	CRANKCASE HEATER RELAY	13,30
CHR2	CRANKCASE HEATER RELAY	18,37
CPR1	COMPRESSOR	10
CPR2	COMPRESSOR	15
DTL1	DISCHARGE TEMPERATURE LIMIT	30
DTL2	DISCHARGE TEMPERATURE LIMIT	37
FTB1	FAN TERMINAL BLOCK	12,18
FTB2	FAN TERMINAL BLOCK	17
HPC1	HIGH PRESSURE CUTOFF	30
HPC2	HIGH PRESSURE CUTOFF	37
HTB	HIGH VOLTAGE TERMINAL BLOCK	5
LPC1	LOW PRESSURE CUTOFF	30
LPC2	LOW PRESSURE CUTOFF	37
LTB1	LOW VOLTAGE TERMINAL BLOCK	20,21,25,26,27,28,31,32,40,41,42
LTB2	LOW VOLTAGE TERMINAL BLOCK	23,24,25,26,27,40,41,42
ODM1	OUTDOOR FAN MOTOR	8
ODM2	OUTDOOR FAN MOTOR	13
PM	PHASE MONITOR	9,22
TNS1	TRANSFORMER - CONDENSER	20

WARNING

HAZARDOUS VOLTAGE!

DISCONNECT ALL ELECTRIC POWER INCLUDING REMOTE DISCONNECTS AND FOLLOW LOCK OUT AND TAG PROCEDURES BEFORE SERVICING. INSURE THAT ALL MOTOR CAPACITORS HAVE DISCHARGED STORED VOLTAGE. UNITS WITH VARIABLE SPEED DRIVE, REFER TO DRIVE INSTRUCTIONS FOR CAPACITOR DISCHARGE.

FAILURE TO DO THE ABOVE BEFORE SERVICING COULD RESULT IN DEATH OR SERIOUS INJURY.

AVERTISSEMENT

TENSION DANGEREUSE!

COUPER TOUTES LES TENSIONS ET OUVRIR LES SECTIONNEURS A DISTANCE. PUIS SUIVRE LES PROCÉDURES DE VERROUILLAGE ET DES ÉTIQUETTES AVANT TOUTE INTERVENTION. VÉRIFIER QUE TOUTS LES CONDENSATEURS DES MOTEURS SONT DÉCHARGÉS. DANS LE CAS D'UNITÉS COMPORTANT DES ENTRAÎNEMENTS À VITESSE VARIABLE, SE REPORTER AUX INSTRUCTIONS DE L'ENTRAÎNEMENT POUR DÉCHARGER LES CONDENSATEURS.

NE PAS RESPECTER CES MESURES DE PRÉCAUTION PEUT ENTRAÎNER DES BLESSURES GRAVES POUVANT ÊTRE MORTELLES.

ADVERTENCIA

¡VOLTAJE PELIGROSO!

DESCONECTE TODA LA ENERGÍA ELÉCTRICA, INCLUIDO LAS DESCONEXIONES REMOTAS Y SIGA LOS PROCEDIMIENTOS DE CIERRE Y ETIQUETADO ANTES DE PROCEDER AL SERVICIO. ASEGÚRESE DE QUE TODOS LOS CAPACITORES DEL MOTOR HAYAN DESCARGADO EL VOLTAJE ALMACENADO. PARA LAS UNIDADES CON EJE DE DIRECCIÓN DE VELOCIDAD VARIABLE, CONSULTE LAS INSTRUCCIONES PARA LA DESCARGA DEL CONDENSADOR.

EL NO REALIZAR LO ANTERIORMENTE INDICADO, PODRÍA OCASIONAR LA MUERTE O SERIAS LESIONES PERSONALES.

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

ATTENTION

N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!

LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.

PRECAUCIÓN

¡UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!

LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.

SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

- NOTES:
- UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25 °C (77 °F), AT ATMOSPHERIC PRESSURE. AT 50% RELATIVE HUMIDITY, WITH ALL UTILITIES TURNED OFF, AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
 - DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS. SOLID LINE INDICATES WIRING BY TRANE CO.
 - NUMBERS ALONG THE RIGHT SIDE OF THE SCHEMATIC DESIGNATE THE LOCATION OF CONTACTS BY LINE NUMBER. AN UNDERLINED NUMBER INDICATES A NORMALLY CLOSED CONTACT. AN OPEN ARROWHEAD BELOW THE LINE NUMBER POINTING UPWARD INDICATES A TIMED CONTACT WHICH BEGINS TIMING WHEN ENERGIZED.
 - CONNECTIONS SHOWN ARE FOR 230V/60HZ/3PH UNITS. WHEN 208V/60HZ/3PH OPERATION IS REQUIRED, MOVE WIRE 1E (R) FROM 230V TERMINAL ON UNIT TRANSFORMER TNS1 TO 208V TERMINAL.
 - CAUTION: DO NOT JUMPER ACROSS SWITCHES DTL1, DTL2, LPC1, LPC2, HPC1 AND HPC2 UNDER ANY CIRCUMSTANCES.
 - NOTICE: DO NOT OPERATE OR APPLY POWER TO COMPRESSORS WHILE UNDER A VACUUM. FAILURE TO FOLLOW THESE INSTRUCTIONS WILL RESULT IN COMPRESSOR FAILURE
 - IF EVAPORATOR DEFROST CONTROL (EDC) IS USED ON INDOOR UNIT, REMOVE JUMPER WIRE W3 (R) BETWEEN TERMINALS "B1" AND "B2" ON LTB1.
 - FOR LPC AND HPC LEAD COLORS, REFERENCE "LEAD COLOR" TABLE.

THIS DRAWING IS THE PROPERTY OF TRANE. IT IS TO BE USED FOR THE EQUIPMENT AND PARTS ONLY. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF TRANE.		DRAWN BY: EDA/MS		CHECKED BY: EDA/MS		DATE: 02/20/2013		PROJECT: 22-49-12		SCALE: 10	
TRANE		FILE NUMBER		DRAWING NUMBER		SHEET		REV			
CONDENSER UNIT - COOLING ONLY ELECTRO-MECHANICAL		2313-0408		0075557		1 OF 1		D			