



TRANE		FILE NUMBER:	DRAWING NUMBER:	SHEET:	REV
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.			2313-0436	1 OF 1	C
DRAWN BY:	TRANE® DATE:	ODYSSEY DIAGRAM CONNECTION - CONDENSER W/ RELIATEL 10T (DUAL CIRCUIT) & 12.5T (ALL VOLTAGES)			
K. EDWARDS	4/07/09				
REPLACES:	REVISION DATE:				
CAD SYSTEM USED:	SIMILAR TO:				
PRO/DETAIL					

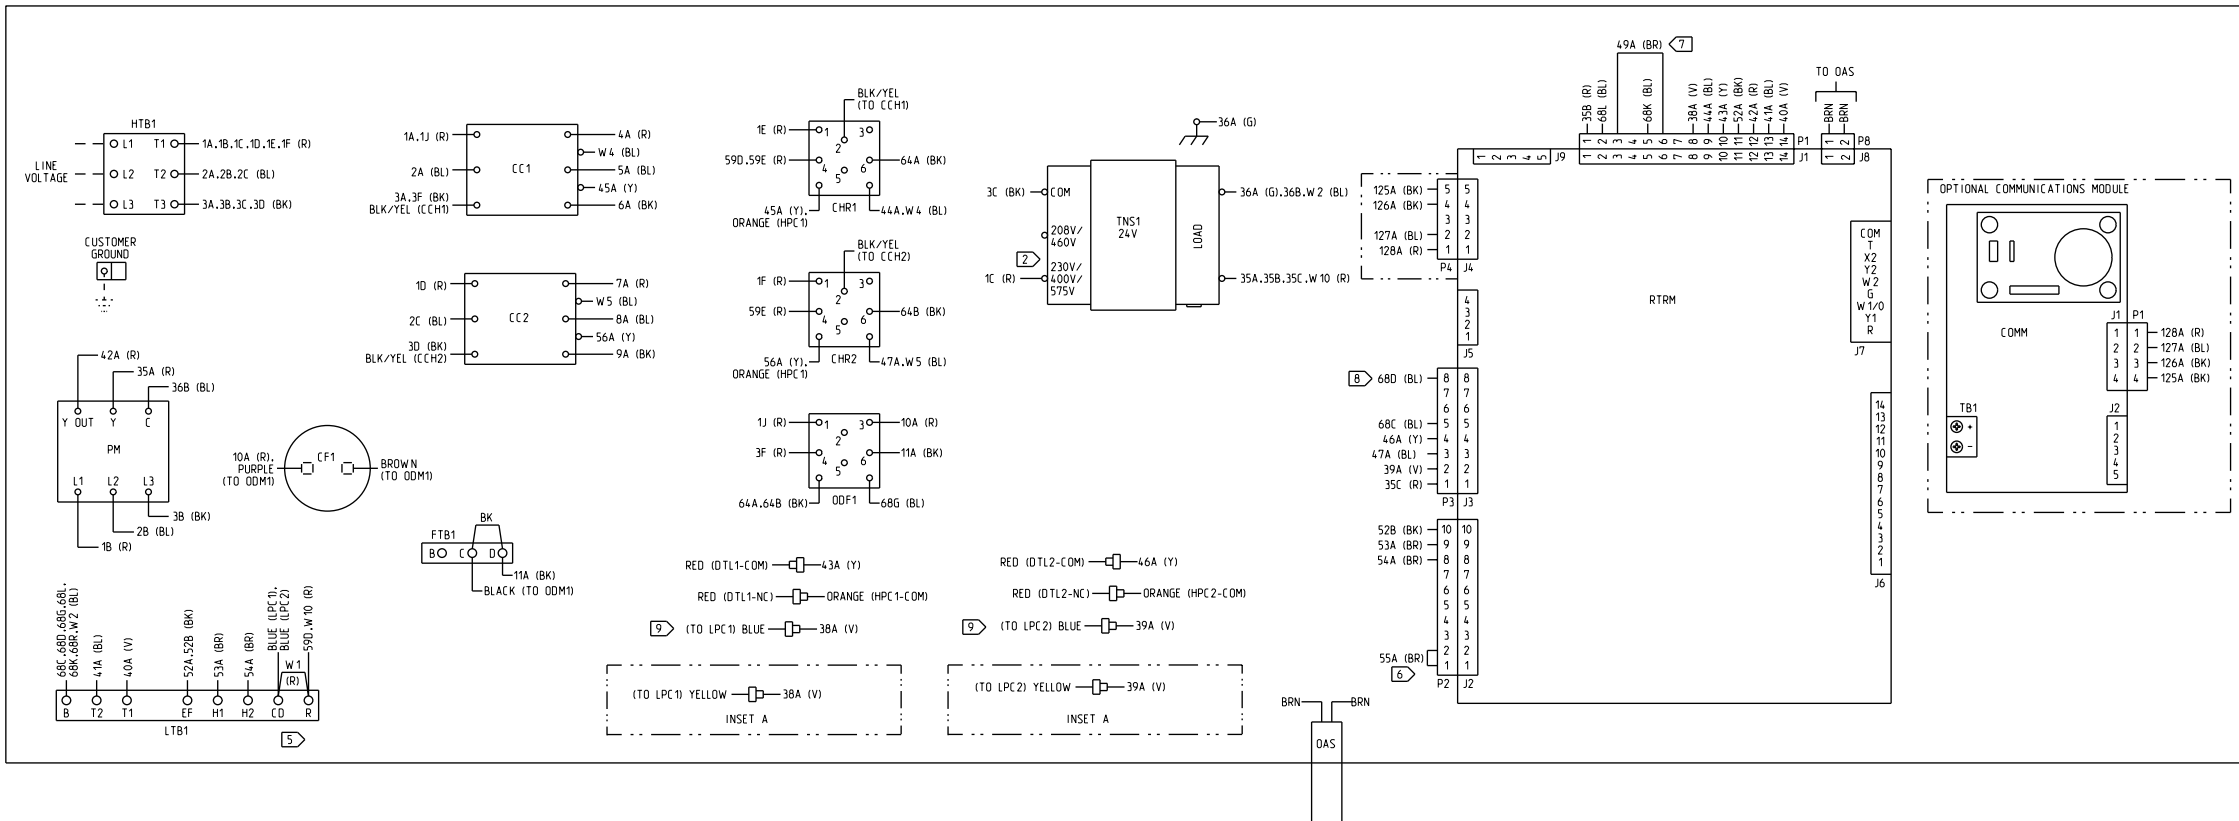

NOTES:

- DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS. SOLID LINE INDICATES WIRING BY TRANE CO.
- CONNECTIONS SHOWN ARE FOR 230V/575V/60HZ/3PH OR 380V-415V/50HZ/3PH. WHEN 208V/480V/60HZ/3PH OPERATION IS REQUIRED, MOVE WIRE 1C (R) FROM 230V TERMINAL OF TNS1 TO 208V TERMINAL.
- CAUTION: DO NOT JUMPER ACROSS SWITCHES DTL1, DTL2, LPC1, LPC2, HPC1 AND HPC2 UNDER ANY CIRCUMSTANCES.
- NOTICE: DO NOT OPERATE OR APPLY POWER TO COMPRESSORS WHILE UNDER A VACUUM. FAILURE TO FOLLOW THESE INSTRUCTIONS WILL RESULT IN COMPRESSOR FAILURE.
- IF EVAPORATOR DEFROST CONTROL (EDC) IS USED ON INDOOR UNIT, REMOVE JUMPER WIRE W1 (R) BETWEEN TERMINALS "CD" AND "R" ON LTBT1.
- TO ENABLE ELECTRIC HEAT, CUT WIRE 55A (BR) ON P2.
- TO ENABLE TWO STAGES OF ELECTRIC HEAT, CUT WIRE 49A (BR) ON P1.
- TO ENABLE COMPRESSOR LEAD/LAG OPERATION, CUT WIRE 68D (BL).
- SUBSTITUTE WITH YELLOW LEADS ON THE LPC1 AND LPC2 FOR TTA TO TON/EE" MODEL UNITS ONLY). SEE INSET A

