




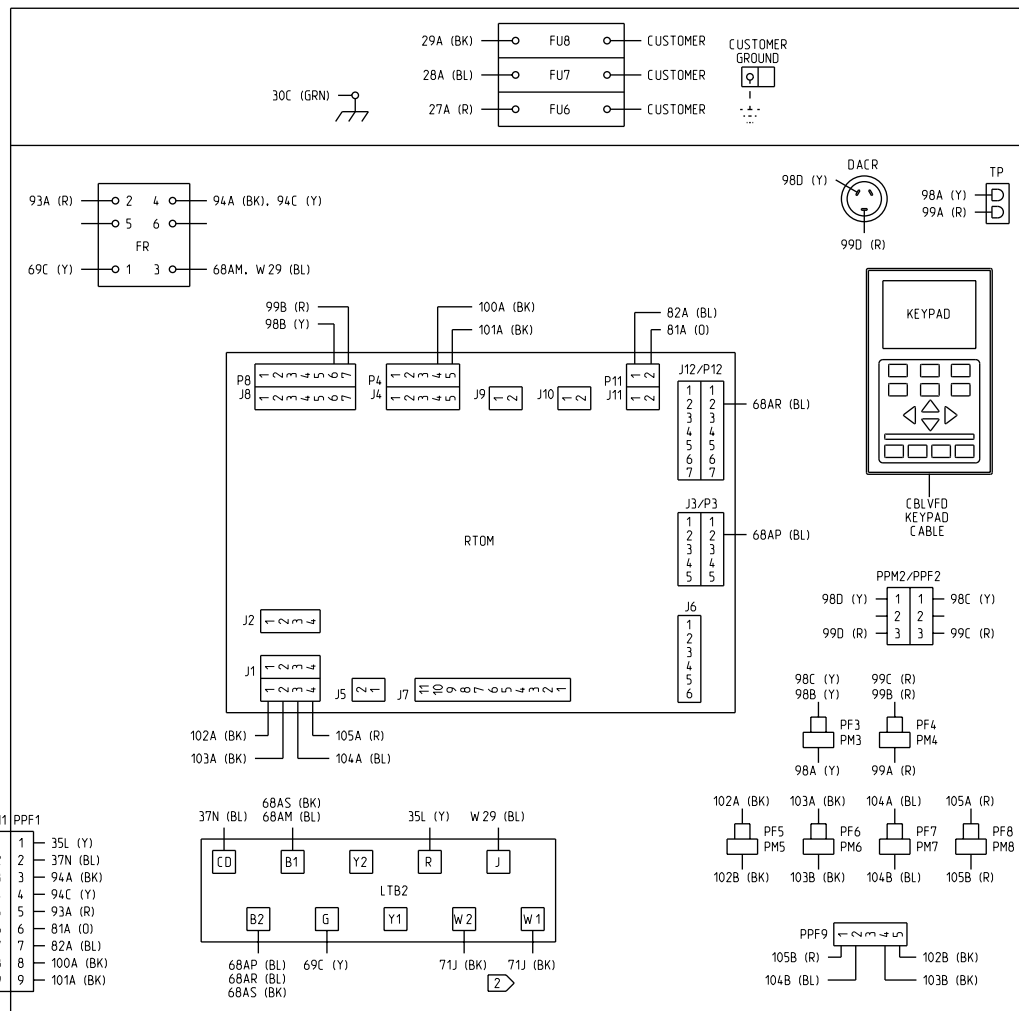


TRANE		FILE NUMBER: --	DRAWING NUMBER: 2313-0453	SHEET: 1 OF 1	REV: A
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.					
DRAWN BY: B. WALDEN		TRANE DATE: 27-Jul-11			
REPLACES: --		REVISION DATE: --			
CAD SYSTEM USED: Pro/DETAIL		SIMILAR TO: --			
ODYSSEY CONNECTION SINGLE ZONE VAV RELIATEL --					

SHEET SIZE: 8.5 X 11 INCHES

- NOTES:
- SEE FIELD WIRING DIAGRAMS IN PRODUCT LITERATURE FOR PROPER FIELD CONNECTIONS.
 - REMOVE JUMPER WIRE 71J (BK) TO ALLOW TWO STAGES OF ELECTRIC HEAT.

WIRE COLOR DESIGNATION			
ABBR	COLOR	ABBR	COLOR
BL	BLUE	O	ORANGE
BK	BLACK	R	RED
BR	BROWN	V	VIOLET (PURPLE)
G or GRN	GREEN	W	WHITE
GY	GRAY (SLATE)	Y	YELLOW

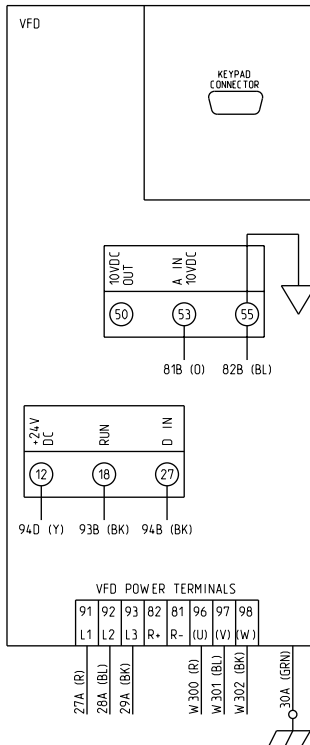

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

PRECAUCIÓN

N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!

LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.

L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'ÉQUIPEMENT.

ATTENTION

¡UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!

LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.

SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

CAUTION

IF ANY OF THE EXISTING WIRING AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, IT MUST BE REPLACED WITH WIRING RATED FOR 105°C OR ITS EQUIVALENT.

IMPORTANT!

DO NOT ENERGIZE UNIT UNTIL CHECK-OUT AND START-UP PROCEDURE HAS BEEN COMPLETED.