

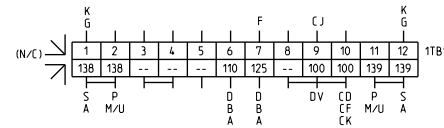


- NOTES
- 1 JUMPER BETWEEN 1TB16-13 AND 1TB16-14, REQUIRED FOR 2-STAGE NATURAL GAS HEAT (<1800 MBH) OR ELECTRIC HEAT ONLY.
- 2 1TB7 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS 0-5V MODULE ONLY.
- 3 1TB8 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS 0-10V MODULE ONLY.
- 4 REMOVE JUMPER BETWEEN 1TB13-23 AND 1TB13-24 WHEN HIGH DUCT TEMP T-STAT (4517 & 8517) IS ORDERED.
- 5 1F25, 1F26, AND 158 AND ASSOCIATED WIRING REQUIRED FOR CONVENIENCE OUTLET OPTION ONLY.
- 6 WIRES W1B, W2B AND W3B ARE ONLY REQUIRED FOR SPECIFIC ELECTRIC HEATER CONFIGURATIONS. SEE APPLICABLE HEATER SCHEMATIC.
- 7 REMOVE JUMPER BETWEEN 1TB4-15 AND 1TB4-16 WHEN A REMOTE EMERGENCY STOP SWITCH IS USED.
- 8 1TB29 NOT AVAILABLE WHEN BOTH 0-5V GBAS AND 0-10V GBAS ARE INSTALLED. IF A SINGLE GBAS IS INSTALLED, 1TB29 WILL OCCUPY THE POSITION WHERE THE TERMINAL BLOCK SUPPORTING THE SECOND GBAS WOULD BE PLACED. (SEE INSET 1A)
- 9 CIRCUIT BREAKERS CB1, CB2, CB3 & CB4 MUST CONNECT TO COLORED AUX CONTACT WIRES BLU/YEL (COM) AND YEL (NO) WHEN SHORT CIRCUIT WITHSTAND RATING (SCWR) IS CHOSEN AS AN OPTION.
- 10 1S5 (V.F.D. BYPASS SWITCH) AND ASSOCIATED WIRING AVAILABLE ONLY ON UNITS WITH EXHAUST/RETURN VFD WITH BYPASS.
- 11 FOR RETURN FAN INSTALL JUMPER BETWEEN 1TB13-11 & 1TB13-12. FOR EXHAUST FAN PROVING INSTALL WIRES 548C AND 549C.

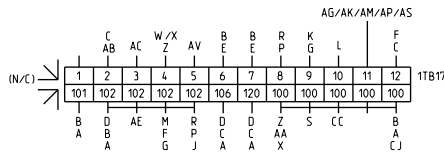

562A, 700U

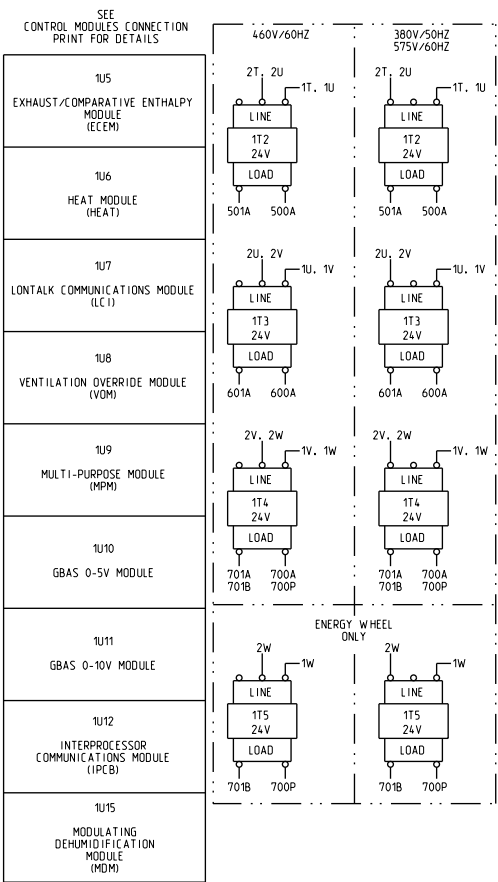