1 REFER TO DETAILS "4A", "4B", "4C", "4D", "4E" FOR CORRECT HEAT MODULE (1U6) CONNECTIONS:

DETAIL "4A" - 2-STAGE NATURAL GAS HEAT (<1800 MBH)
DETAIL "4B" - 2-STAGE NATURAL GAS HEAT (1800 MBH & 2500 MBH)
DETAIL "4C" - MODULATING NATURAL GAS HEAT
DETAIL "4D" - ELECTRIC HEAT
DETAIL "4E" - HYDRONIC HEAT
DETAIL "4F" - COOLING ONLY AIR HANDLER W/ CHILLED WATER

2 UNITS WITHOUT A SUPPLY FAN VARIABLE FREQUENCY DRIVE (V.F.D) USE WIRE 700F; UNITS WITH A SUPPLY FAN VARIABLE FREQUENCY DRIVE USE WIRE 543A.

3 MCM (1U3) NOT USED ON AIR HANDLER UNITS.

4 WIRELESS COMMUNICATIONS JUMPER WIRE W50 MUST BE INSTALLED WHEN APPLYING A WCI MODULE. THE BCI WILL NOT COMMUNICATE IF WIRE W50 IS INSTALLED WITHOUT THE USE OF A WCI.
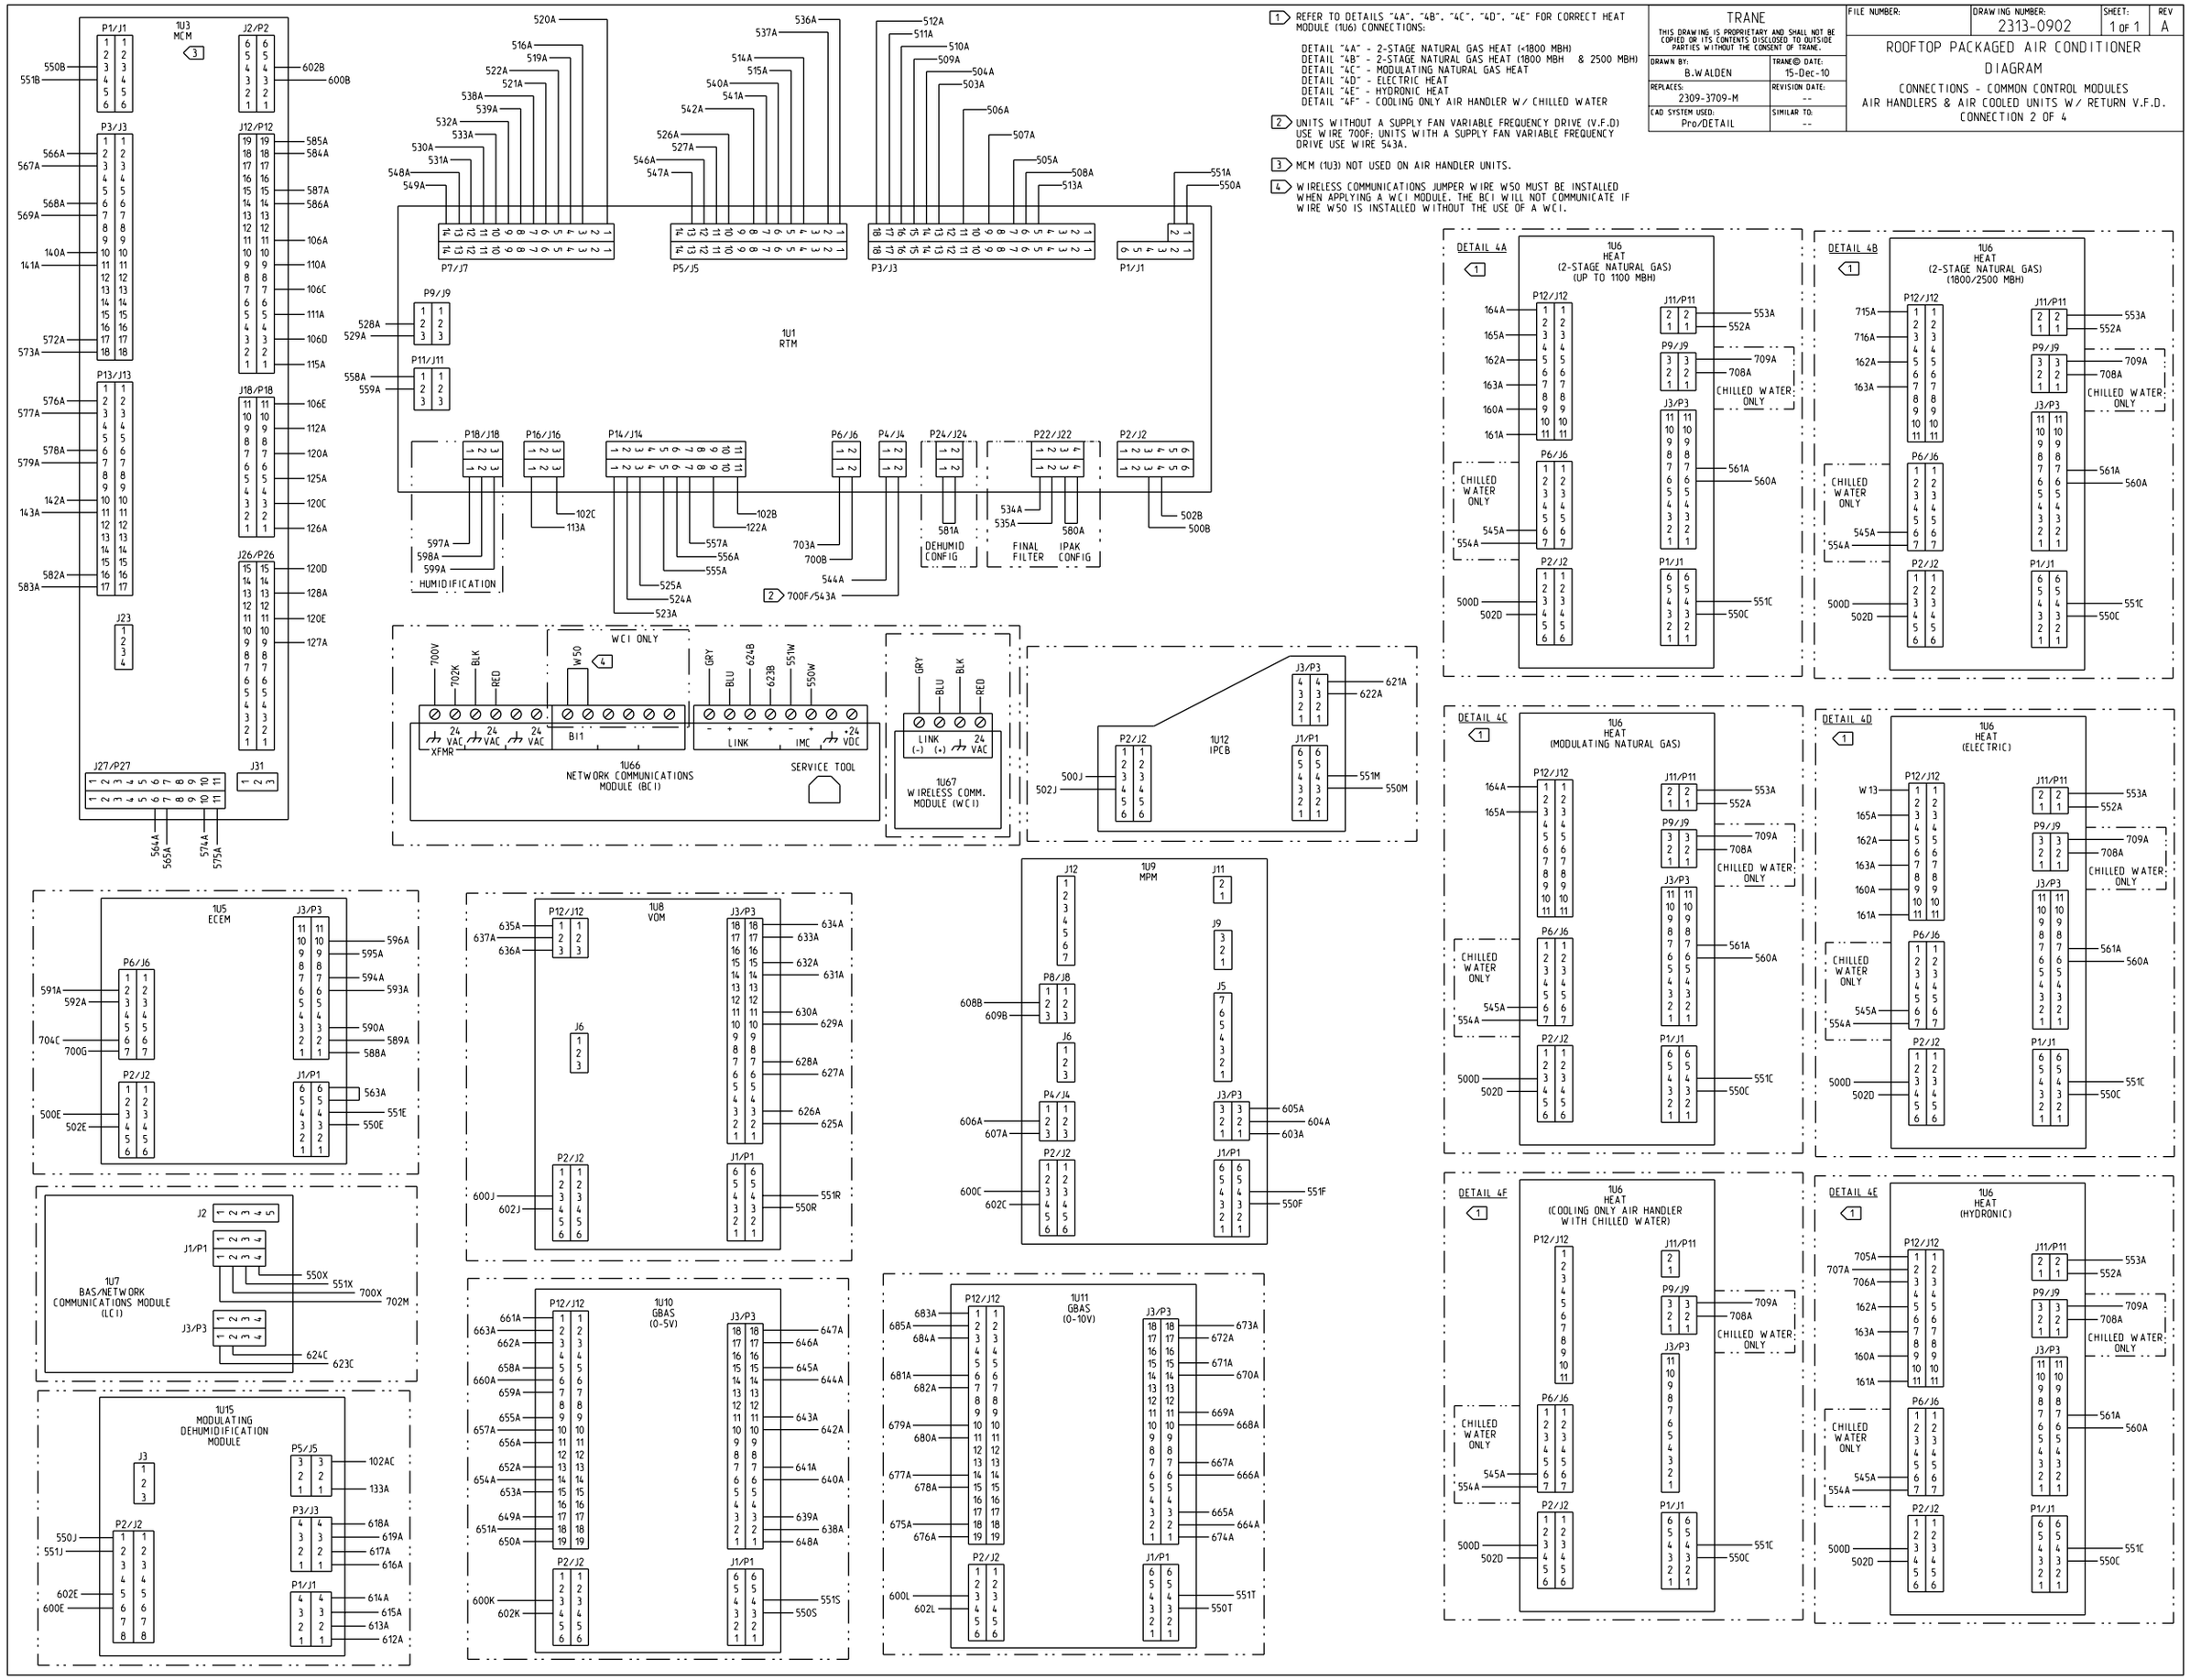
TRANE		FILE NUMBER:	DRAWING NUMBER: 2313-0902	SHEET: 1 OF 1	REV A
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.		ROOFTOP PACKAGED AIR CONDITIONER DIAGRAM			
DRAWN BY: B.WALDEN	TRANE® DATE: 15-Dec-10	CONNECTIONS - COMMON CONTROL MODULES			
REPLACES: 2309-3709-M	REVISION DATE: --	AIR HANDLERS & AIR COOLED UNITS W/ RETURN V.F.D.			
CAD SYSTEM USED: Pro/DETAIL	SIMILAR TO: --	CONNECTION 2 OF 4