


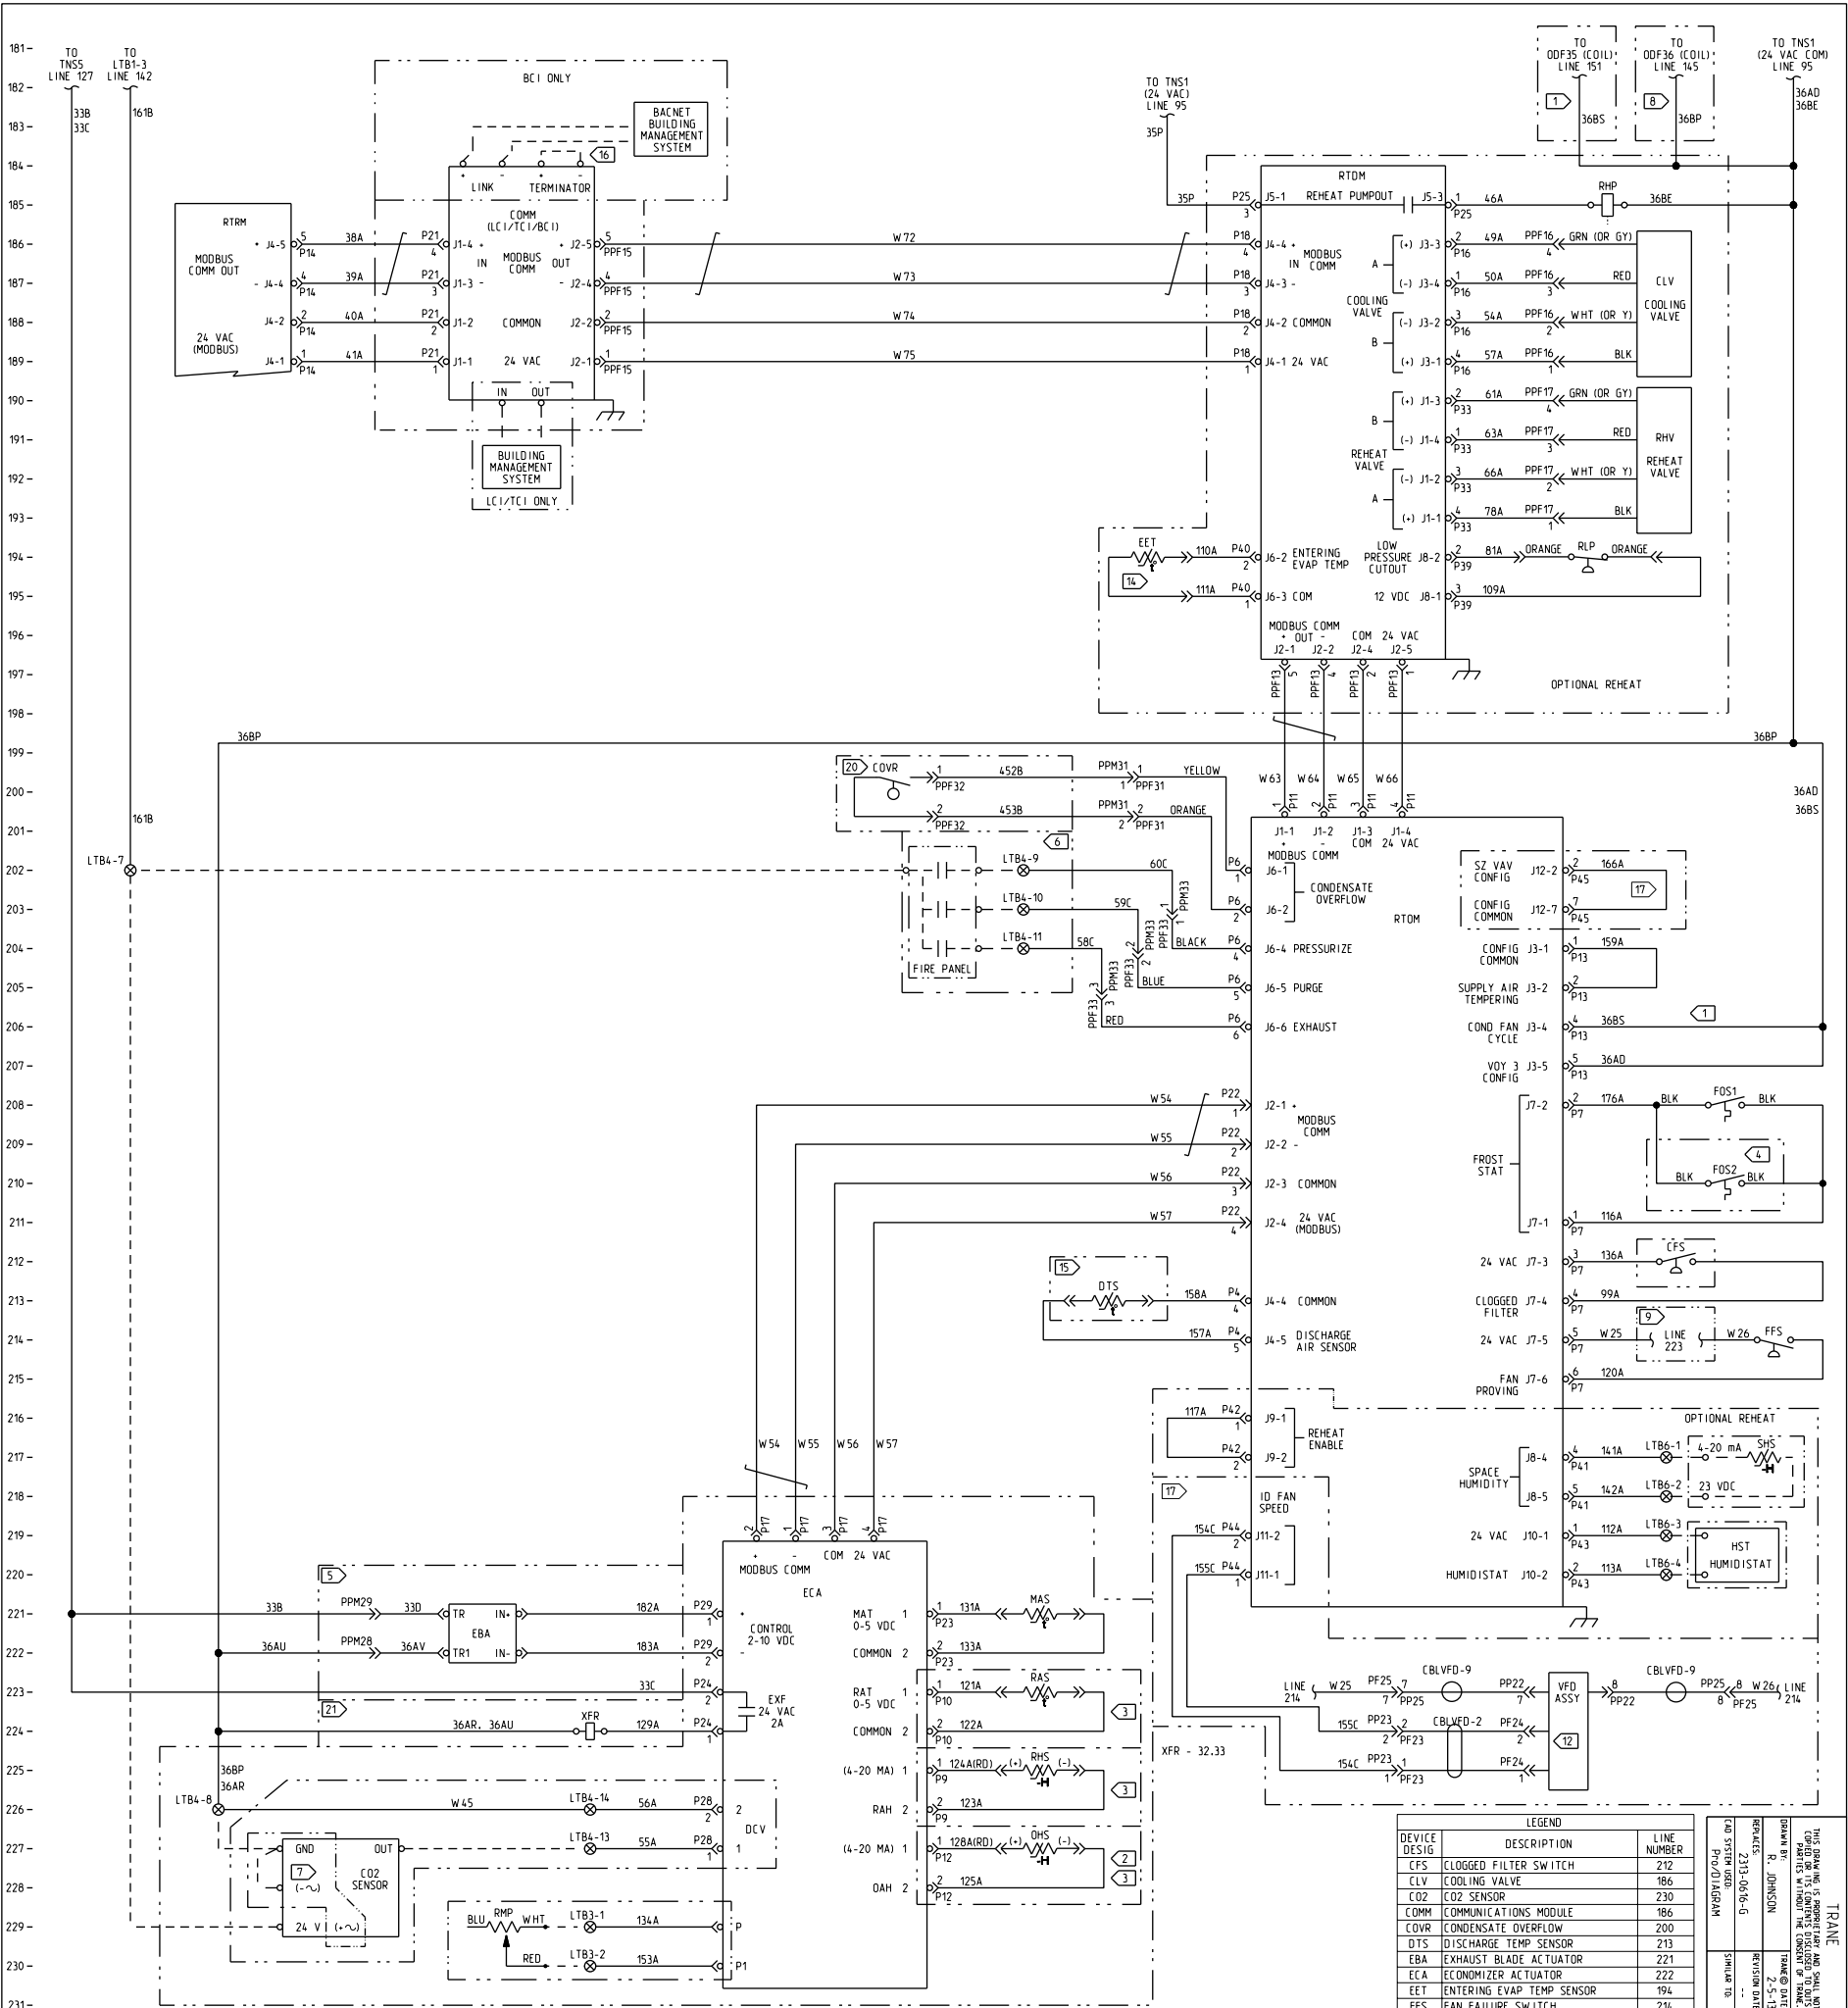

- 1

WIRE 36BS IS NOT USED FOR 35T AND 50T UNITS.
- 2

REQUIRED FOR OPTIONAL REFERENCE ENTHALPY CONTROL.
- 3

REQUIRED FOR OPTIONAL COMPARATIVE ENTHALPY CONTROL.
- 4

FOS2 USED ON 40T AND 50T UNITS ONLY.
- 5

EBA REQUIRED FOR OPTIONAL FRESH AIR TRACKING EXHAUST.
- 6

OPTIONAL VENTILATION OVERRIDE.
- 7

0-10 VDC DUCT MOUNTED SENSOR ONLY.
- 8

WIRE 36BP USED ON UNITS WITH OPTIONAL ECONOMIZER ONLY.
- 9

WIRING SHOWN IS FOR UNIT OPTIONAL VARIABLE FREQUENCY DRIVE. WHEN UNIT HAS CONSTANT VOLUME, WIRE W25 CONNECTS TO FAN FAILURE SWITCH AND WIRE W26 IS NOT USED.
- 15

DISCHARGE TEMPERATURE SENSOR IS REQUIRED WITH SUPPLY AIR TEMPERING, DEHUMIDIFICATION AND SZVAV OPTIONS.
- 16

FIELD INSTALLED BACNET TERMINATOR JUMPER IS REQUIRED FOR TERMINATION AT EACH END OF THE WIRED BACNET COMMUNICATIONS LINK.
- 17

WIRES 154C, 155C, AND 166A ONLY INCLUDED WITH SZVAV OPTION.
- 20

REQUIRED FOR OPTIONAL CONDENSATE OVERFLOW.
- 21

REQUIRED FOR POWERED EXHAUST.

CAUTION

USE COPPER CONDUCTORS ONLY!

UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.

FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

PRECAUCIÓN

N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!

LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.

L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'EQUIPEMENT.

ATTENTION

UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!

LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.

SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

DEVICE	DESCRIPTION	LINE NUMBER
CFS	CLOGGED FILTER SWITCH	212
CLV	COOLING VALVE	186
CO2	CO2 SENSOR	230
COMM	COMMUNICATIONS MODULE	186
COVR	CONDENSATE OVERFLOW	200
DTS	DISCHARGE TEMP SENSOR	213
EBA	EXHAUST BLADE ACTUATOR	221
ECA	ECONOMIZER ACTUATOR	222
EET	ENTERING EVAP TEMP SENSOR	194
FFS	FAN FAILURE SWITCH	214
FOS1	FROST STAT 1	208
FOS2	FROST STAT 2	210
HST	HUMIDISTAT	219
MAS	SENSOR - MIXED AIR TEMP	221
RHS	SENSOR - R/A HUMIDITY	227
RAS	SENSOR - RETURN AIR TEMP	223
RHP	SOLENOID - REHEAT PUMPOUT	185
RHS	SENSOR - R/A HUMIDITY	225
RHV	REHEAT VALVE	190
RLP	REHEAT LOW PRESSURE CUTOUT	194
RTDM	DEHUMIDIFICATION MODULE	186
RTOM	OPTIONS MODULE	204
RTRM	REFRIGERATION MODULE	185
SHS	SENSOR - SPACE HUMIDITY	217
XFR	EXHAUST FAN RELAY	224

THIS DRAWING IS THE PROPERTY OF TRANE. IT IS TO BE USED ONLY FOR THE PROJECT AND SYSTEM IDENTIFIED HEREIN. IT IS NOT TO BE REPRODUCED OR COPIED IN ANY MANNER WITHOUT THE WRITTEN CONSENT OF TRANE.

DESIGNED BY: J. JOHNSON

DRAWN BY: J. JOHNSON

PROJECT: 2313-0616-01

REVISION DATE: 2-23-13

BY: J. JOHNSON

SCALE: 10

TRANE

FILE NUMBER: 2313-1266

DRAWING NUMBER: 2313-1267

SHEET: 1 OF 2

REV: A

CONTROL MODULES SCHEMATIC

DIAGRAM 3

CV & SZVAV