

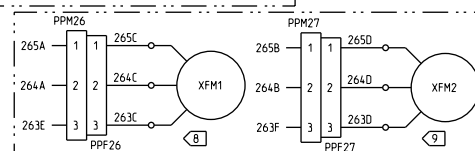
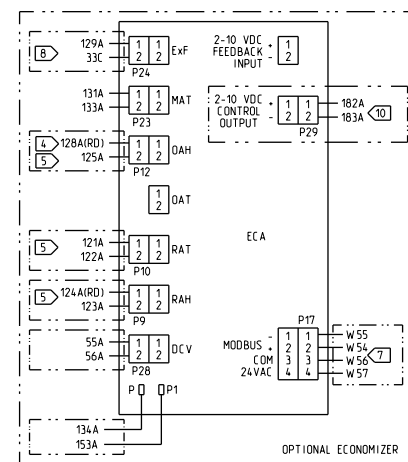
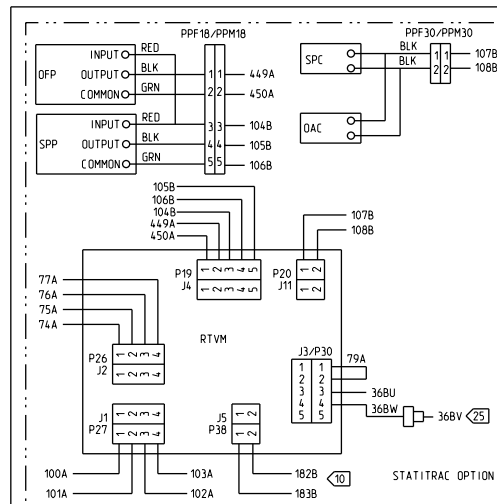
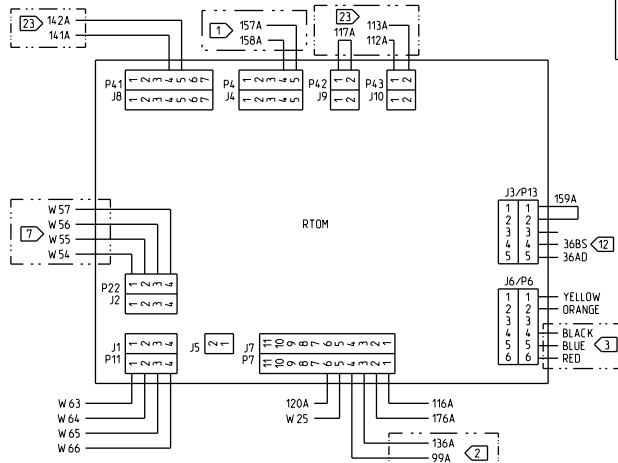
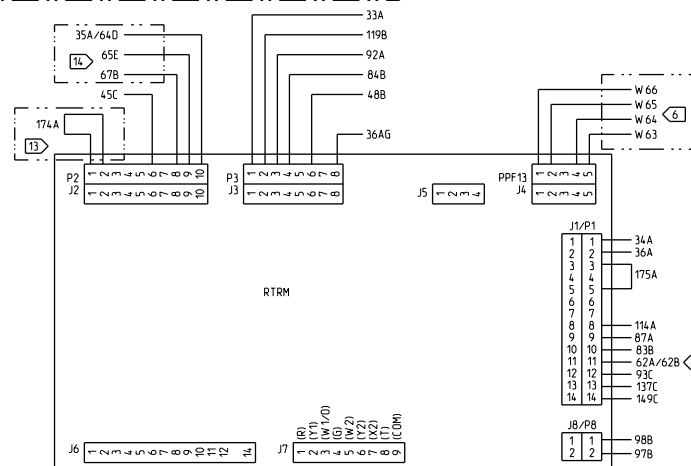
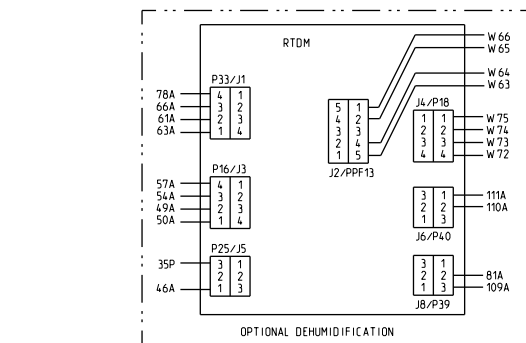

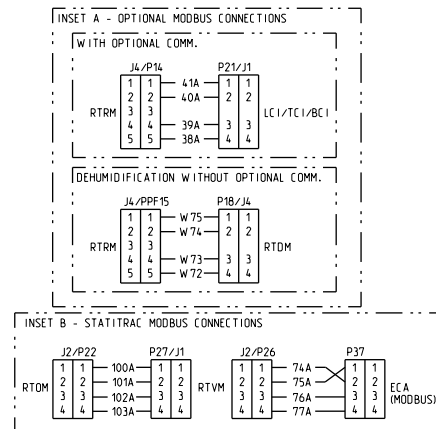
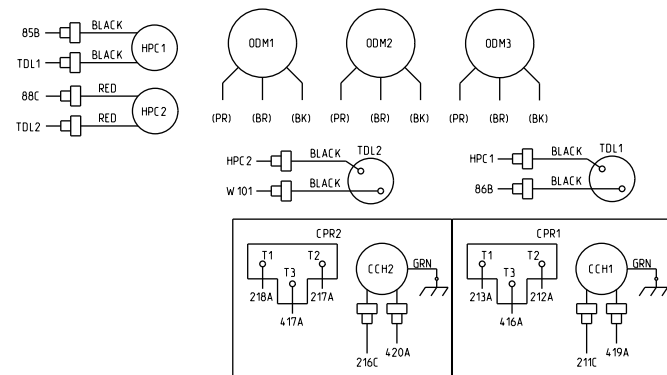





24 WIRE 62B IS USED ON CV UNITS AND 62A IS USED ON VAV/SZVAV UNITS.

25 DISCONNECT WIRES 36BW AND 36BV ON HORIZONTAL UNITS.


CONDENSER SECTION WIRING

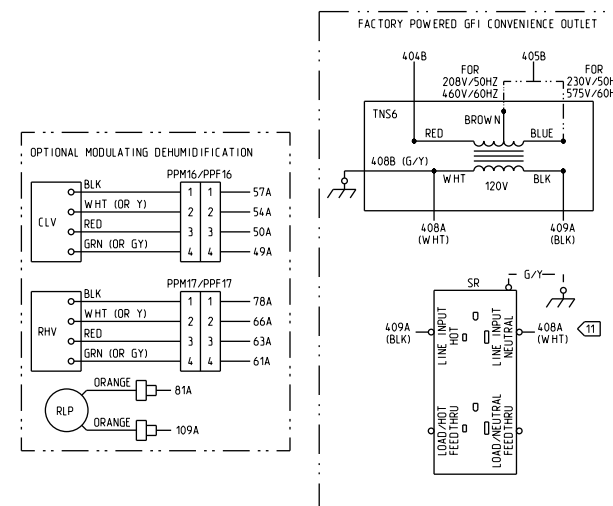

RETURN AIR SECTION WIRING

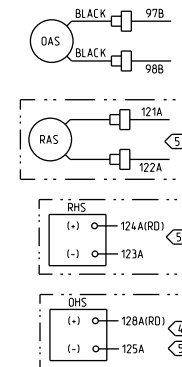

SUPPLY AIR
SECTION WIRING

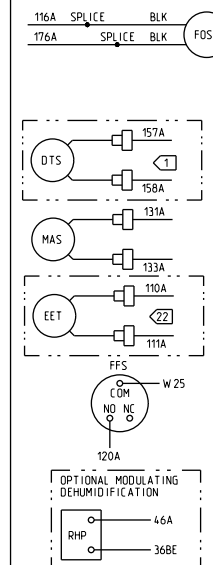

STANDARD INDOOR FAN MOTOR

