


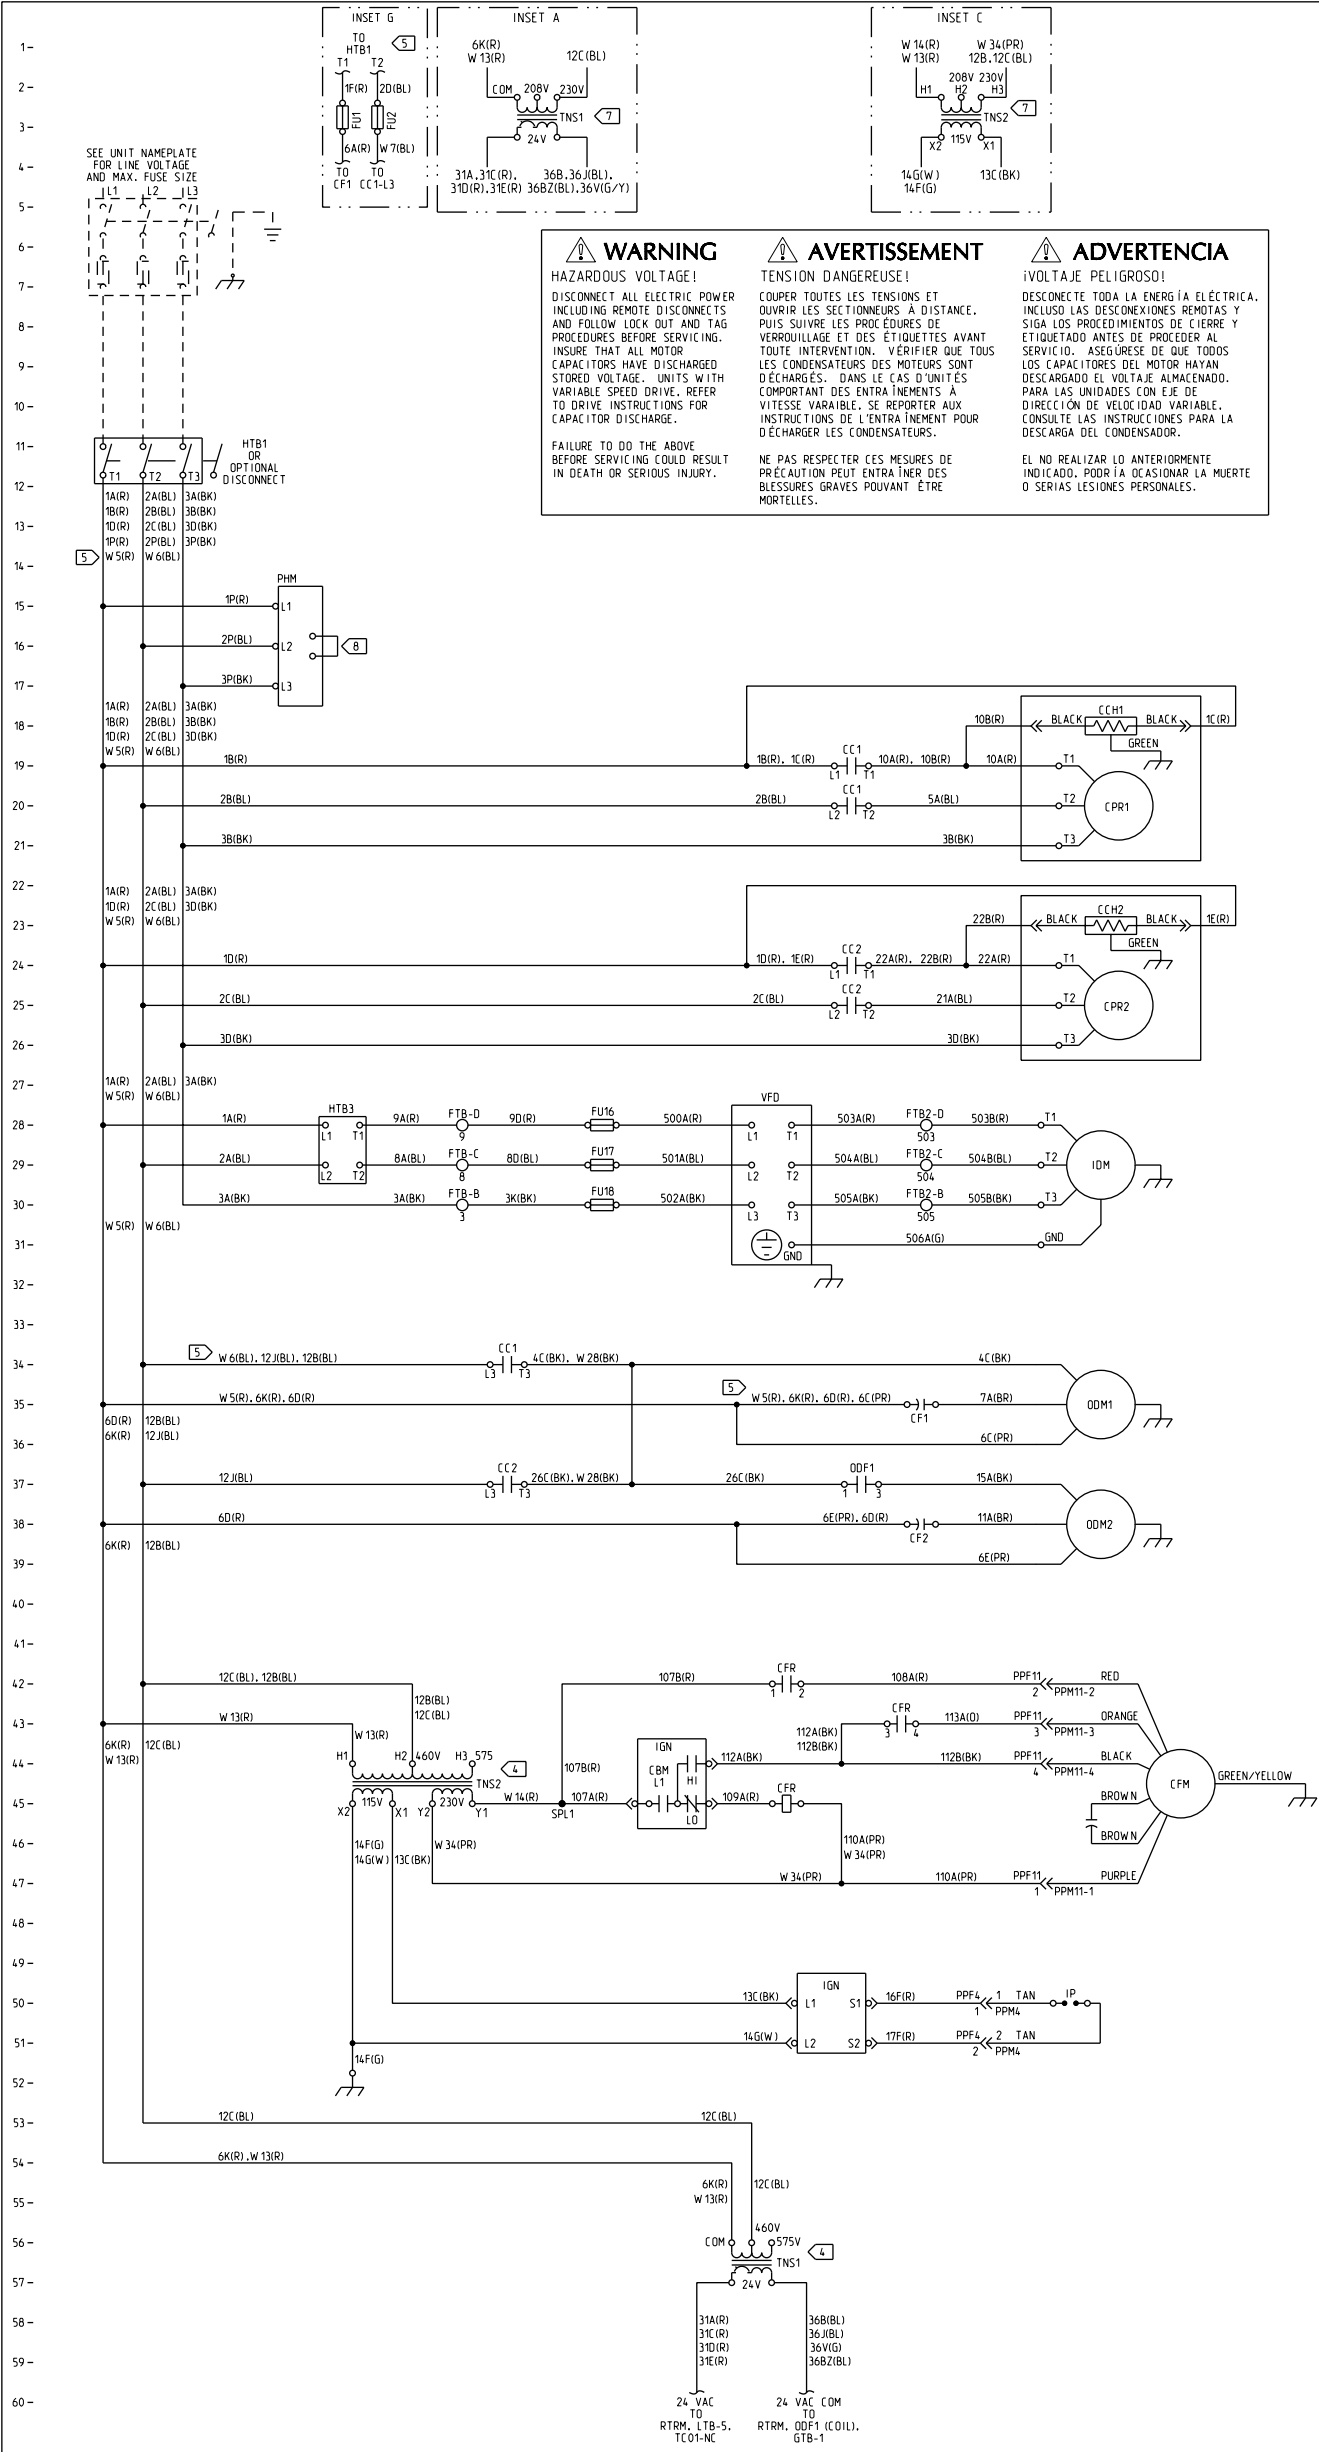

LEGEND		
DEVICE DESIG	DESCRIPTION	LINE NUMBER
CC1	CONTACTOR - COMPRESSOR	19,20,34
CC2	CONTACTOR - COMPRESSOR	24,25,37
CH1	HEATER - CRANKCASE	18
CH2	HEATER - CRANKCASE	23
CF1	CAPACITOR - OD MOTOR	35
CF2	CAPACITOR - OD MOTOR	38
CFM	COMBUSTION FAN MOTOR	44,46
CFR	COMBUSTION FAN RELAY	42,43,45
CPR1	COMPRESSOR	21
CPR2	COMPRESSOR	26
FTB	TERMINAL BLOCK - INDOOR FAN	28,29,30
FTB2	TERMINAL BLOCK - INDOOR FAN-VFD	28,29,30
FU1	FUSE - 200-380 VAC POWER	3
FU16	FUSE - VFD	28
FU17	FUSE - VFD	29
FU18	FUSE - VFD	30
FU2	FUSE - 200-380 VAC POWER	3
HTB1	MANUAL DISCONNECT/TERM BLOCK	11
HTB3	TERMINAL BLOCK - HIGH VOLTAGE	28
IDM	MOTOR - INDOOR	28
IGN	IGNITION MODULE	43,45,50
IP	IGNITION PROBE	50
ODF1	CONTACTOR - OUTDOOR FAN	37
ODM1	MOTOR - OUTDOOR	34
ODM2	MOTOR - OUTDOOR	37
PHM	MODULE - PHASE MONITOR	15
TNS1	TRANSFORMER - CONTROLS POWER	56
TNS2	TRANSFORMER - IGNITION	44
VFD	VARIABLE FREQUENCY DRIVE - IDM	28

- NOTES:
- UNLESS OTHERWISE NOTED, ALL SWITCHES ARE SHOWN AT 25°C (77°F), AT ATMOSPHERIC PRESSURE, AT 50% RELATIVE HUMIDITY, WITH ALL UTILITIES TURNED OFF, AND AFTER A NORMAL SHUTDOWN HAS OCCURRED.
 - DASHED LINES INDICATE RECOMMENDED FIELD WIRING BY OTHERS. DASHED LINE ENCLOSURES AND/OR DASHED DEVICE OUTLINES INDICATE COMPONENTS PROVIDED BY THE FIELD. PHANTOM LINE ENCLOSURES INDICATE ALTERNATE CIRCUITRY OR AVAILABLE SALES OPTIONS. SOLID LINE INDICATES WIRING BY TRANE CO.
 - NUMBERS ALONG THE RIGHT SIDE MARGIN OF THE SCHEMATIC DESIGNATE, BY LINE NUMBER, THE LOCATION OF CONTACTS ENERGIZED BY COIL. AN UNDERLINED NUMBER INDICATES A NORMALLY CLOSED CONTACT. AN OPEN ARROWHEAD POINTING UPWARD BELOW THE LINE NUMBER INDICATES A TIMED CONTACT WHICH BEGINS TIMING WHEN ENERGIZED.
- 4 WIRING SHOWN IS FOR 460V UNITS. FOR 575V, MOVE ALL WIRES FROM THE 460V TERMINAL TO THE 575V TERMINAL ON TNS1 AND TNS2. FOR 208-230V WIRING, SEE INSET A AND C.
- 5 FUSES ARE USED FOR 208-230VAC 60HZ ONLY. REMOVE WIRES W5(R) AND W6(BL), AND WIRE FUSES AS SHOWN IN INSET G.
- 7 WIRING SHOWN IS FOR 230V UNITS. FOR 208V, MOVE ALL WIRES FROM THE 230V TERMINAL TO THE 208V TERMINAL ON TNS1 AND TNS2.

WIRE COLOR DESIGNATION			
ABBR	COLOR	ABBR	COLOR
BK	BLACK	V.(PR)	PURPLE
BL	BLUE	R	RED
BR	BROWN	TN	TAN
G	GREEN	W	WHITE
O	ORANGE	Y	YELLOW

CAUTION
USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED TO ACCEPT OTHER TYPES OF CONDUCTORS.
FAILURE TO DO SO MAY CAUSE DAMAGE TO THE EQUIPMENT.

ATTENTION
N'UTILISER QUE DES CONDUCTEURS EN CUIVRE!
LES BORNES DE L'UNITÉ NE SONT PAS CONÇUES POUR RECEVOIR D'AUTRES TYPES DE CONDUCTEURS.

L'UTILISATION DE TOUT AUTRE CONDUCTEUR PEUT ENDOMMAGER L'EQUIPEMENT

PRECAUCIÓN
¡UTILICE ÚNICAMENTE CONDUCTORES DE COBRE!
LAS TERMINALES DE LA UNIDAD NO ESTÁN DISEÑADAS PARA ACEPTAR OTROS TIPOS DE CONDUCTORES.
SI NO LO HACE, PUEDE OCASIONAR DAÑO AL EQUIPO.

- CFR-42, 43

TRANE			
THIS DRAWING IS THE PROPERTY OF TRANE. IT IS TO BE USED ONLY FOR THE PARTS AND SERVICES PROVIDED BY TRANE. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM.	DATE: 2/13/14	BY: J. STANBURY	FOR: 2313-1477
DESIGNED BY: J. STANBURY	DATE: 2/13/14	REVIEWED BY: J. STANBURY	DATE: 2/13/14
DATE: 2/13/14	BY: J. STANBURY	FOR: 2313-1477	FILE NUMBER: 2313-1477
DATE: 2/13/14	BY: J. STANBURY	FOR: 2313-1477	DRAWING NUMBER: 2313-1484
DATE: 2/13/14	BY: J. STANBURY	FOR: 2313-1477	SHEET: 1 OF 1
DATE: 2/13/14	BY: J. STANBURY	FOR: 2313-1477	REV: A