



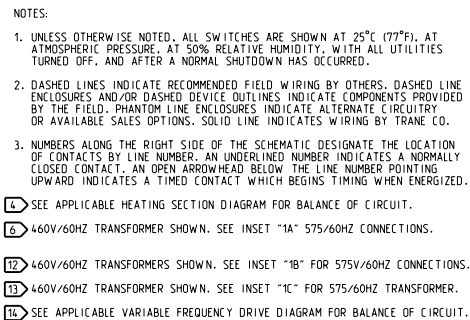

CONTACTOR COIL LOCATION		
DEVICE DESIG	DESCRIPTION	LINE NUMBER
1K10	CONTACTOR - CONDENSER FAN	155
1K113	CONTACTOR - COMPRESSOR	134
1K114	CONTACTOR - COMPRESSOR	149
1K15	CONTACTOR - COMPRESSOR	136
1K6	CONTACTOR - COMPRESSOR	151
1K7	CONTACTOR - CONDENSER FAN	138
1K8	CONTACTOR - CONDENSER FAN	140
1K9	CONTACTOR - COMPRESSOR FAN	153

TERMINAL BLOCK USAGE	
DEVICE DESIG	DESCRIPTION
1TB4, 1TB5, 1TB16, 1TB17	CONTROLS - CUSTOMER CONNECTIONS
1TB6 - 1TB10	CONTROLS - FACTORY
4TB2	POWER - ELECTRIC HEAT OPTION
4TB3	CONTROLS - ELECTRIC HEAT
4TB14, 4TB15	CONTROLS - GAS HEAT

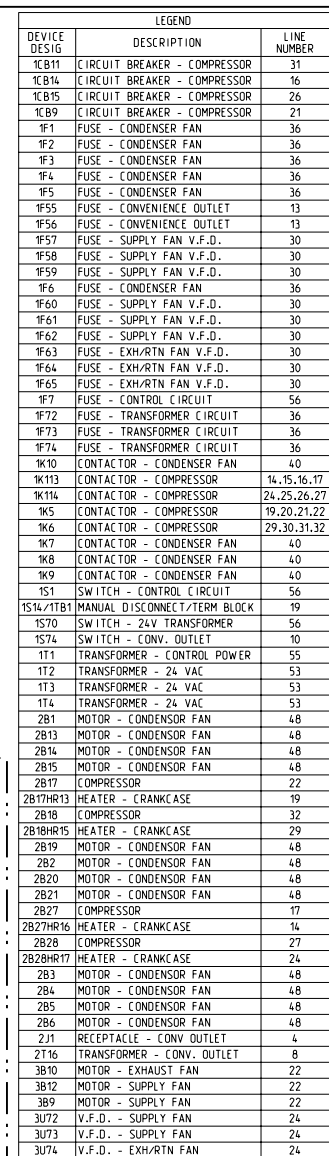

DEVICE PREFIX LOCATION CODE	
AREA	LOCATION
1	INSIDE UNIT CONTROL BOX
2	CONDENSER SECTION
3	AIR HANDLER SECTION
4	HEATING SECTION
5	EXTERNAL FIELD MTD DEVICE

CAUTION
USE COPPER CONDUCTORS ONLY!
UNIT TERMINALS ARE NOT DESIGNED TO
ACCEPT OTHER TYPES OF CONDUCTORS.
FAILURE TO DO SO MAY CAUSE DAMAGE TO
THE EQUIPMENT.

ATTENTION
N'UTILISER QUE DES CONDUCTEURS EN
CUIVRE!
LES BORNES DE L'UNITÉ NE SONT PAS
CONÇUES POUR RECEVOIR D'AUTRES TYPES
DE CONDUCTEURS.
L'UTILISATION DE TOUT AUTRE CONDUCTEUR
PEUT ENDOMMAGER L'EQUIPEMENT.

PRECAUCIÓN
¡UTILICE ÚNICAMENTE CONDUCTORES DE
COBRE!
LAS TERMINALES DE LA UNIDAD NO ESTÁN
DISEÑADAS PARA ACEPTAR OTROS TIPOS DE
CONDUCTORES.
SI NO LO HACE, PUEDE OCASIONAR DAÑO AL
EQUIPO.

