
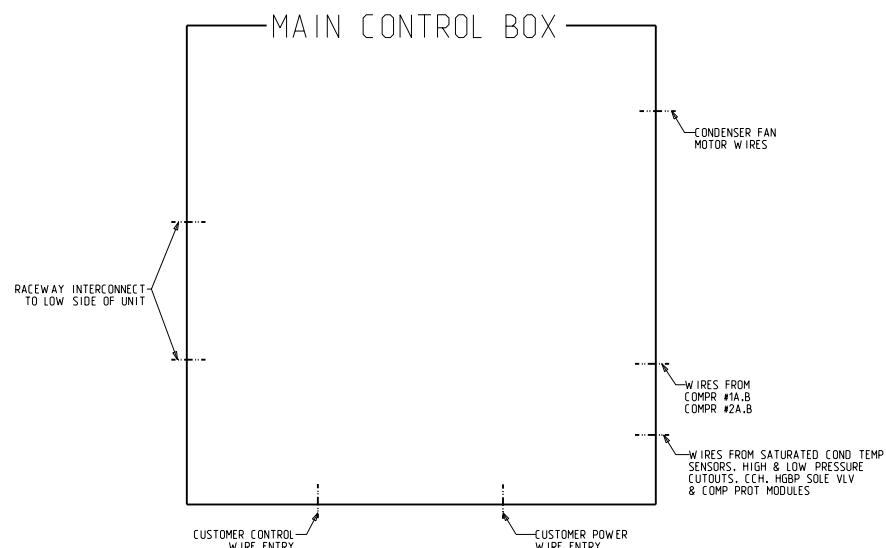


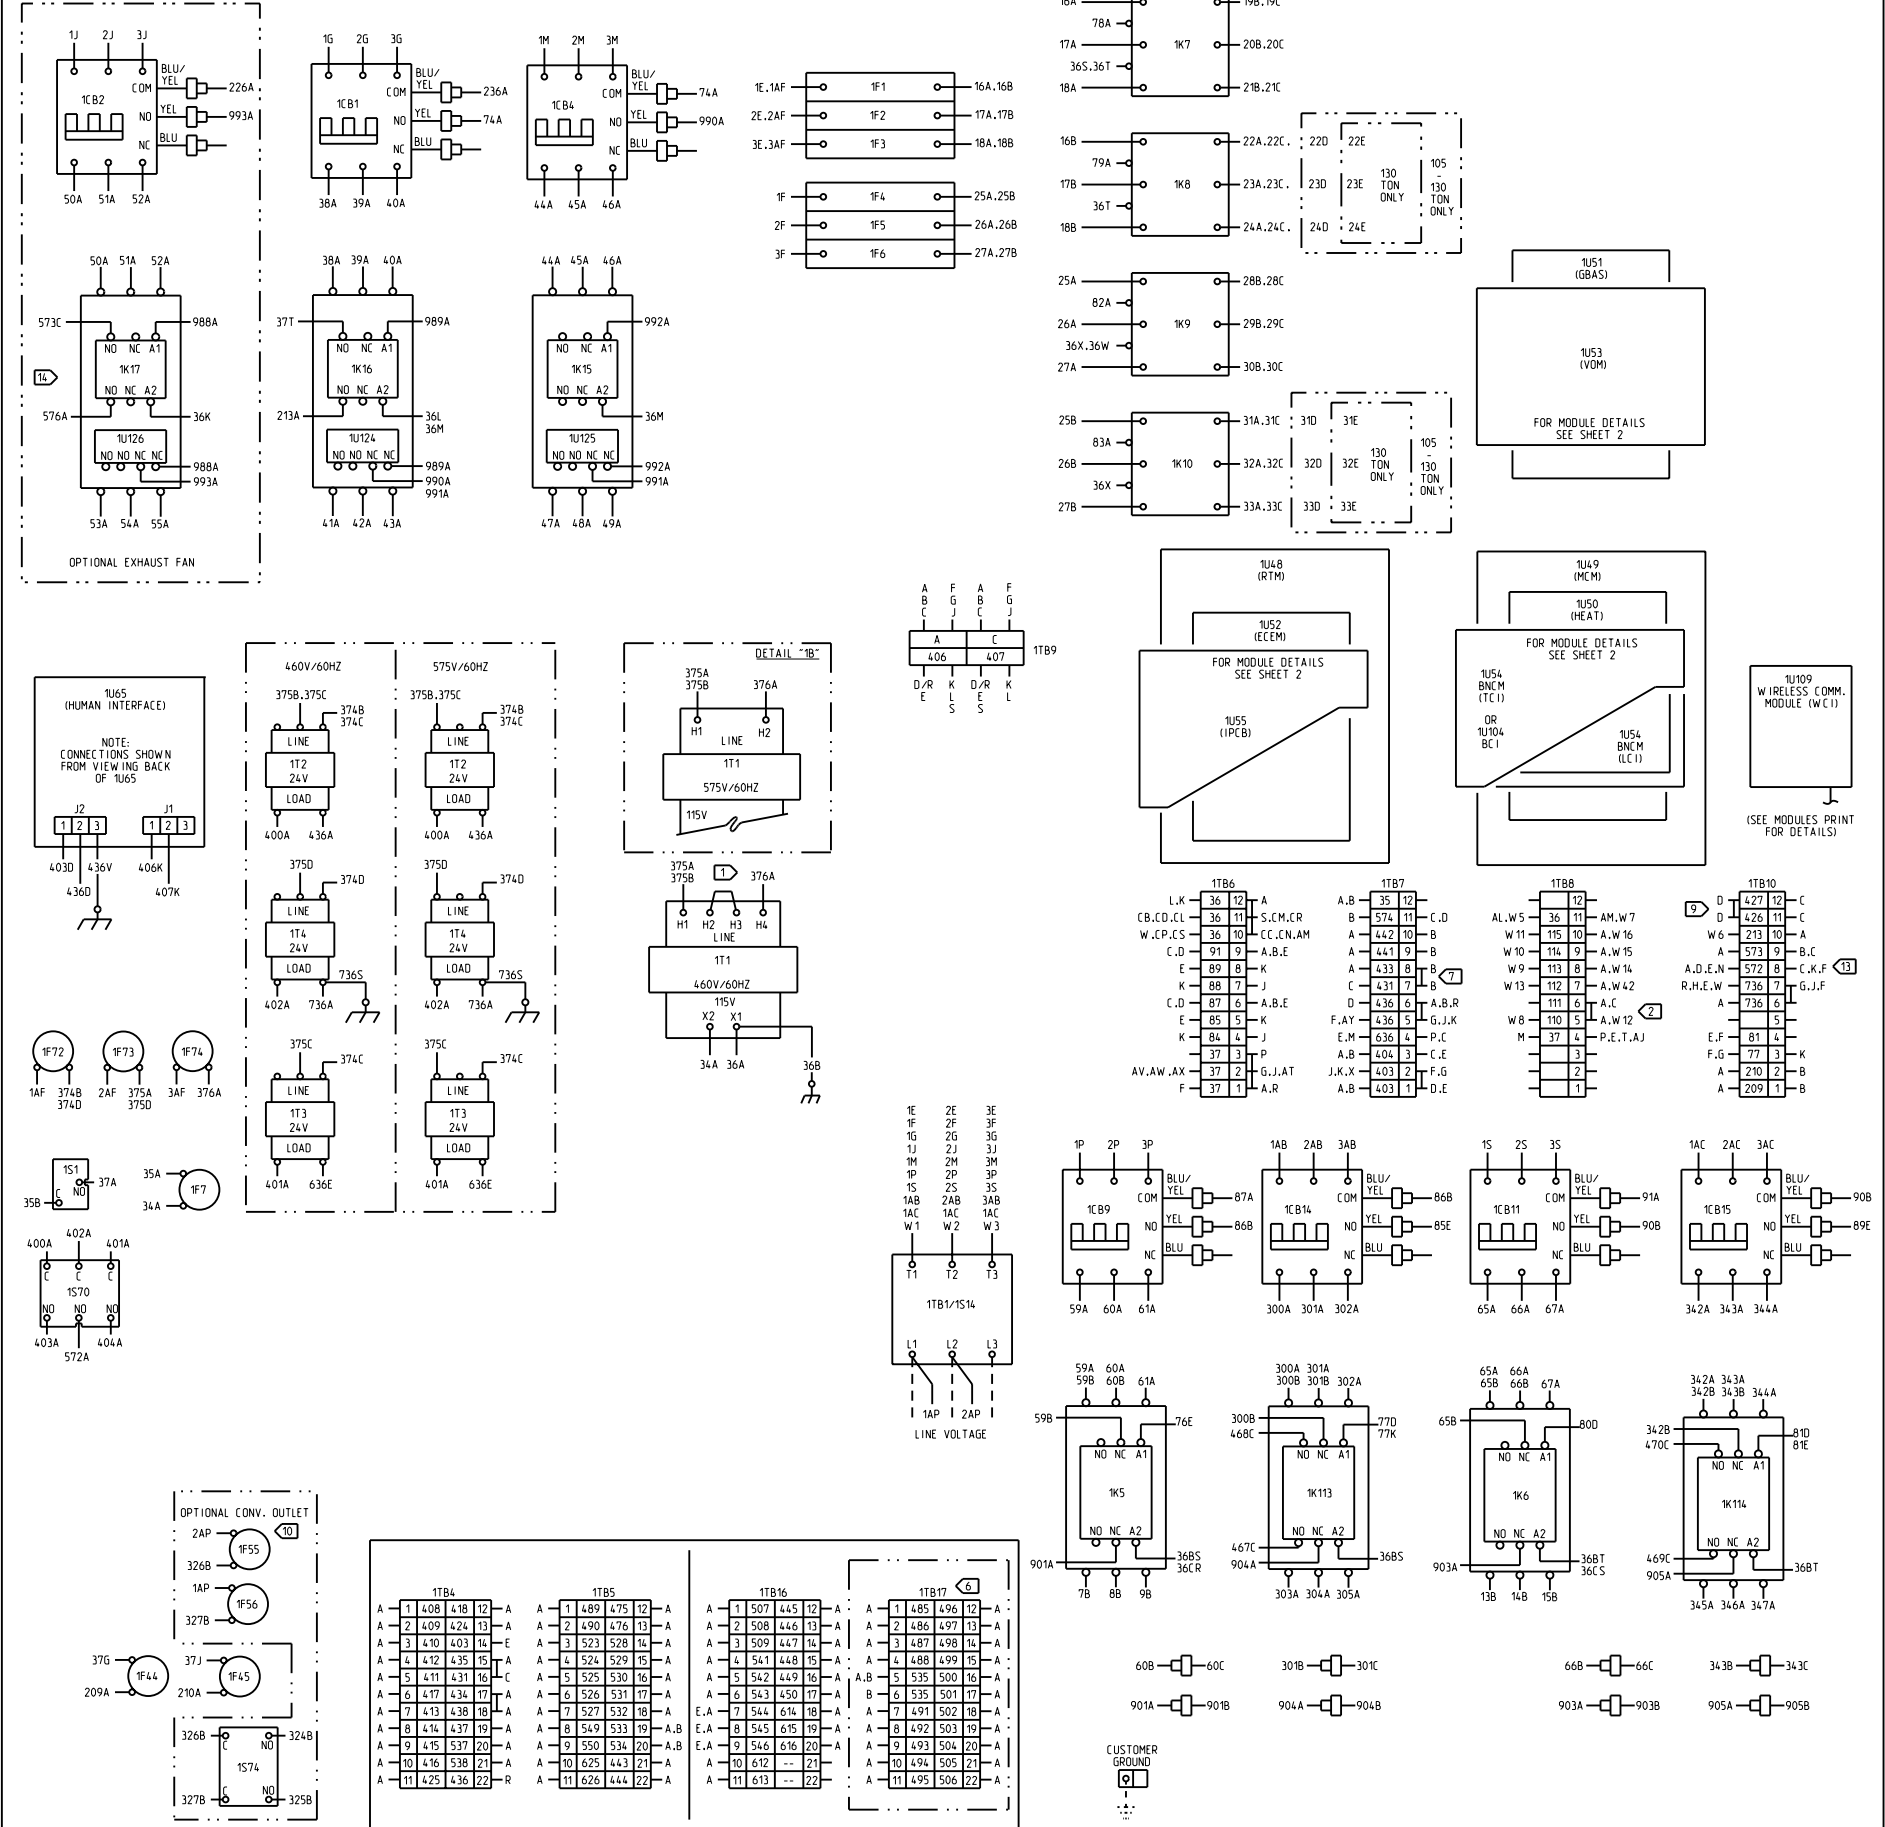

- NOTES:
- 1 460V/60HZ TRANSFORMER SHOWN. SEE DETAIL "B" FOR 575/60HZ VOLTAGE CONNECTIONS.
 - 2 JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
 - 6 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
 - 7 REMOVE JUMPER WHEN HIGH DUCT TEMP T-STAT (3516 - 3571) IS ORDERED.
 - 9 JUMPER INSTALLED ONLY ON UNITS WITHOUT ECONOMIZER OPTION.
 - 10 IF55, IF56 1/4" AND ASSOCIATED WIRING USED ON CONVENTIONAL OUTLET OPTION ONLY.
 - 13 ON 1TB10-B USE WIRE 572E ON 100% EXHAUST UNITS W/O STATITRAC. USE 572F ON 100% EXHAUST UNITS W/ STATITRAC.
 - 14 ON 1K17 AUX SWITCH USE WIRES 573C & 576A ON UNITS WITH 100% EXHAUST W/O STATITRAC ONLY.

[illegible]