
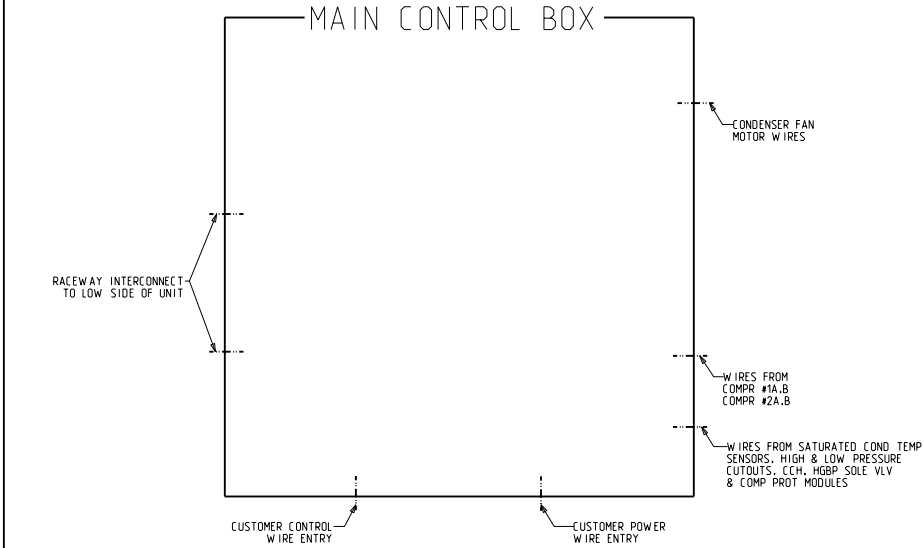


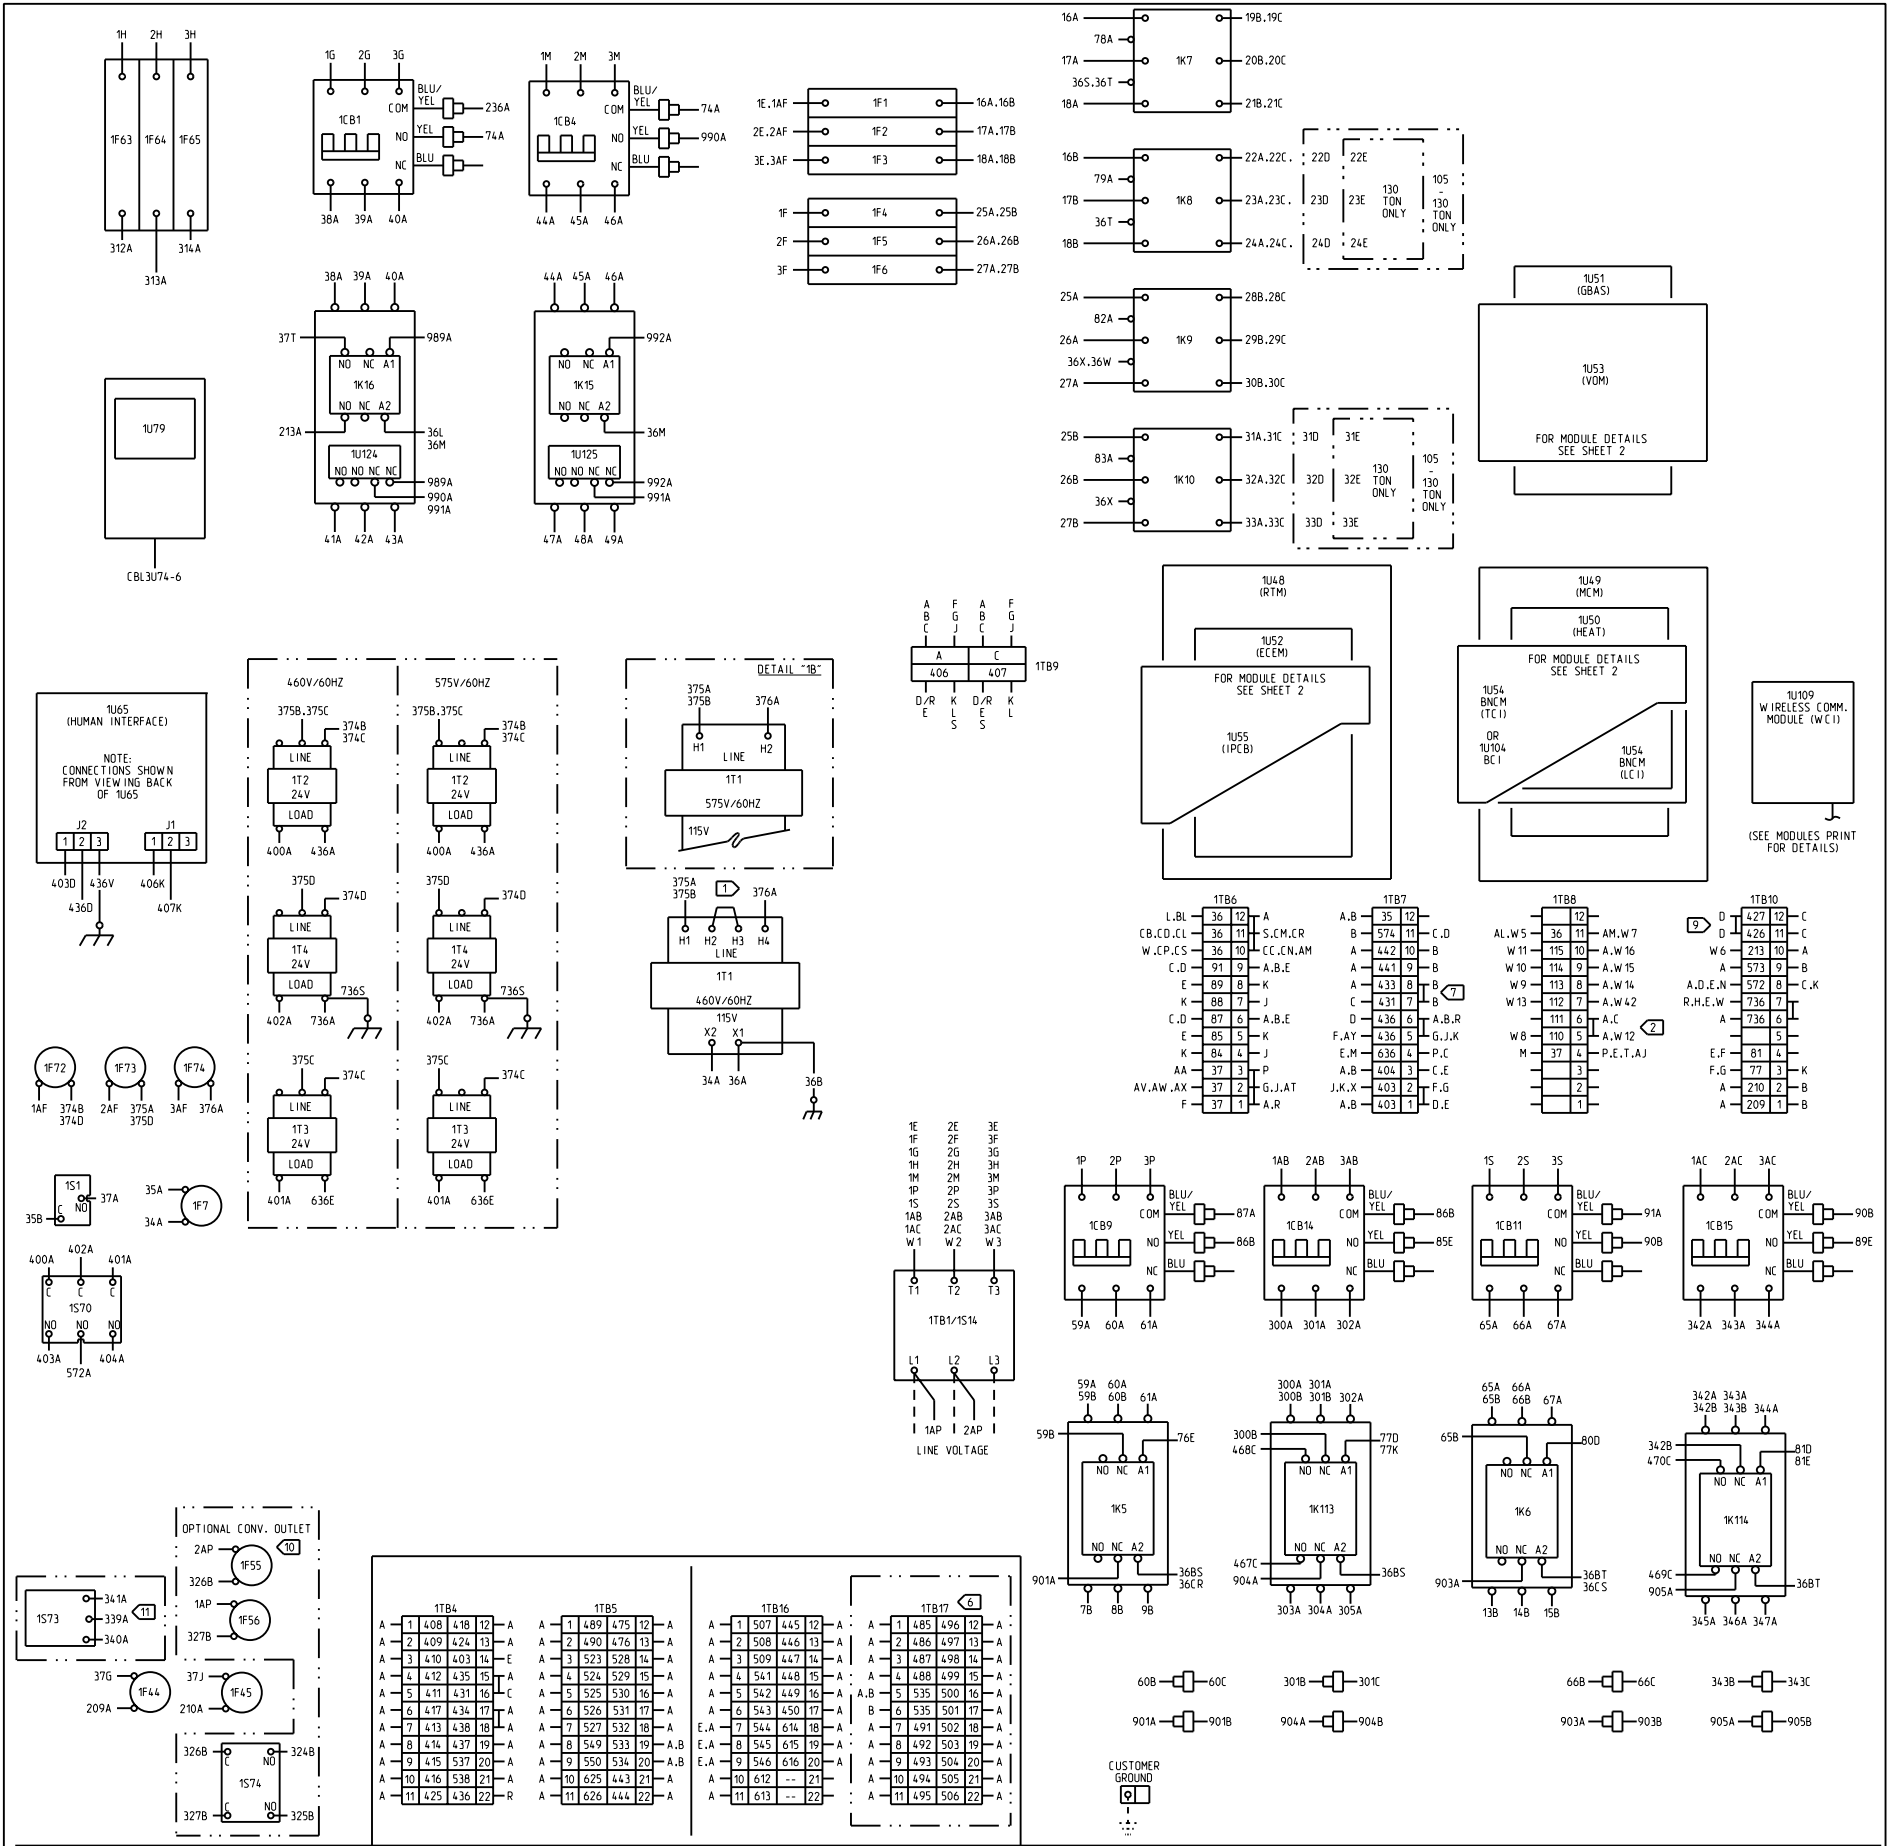

- NOTES:
- 1 460V/60HZ TRANSFORMER SHOWN. SEE DETAIL "1B" FOR 575V/60HZ VOLTAGE CONNECTIONS.
 - 2 JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
 - 3 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
 - 4 REMOVE JUMPER WHEN HIGH DUCT TEMP T-STAT (3S16 - 3S17) IS ORDERED.
 - 5 JUMPER INSTALLED ONLY ON UNITS WITHOUT ECONOMIZER OPTION.
 - 6 1F55, 1F56, 1S74 AND ASSOCIATED WIRING USED ON CONVENIENCE OUTLET OPTION ONLY.
 - 7 MANUAL BYPASS SWITCH AND ASSOCIATED WIRING OPTIONAL.

TRANS	FILE NUMBER	DRAWING NUMBER	SHEET	REV
2313-1848	2313-1851	1 OF 1	B	
ROOFTOP PACKAGED AIR CONDITIONER	CONNECTION - CONTROL BOX AREA 1			
W / EXHAUST FAN VARIABLE FREQUENCY DRIVE	90-130 TON - SHEET 1 OF 3			