



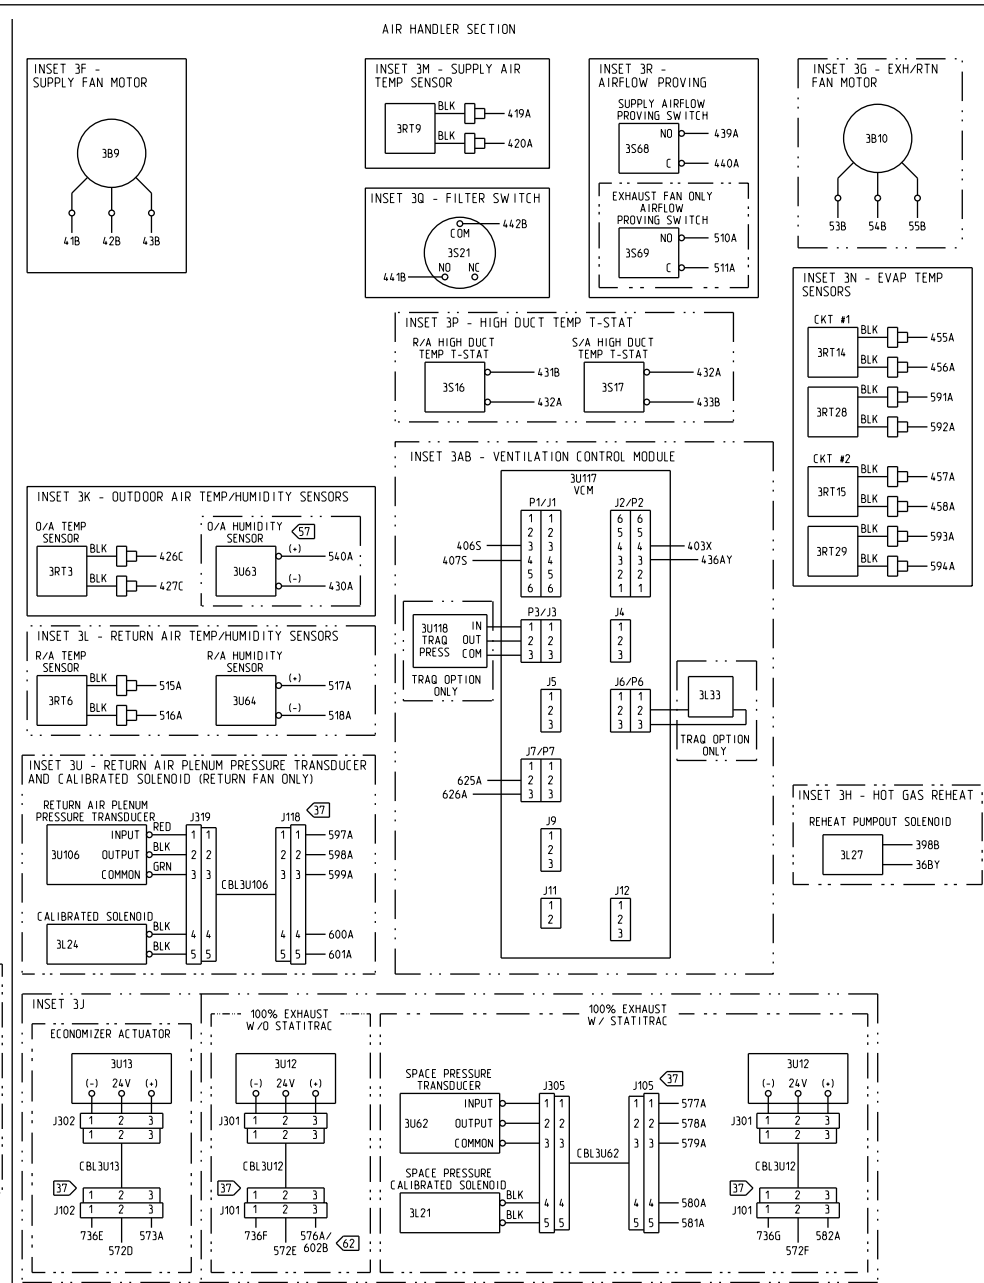

TRANE		FILE NUMBER:	2313-1863	DRAWING NUMBER:	2313-1868	SHEET:	1 of 1	REV	B
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.		ROOFTOP PACKAGED AIR CONDITIONER							
DRAWN BY: M. THOMAS		TRANE DATE: 12-19-12		DIAGRAM					
REPLACES: 2313-1020-A		REVISION DATE: 12-18/13		CONNECTION - RACEWAY DEVICES					
CAD SYSTEM USED: Pro/DETAIL		SIMILAR TO: --		40T-75T STANDARD W/ 65K SCCR					
				CONNECTION 3 OF 3					

AREA	LOCATION
1	INSIDE UNIT CONTROL BOX
2	CONDENSER SECTION
3	AIR HANDLER SECTION
4	HEATING SECTION
5	EXTERNAL FIELD MOUNTED DEVICE

- NOTES:
- 37 PLUGS J101, J102, J105, J116, J117, J118 AND J120 LOCATED IN MAIN CONTROL PANEL.
- 52 254 & 255 ARE LOW PRESSURE CUTOFF SWITCHES USED FOR COMPRESSOR PROTECTION (25 PSIG). CAUTION !! DO NOT JUMPER ACROSS SWITCH UNDER ANY CIRCUMSTANCE.
- 57 3U63 AND ASSOCIATED WIRING USED ON REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY OPTIONS.
- 61 COMP PROTECTION MODULES 287U1, 287U2, 288U3 AND 288U4 & ASSOCIATED WIRING ARE REQUIRED FOR 75 TON UNITS ONLY.
- 62 WIRE 576A USED ONLY ON UNITS WITH OPTIONAL EXHAUST FAN WITHOUT STATITRAC. WIRE 602B USED ONLY ON UNITS WITH OPTIONAL RETURN FAN WITHOUT STATITRAC.

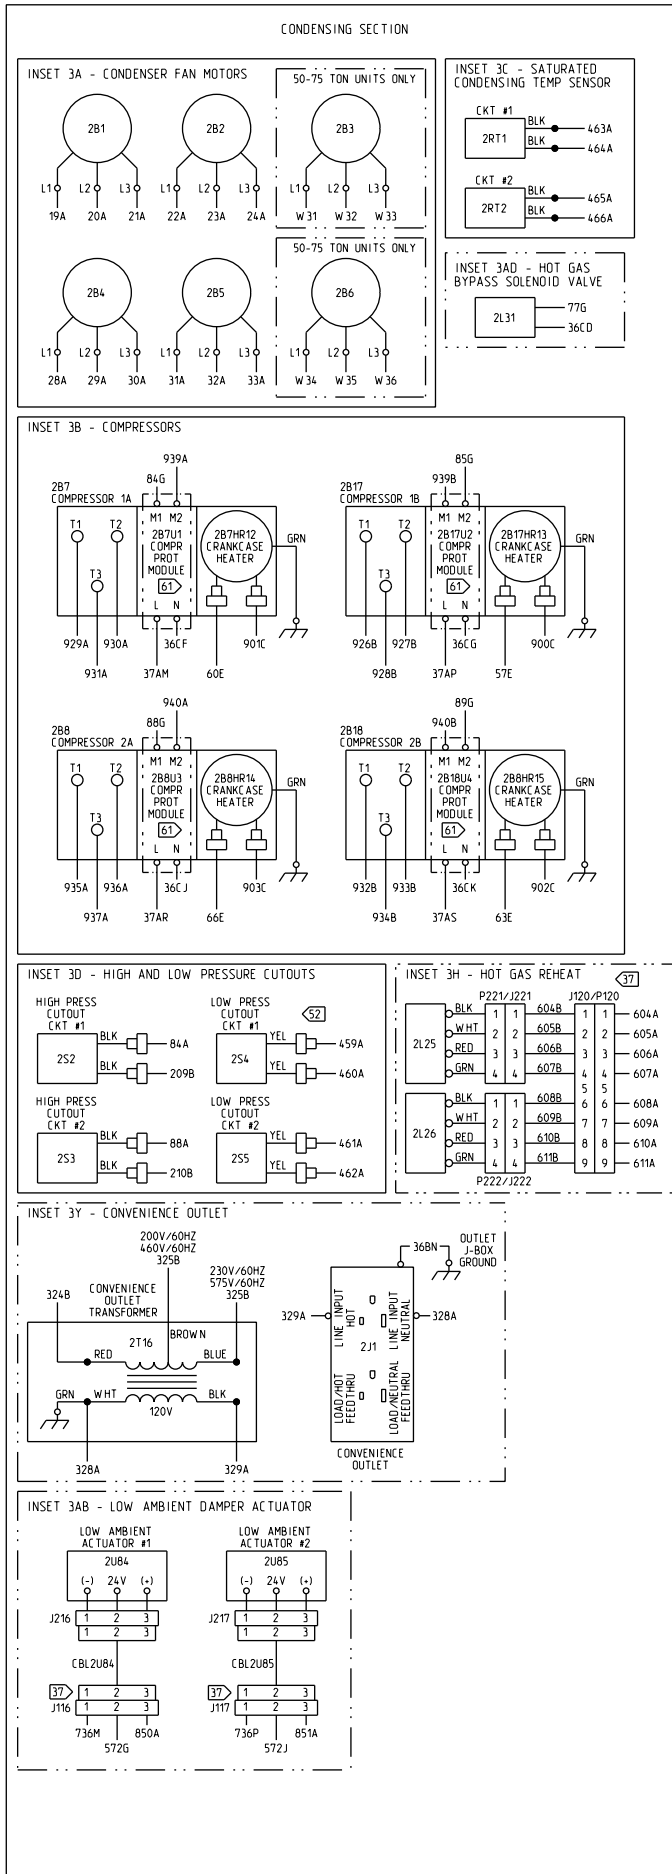