



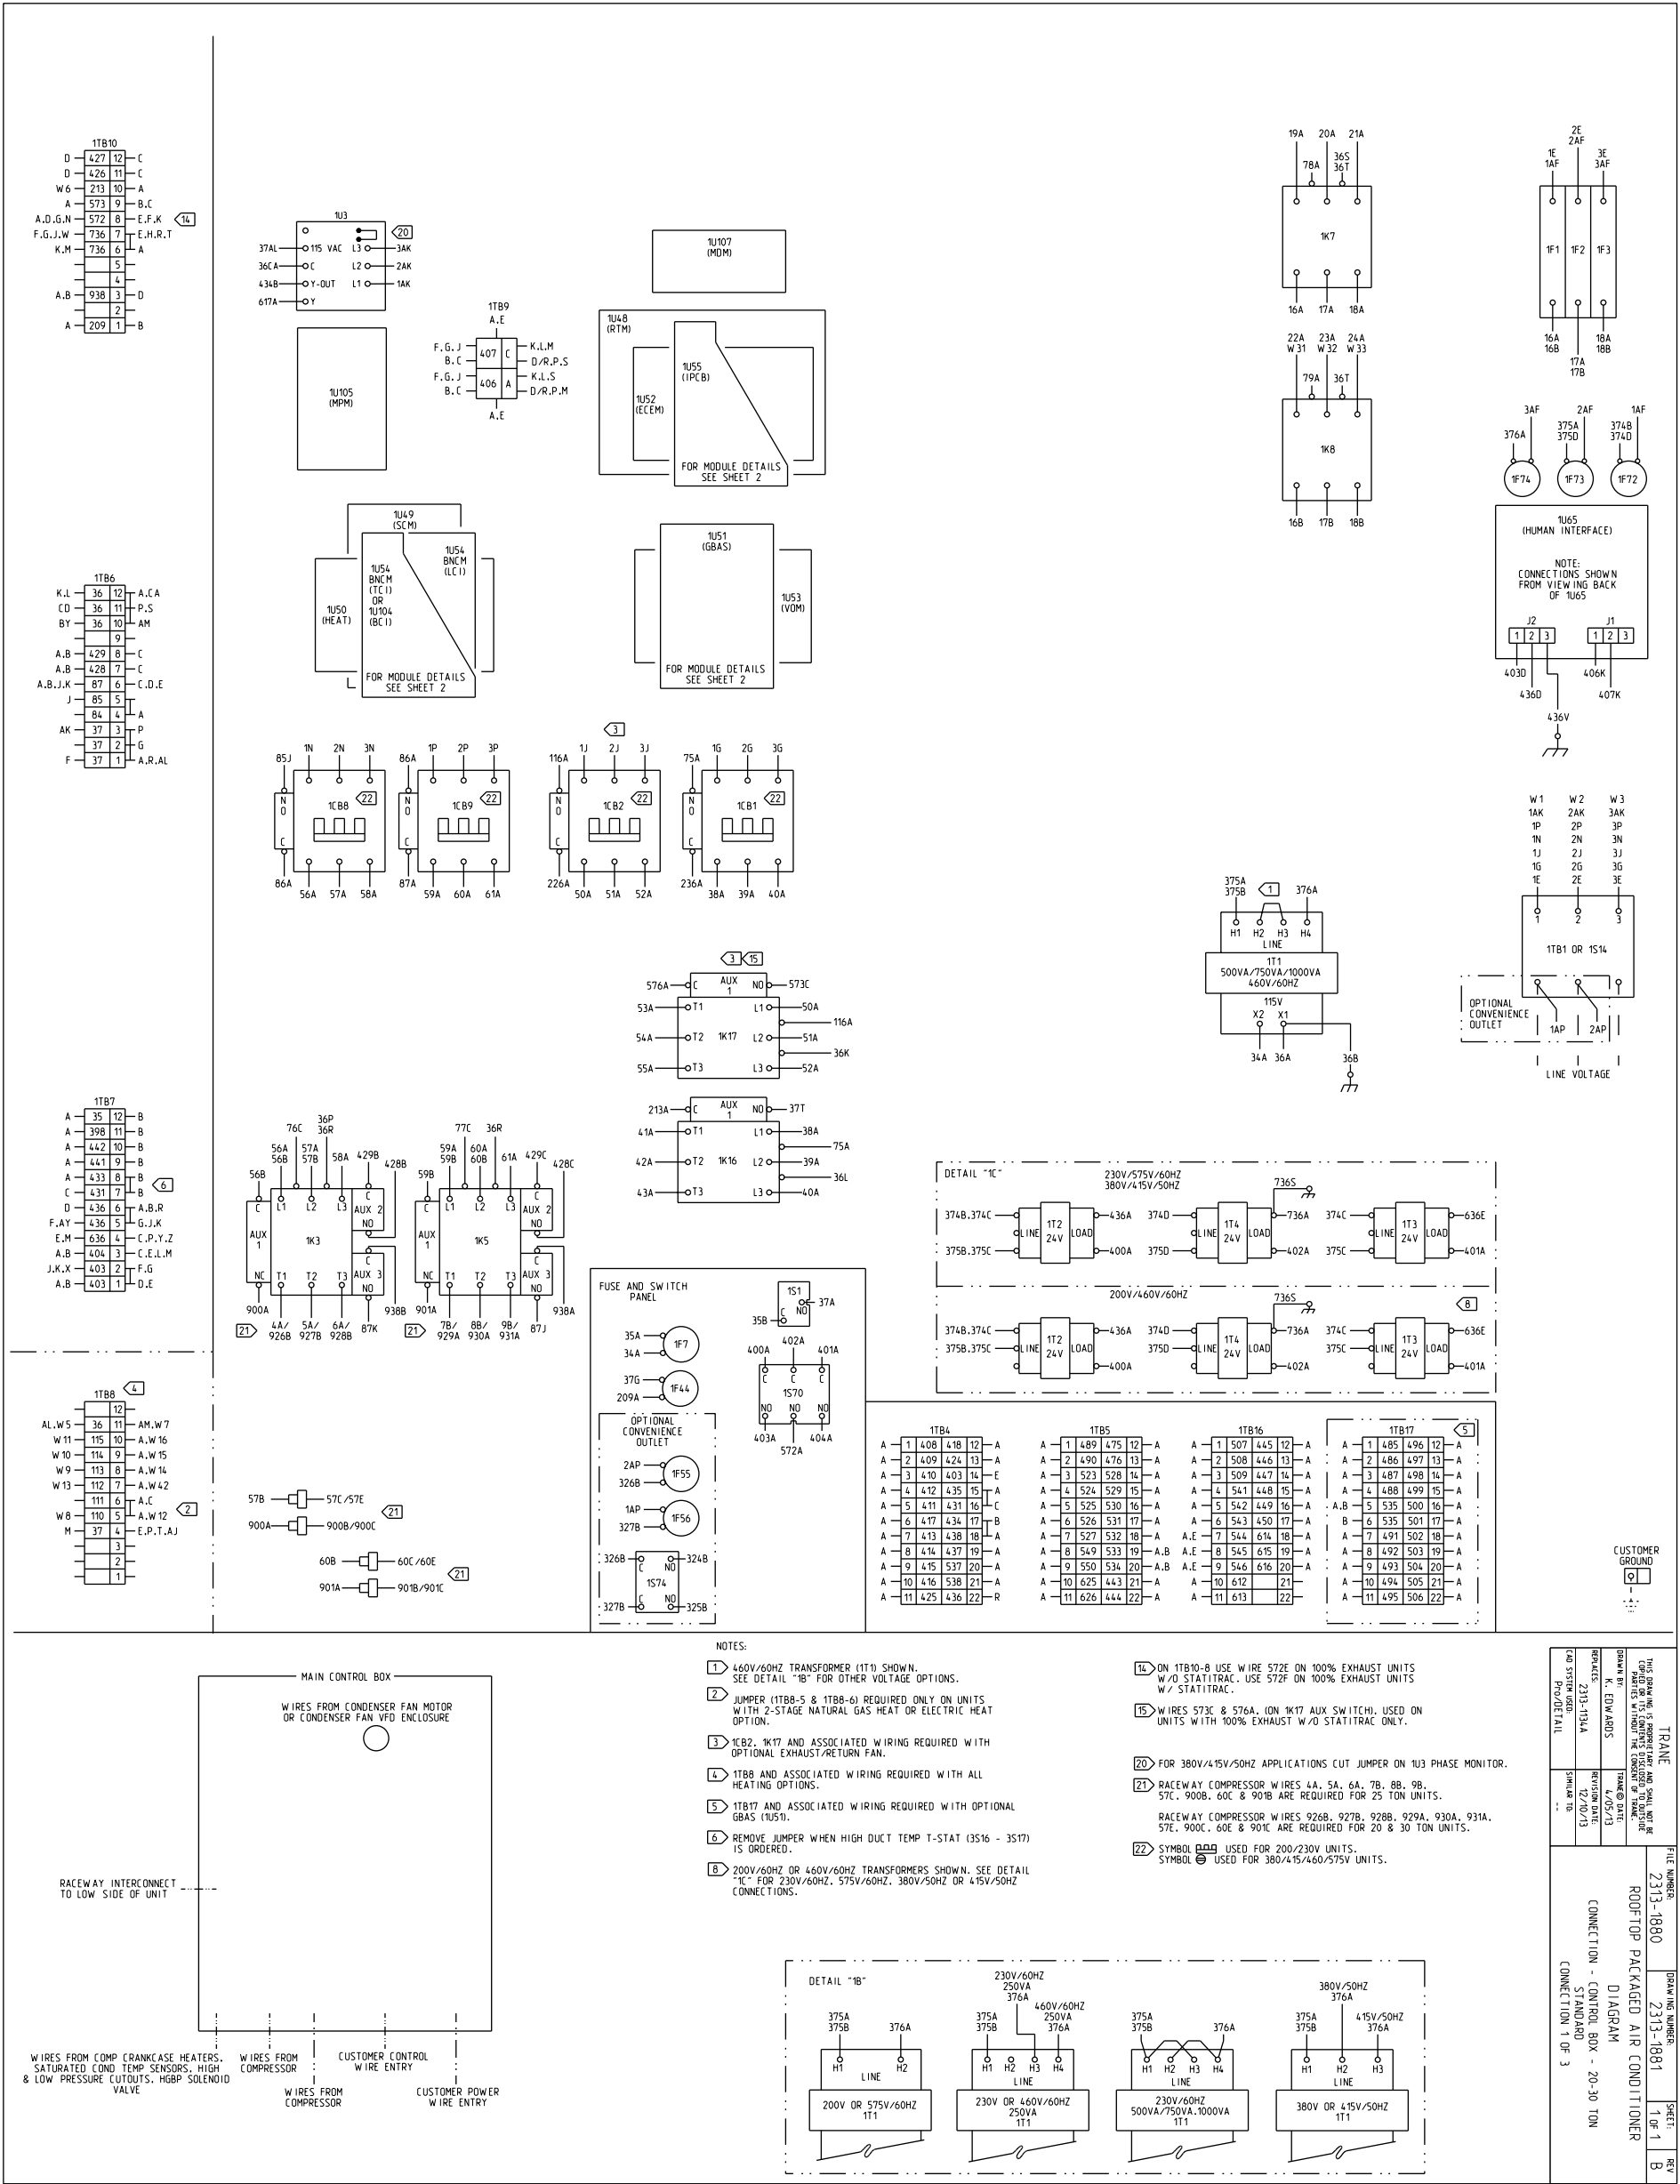

NOTES:

- 1 460V/60HZ TRANSFORMER (1T1) SHOWN. SEE DETAIL "1B" FOR OTHER VOLTAGE OPTIONS.
- 2 JUMPER (1T88-5 & 1T88-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
- 3 1CB2, 1K17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL EXHAUST/RETURN FAN.
- 4 1T88 AND ASSOCIATED WIRING REQUIRED WITH ALL HEATING OPTIONS.
- 5 1T817 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
- 6 REMOVE JUMPER WHEN HIGH DUCT TEMP T-STAT (3S17) IS ORDERED.
- 8 200V/60HZ OR 460V/60HZ TRANSFORMERS SHOWN. SEE DETAIL "1C" FOR 230V/60HZ, 575V/60HZ, 380V/50HZ OR 415V/50HZ CONNECTIONS.
- 14 ON 1T810-B USE WIRE 572E ON 100% EXHAUST UNITS W/O STATITRAC. USE 572F ON 100% EXHAUST UNITS W/O STATITRAC.
- 15 WIRES 573C & 576A (ON 1K17 AUX SWITCH) USED ON UNITS WITH 100% EXHAUST W/O STATITRAC ONLY.
- 20 FOR 380V/415V/50HZ APPLICATIONS CUT JUMPER ON 1U3 PHASE MONITOR.
- 21 RACEWAY COMPRESSOR WIRES 4A, 5A, 6A, 7B, 8B, 9B, 57C, 900B, 60C & 901B ARE REQUIRED FOR 25 TON UNITS. RACEWAY COMPRESSOR WIRES 926B, 927B, 928B, 929A, 930A, 931A, 57E, 900C, 60E & 901C ARE REQUIRED FOR 20 & 30 TON UNITS.
- 22 SYMBOL USED FOR 200/230V UNITS. SYMBOL USED FOR 380/415/460/575V UNITS.

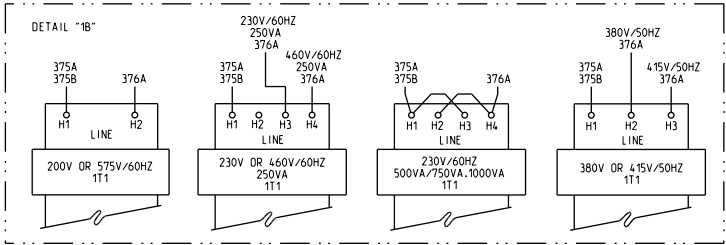

THIS DRAWING IS THE PROPERTY OF THE COMPANY AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM.	DRAWN BY: EDV ADOS CHECKED BY: J. J. J. J. DATE: 12/10/13 SCALE: 10:1	TRANSFORMER: 2313-1881 DATE: 12/10/13 SCALE: 10:1	FILE NUMBER: 2313-1880 DRAWING NUMBER: 2313-1881 SHEET: 1 OF 1 REV: B