
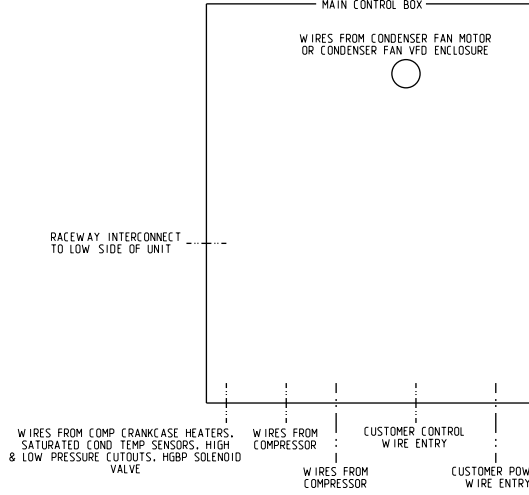


- NOTES:
- 1 460V/60HZ TRANSFORMER (1T1) SHOWN. SEE DETAIL "1B" FOR OTHER VOLTAGE OPTIONS.
 - 2 JUMPER (11B8-5 & 11B8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
 - 4 11B8 AND ASSOCIATED WIRING REQUIRED WITH ALL HEATING OPTIONS.
 - 5 11B17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
 - 6 REMOVE JUMPER WHEN HIGH DUCT TEMP T-STAT (3S16 - 3S17) IS ORDERED.
 - 8 200V/60HZ OR 460V/60HZ TRANSFORMERS SHOWN. SEE DETAIL "1C" FOR 230V/60HZ, 575V/60HZ, 380V/50HZ OR 415V/50HZ CONNECTIONS.
 - 11 MANUAL BYPASS SWITCH AND ASSOCIATED WIRING OPTIONAL.

- 19 WIRES 572F, 736J & 736G USED WITH RETURN FAN OPTION ONLY.
- 20 FOR 380V/415V/50HZ APPLICATIONS CUT JUMPER ON 1U3 PHASE MONITOR.
- 21 RACEWAY COMPRESSOR WIRES 4A, 5A, 6A, 7B, 8B, 9B, 57C, 900B, 60C & 901B ARE REQUIRED FOR 25 TON UNITS.
- 21 RACEWAY COMPRESSOR WIRES 926B, 927B, 928B, 929A, 930A, 931A, 57E, 900C, 60E & 901C ARE REQUIRED FOR 20 & 30 TON UNITS.
- 22 SYMBOL USED FOR 200/230V UNITS. SYMBOL USED FOR 380/415/460/575V UNITS.

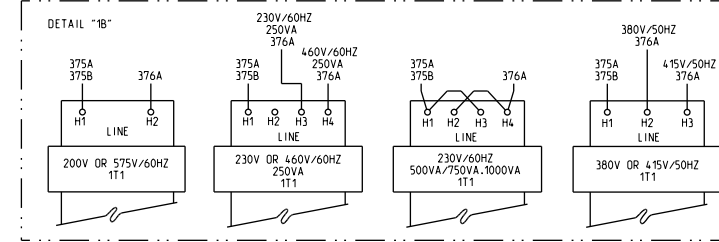

THIS DRAWING IS THE PROPERTY OF TRANE. IT IS TO BE USED ONLY FOR THE EQUIPMENT SPECIFICALLY IDENTIFIED HEREIN. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM.	DRAWN BY: EDV ADOS CHECKED BY: J. J. J. J. DATE: 12/10/13 SCALE: 1" = 1'-0"	TITLE: TRANSFORMER DRAWING NUMBER: 2313-1883 SHEET: 1 OF 1 REV: B