


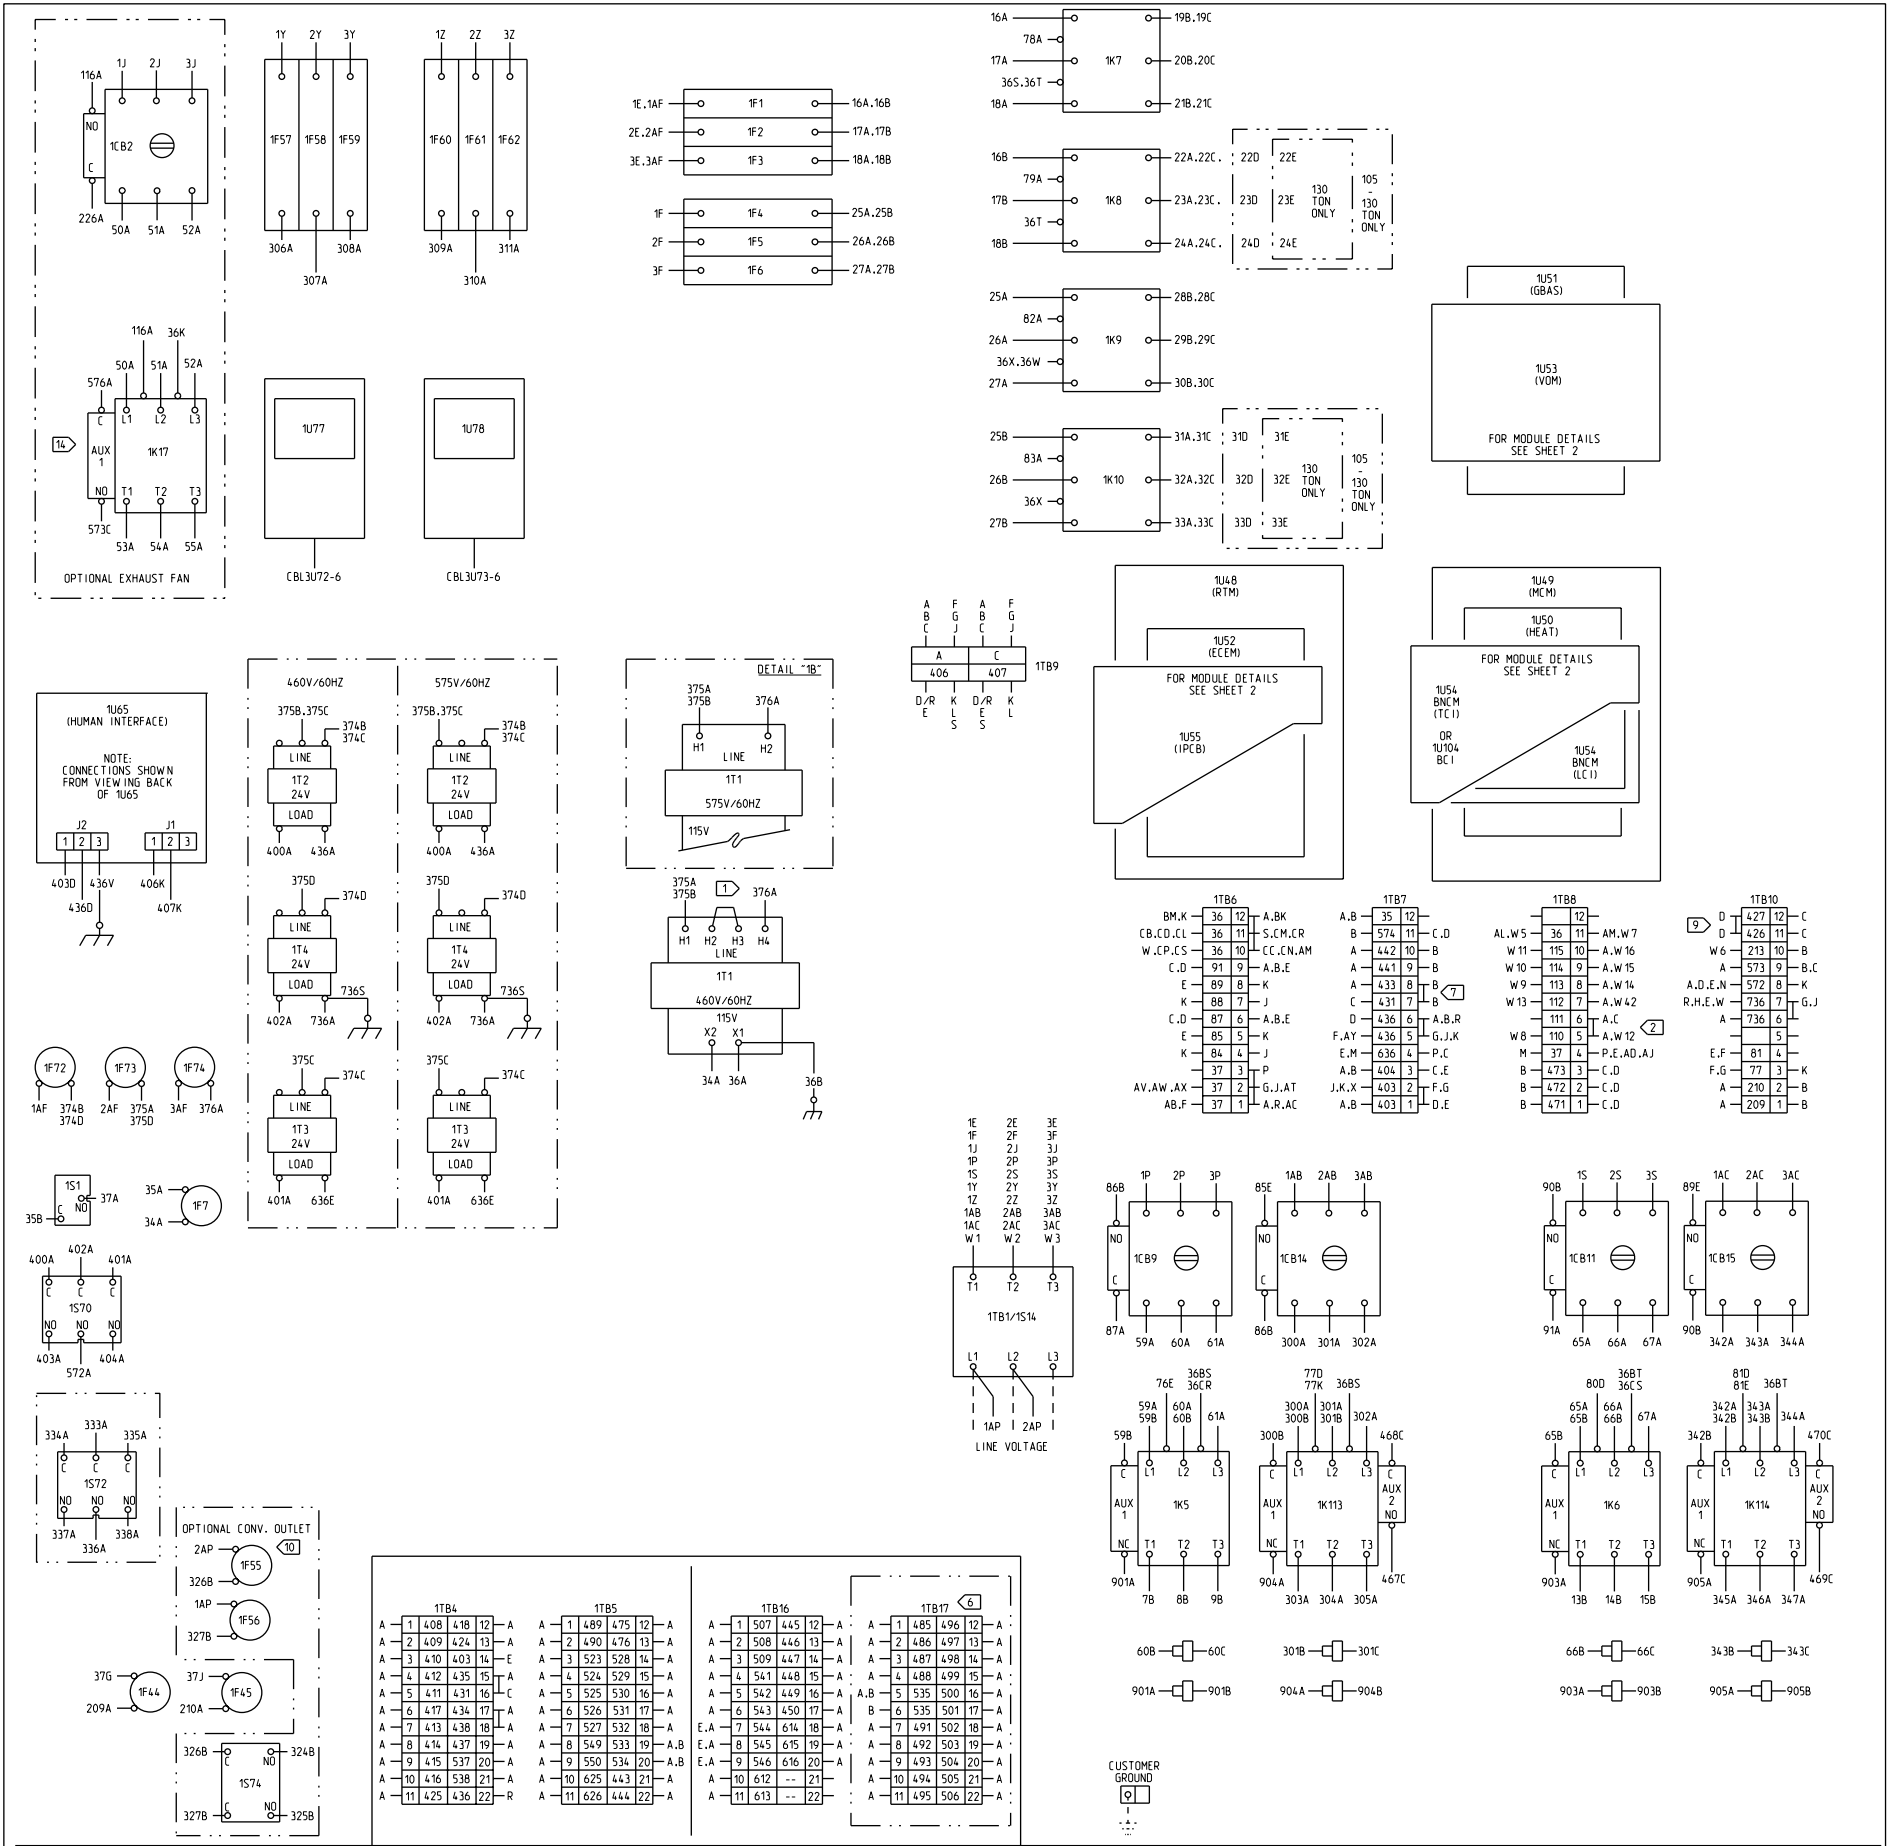

NOTES:

- 460V/60HZ TRANSFORMER SHOWN. SEE DETAIL "1B" FOR 575/60HZ VOLTAGE CONNECTIONS.
- JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
- 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
- REMOVE JUMPER WHEN HIGH DUCT TEMP T-STAT (3516 - 3517) IS ORDERED.
- JUMPER INSTALLED ONLY ON UNITS WITHOUT ECONOMIZER OPTION.
- 1F55, 1F56, 1F74 AND ASSOCIATED WIRING USED ON CONVENIENCE OUTLET OPTION ONLY.
- MANUAL BYPASS SWITCH AND ASSOCIATED WIRING OPTIONAL.
- ON 1K17 AUX SWITCH USE WIRES 573C & 576A ON UNITS WITH 100% EXHAUST W/O STATITRAC ONLY.

TRANS. FILE NUMBER: 2313-1892
DRAWING NUMBER: 2313-1894
SHEET: 1 OF 1
REV: A

CONNECTION - CONTROL BOX AREA 1
W/ SUPPLY FAN VARIABLE FREQUENCY DRIVE
90-130 TON - SHEET 1 OF 3