




NOTES:		TRANS 2313-1892 2313-1896 1 OF 1 A		DRAWING NUMBER 2313-1896 SHEET 1 OF 1 REV A	
1 460V/60HZ TRANSFORMER SHOWN. SEE DETAIL "1B" FOR 575/60HZ VOLTAGE CONNECTIONS.		THE DRAWING IS THE PROPERTY OF THE COMPANY AND IS LOANED TO YOU BY THE COMPANY. IT IS TO BE USED FOR THE PROJECT ONLY AND NOT TO BE REPRODUCED OR COPIED IN ANY MANNER WITHOUT THE CONSENT OF TRANS.		FILE NUMBER 2313-1892	
2 JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.		DRAWN BY: K. EDWARDS		ROOFTOP PACKAGED AIR CONDITIONER DIAGRAM	
3 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).		CHECKED: 2313-117A		CONNECTION - CONTROL BOX AREA 1 W/ SUPPLY AND EXHAUST FAN VARIABLE FREQUENCY DRIVES 90-130 TON - SHEET 1 OF 3	
4 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).		DATE: 5/20/13			
5 REMOVE JUMPER WHEN HIGH DUCT TEMP T-STAT (3516 - 3517) IS ORDERED.		REGIONAL DATE:			
6 JUMPER INSTALLED ONLY ON UNITS WITHOUT ECONOMIZER OPTION.		SIMILAR TO: --			
7 1F55, 1F56, 1F74 AND ASSOCIATED WIRING USED ON CONVENIENCE OUTLET OPTION ONLY.					
8 MANUAL BYPASS SWITCH AND ASSOCIATED WIRING OPTIONAL.					

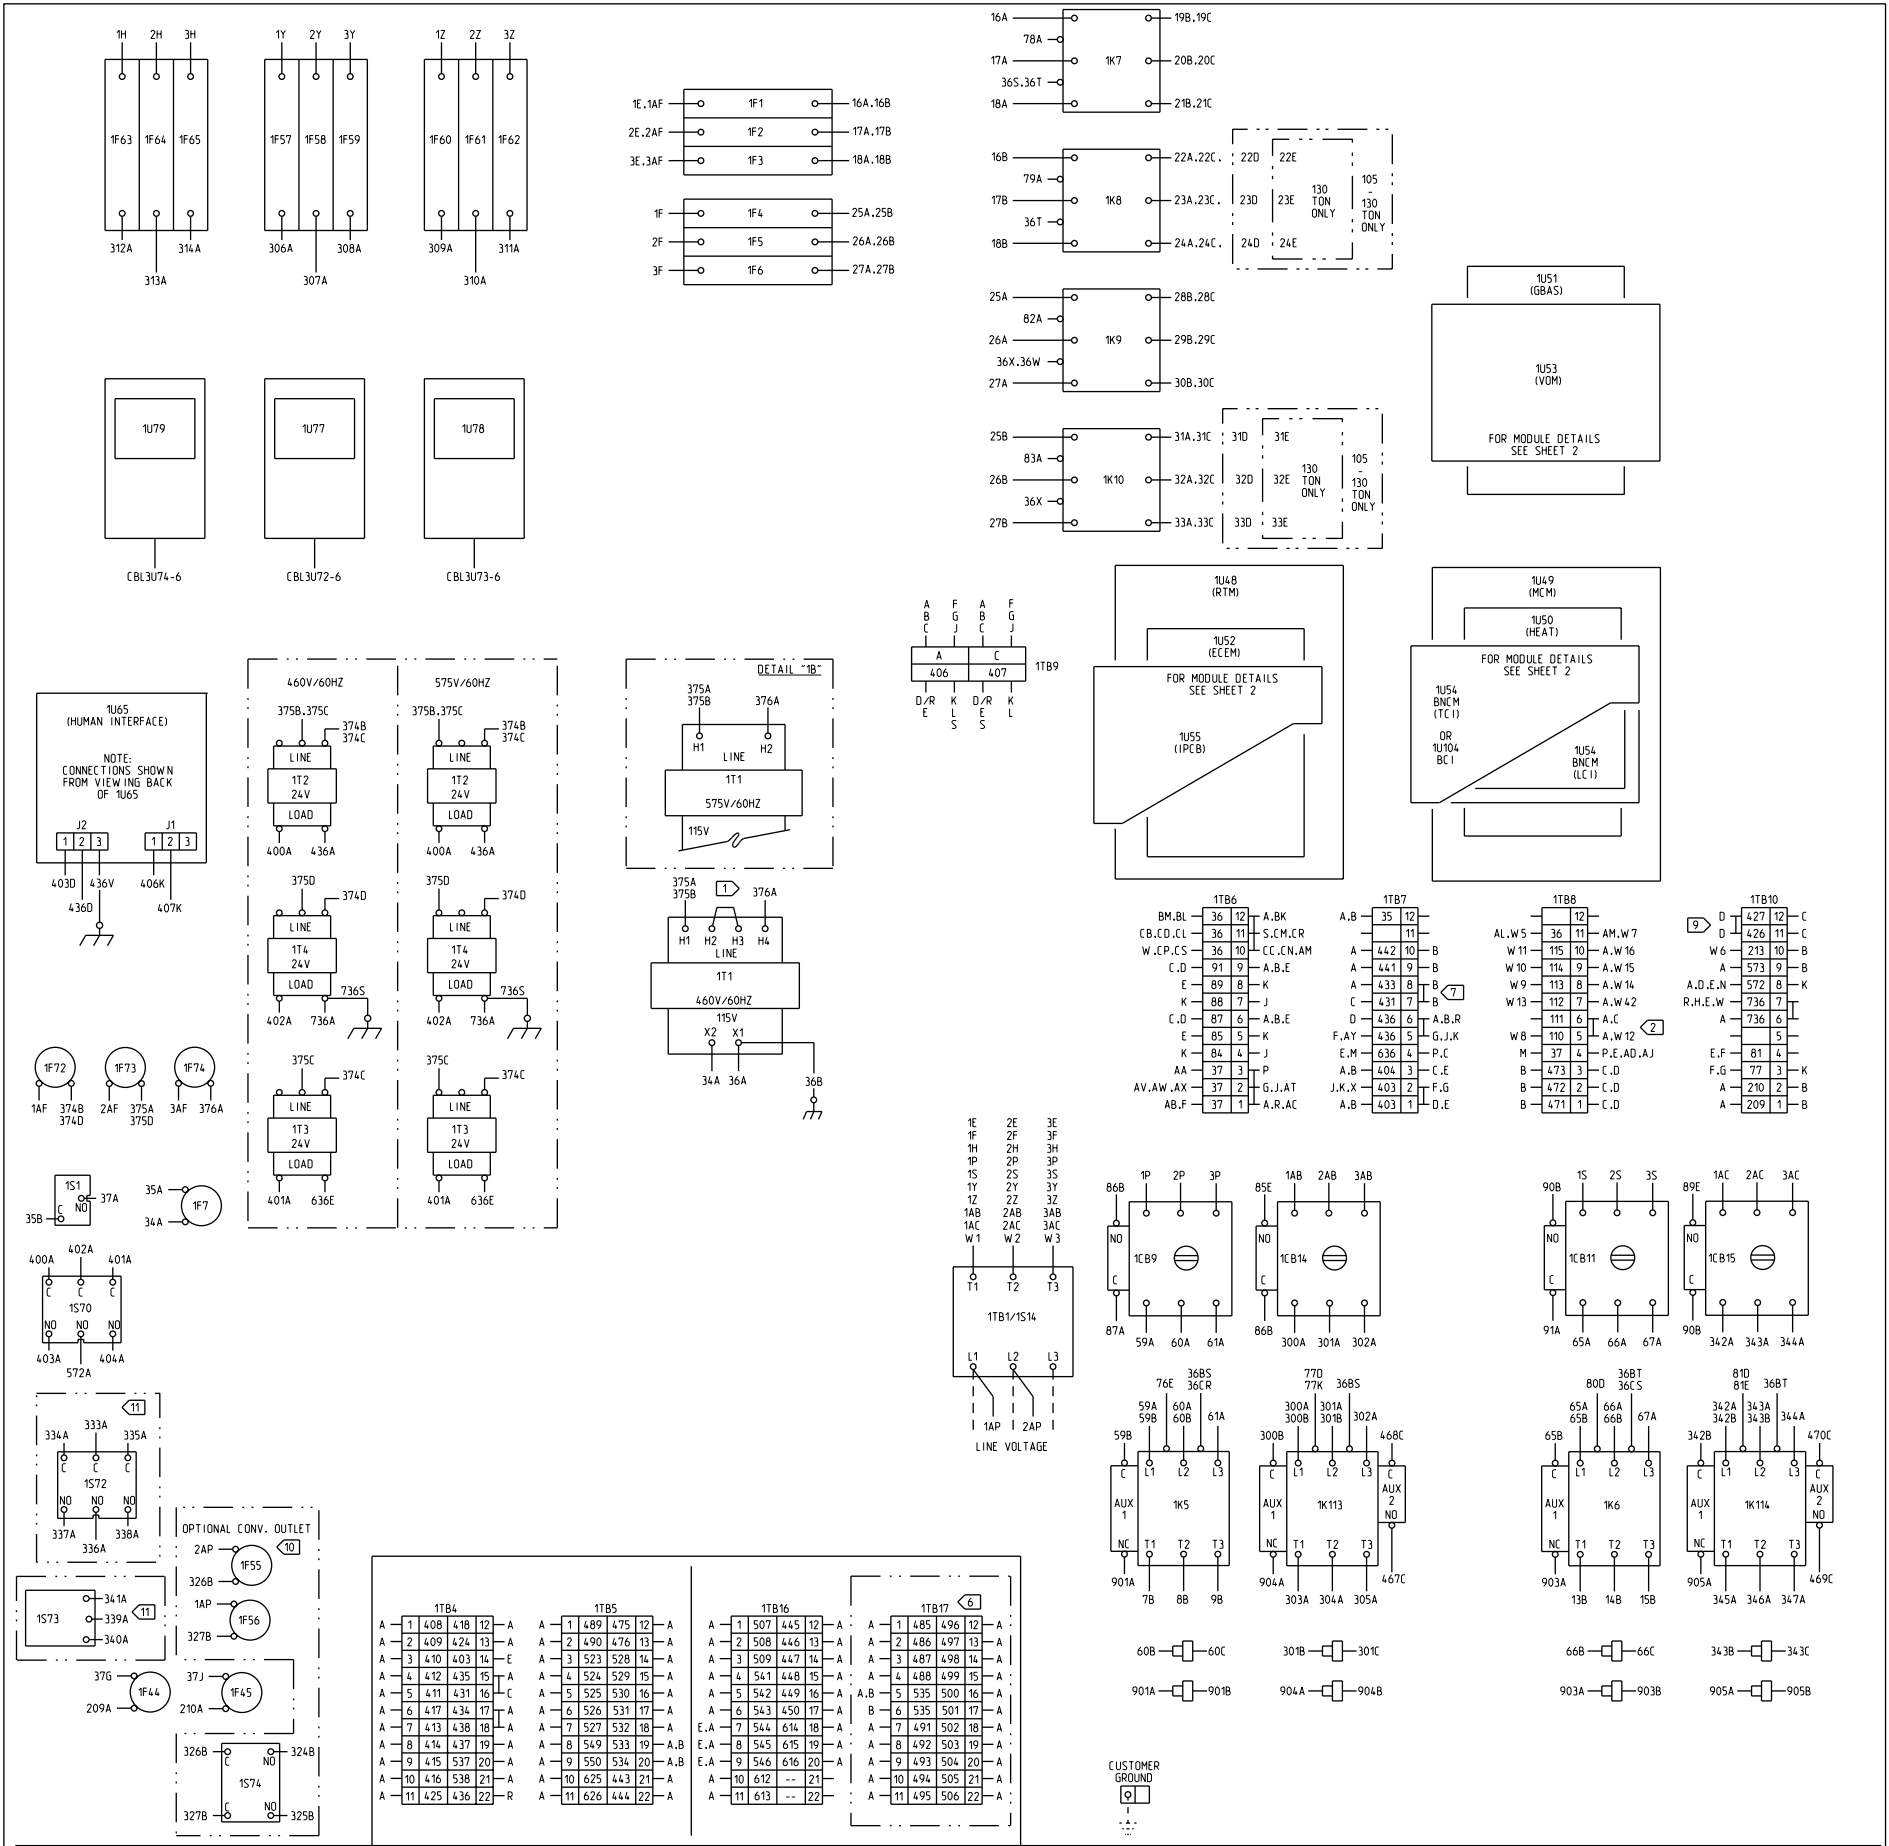