
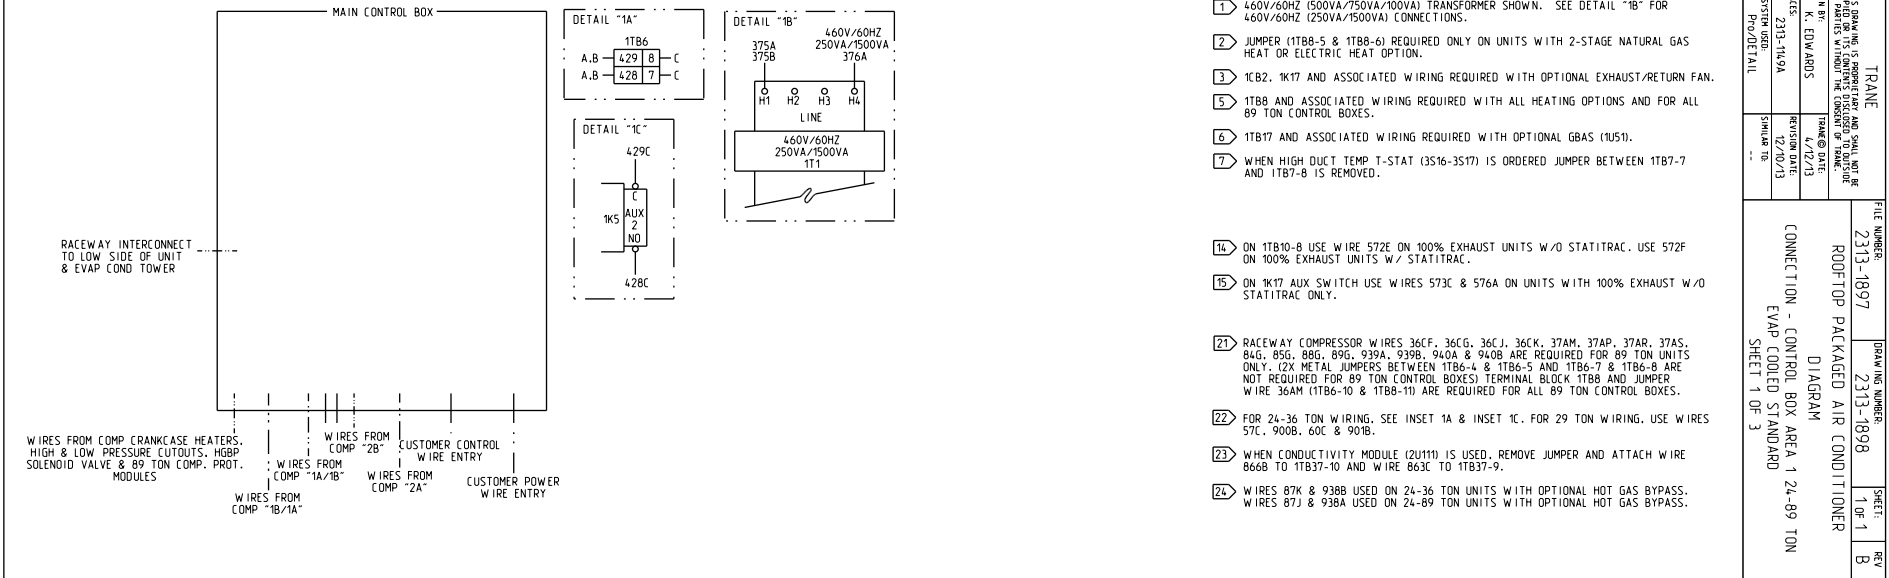


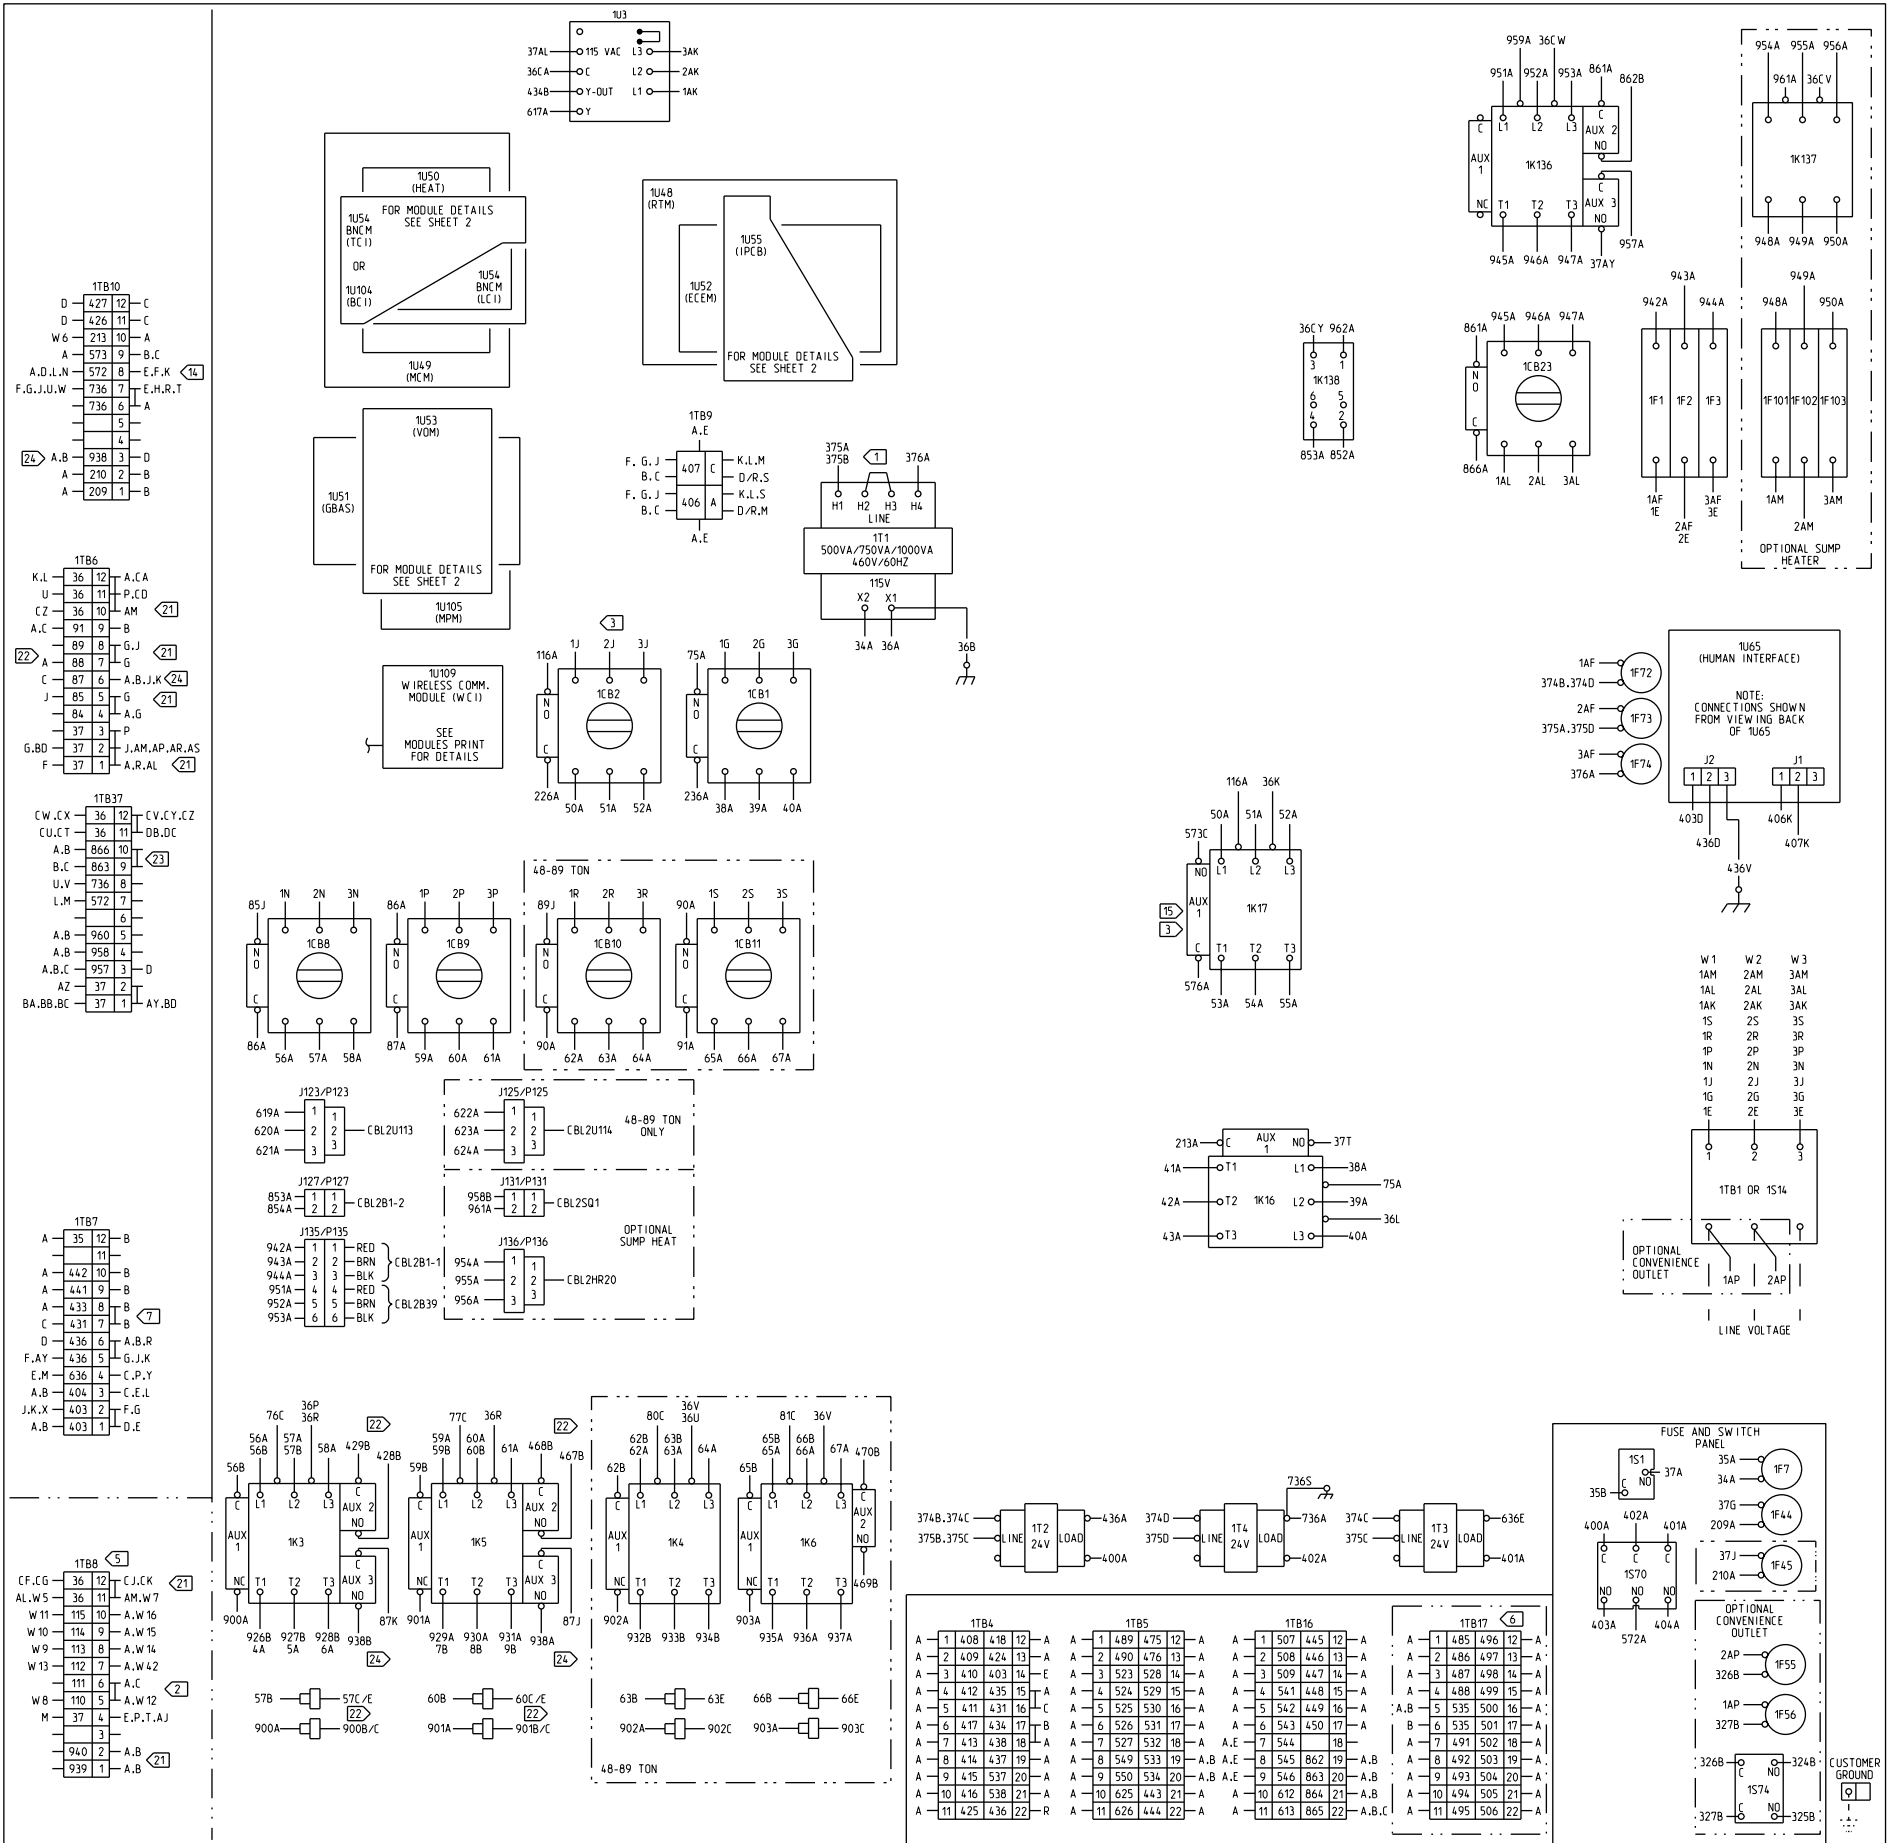

- NOTES:
- 460V/60HZ (500VA/750VA/1000VA) TRANSFORMER SHOWN. SEE DETAIL "1B" FOR 460V/60HZ (250VA/500VA) CONNECTIONS.
 - JUMPER (1TB8-5 & 1TB8-6) REQUIRED ONLY ON UNITS WITH 2-STAGE NATURAL GAS HEAT OR ELECTRIC HEAT OPTION.
 - 1K12, 1K17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL EXHAUST/RETURN FAN.
 - 1TB8 AND ASSOCIATED WIRING REQUIRED WITH ALL HEATING OPTIONS AND FOR ALL 89 TON CONTROL BOXES.
 - 1TB17 AND ASSOCIATED WIRING REQUIRED WITH OPTIONAL GBAS (1U51).
 - WHEN HIGH DUCT TEMP T-STAT (3S16-3S17) IS ORDERED JUMPER BETWEEN 1TB7-7 AND 1TB7-8 IS REMOVED.
- 14 ON 1TB10-8 USE WIRE 572E ON 100% EXHAUST UNITS W/O STATITRAC. USE 572F ON 100% EXHAUST UNITS W/ STATITRAC.
- 15 ON 1K17 AUX SWITCH USE WIRES 573C & 576A ON UNITS WITH 100% EXHAUST W/O STATITRAC ONLY.
- 21 RACEWAY COMPRESSOR WIRES 36CF, 36CG, 36CJ, 36CK, 37AM, 37AP, 37AR, 37AS, 84G, 85G, 86G, 89G, 939A, 939B, 940A & 940B ARE REQUIRED FOR 89 TON UNITS ONLY. (2X METAL JUMPERS BETWEEN 1TB6-4 & 1TB6-5 AND 1TB6-7 & 1TB6-8 ARE NOT REQUIRED FOR 89 TON CONTROL BOXES) TERMINAL BLOCK 1TB8 AND JUMPER WIRE 36AM (1TB6-10 & 1TB8-11) ARE REQUIRED FOR ALL 89 TON CONTROL BOXES.
- 22 FOR 24-36 TON WIRING, SEE INSET 1A & INSET 1C. FOR 29 TON WIRING, USE WIRES 57C, 900B, 60C & 901B.
- 23 WHEN CONDUCTIVITY MODULE (2U111) IS USED, REMOVE JUMPER AND ATTACH WIRE 866B TO 1TB37-10 AND WIRE 863C TO 1TB37-9.
- 24 WIRES 87K & 938B USED ON 24-36 TON UNITS WITH OPTIONAL HOT GAS BYPASS. WIRES 87J & 938A USED ON 24-89 TON UNITS WITH OPTIONAL HOT GAS BYPASS.

THIS DRAWING IS THE PROPERTY OF TRANE. IT IS TO BE USED ONLY FOR THE EQUIPMENT AND PARTS SHOWN HEREIN. NO PARTS ARE TO BE USED WITHOUT THE WRITTEN CONSENT OF TRANE.	DRAWN BY: EDW ANDS CHECKED BY: J. J. ANDS DATE: 12/12/13 SCALE: 1:1	TITLE: TRANSFORMER AND WIRING FOR ROOF TOP PACKAGED AIR CONDITIONER DIAGRAM	SHEET: 1 OF 1