TRANE	FILE NUMBER: 2313-1918	DRAWING NUMBER: 2313-1920	SHEET: 1 OF 1	REV A
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.	ROOFTOP PACKAGED AIR CONDITIONER DIAGRAM COMMON CONTROL MODULES EVAP COOLED W/ SUPPLY FAN V.F.D. CONNECTION 2 OF 3			
DRAWN BY: K. EDWARDS	TRANE® DATE: 5/04/13			
REPLACES: 2313-1169A	REVISION DATE: --			
CAD SYSTEM USED: Pro/DETAIL	SIMILAR TO: --			

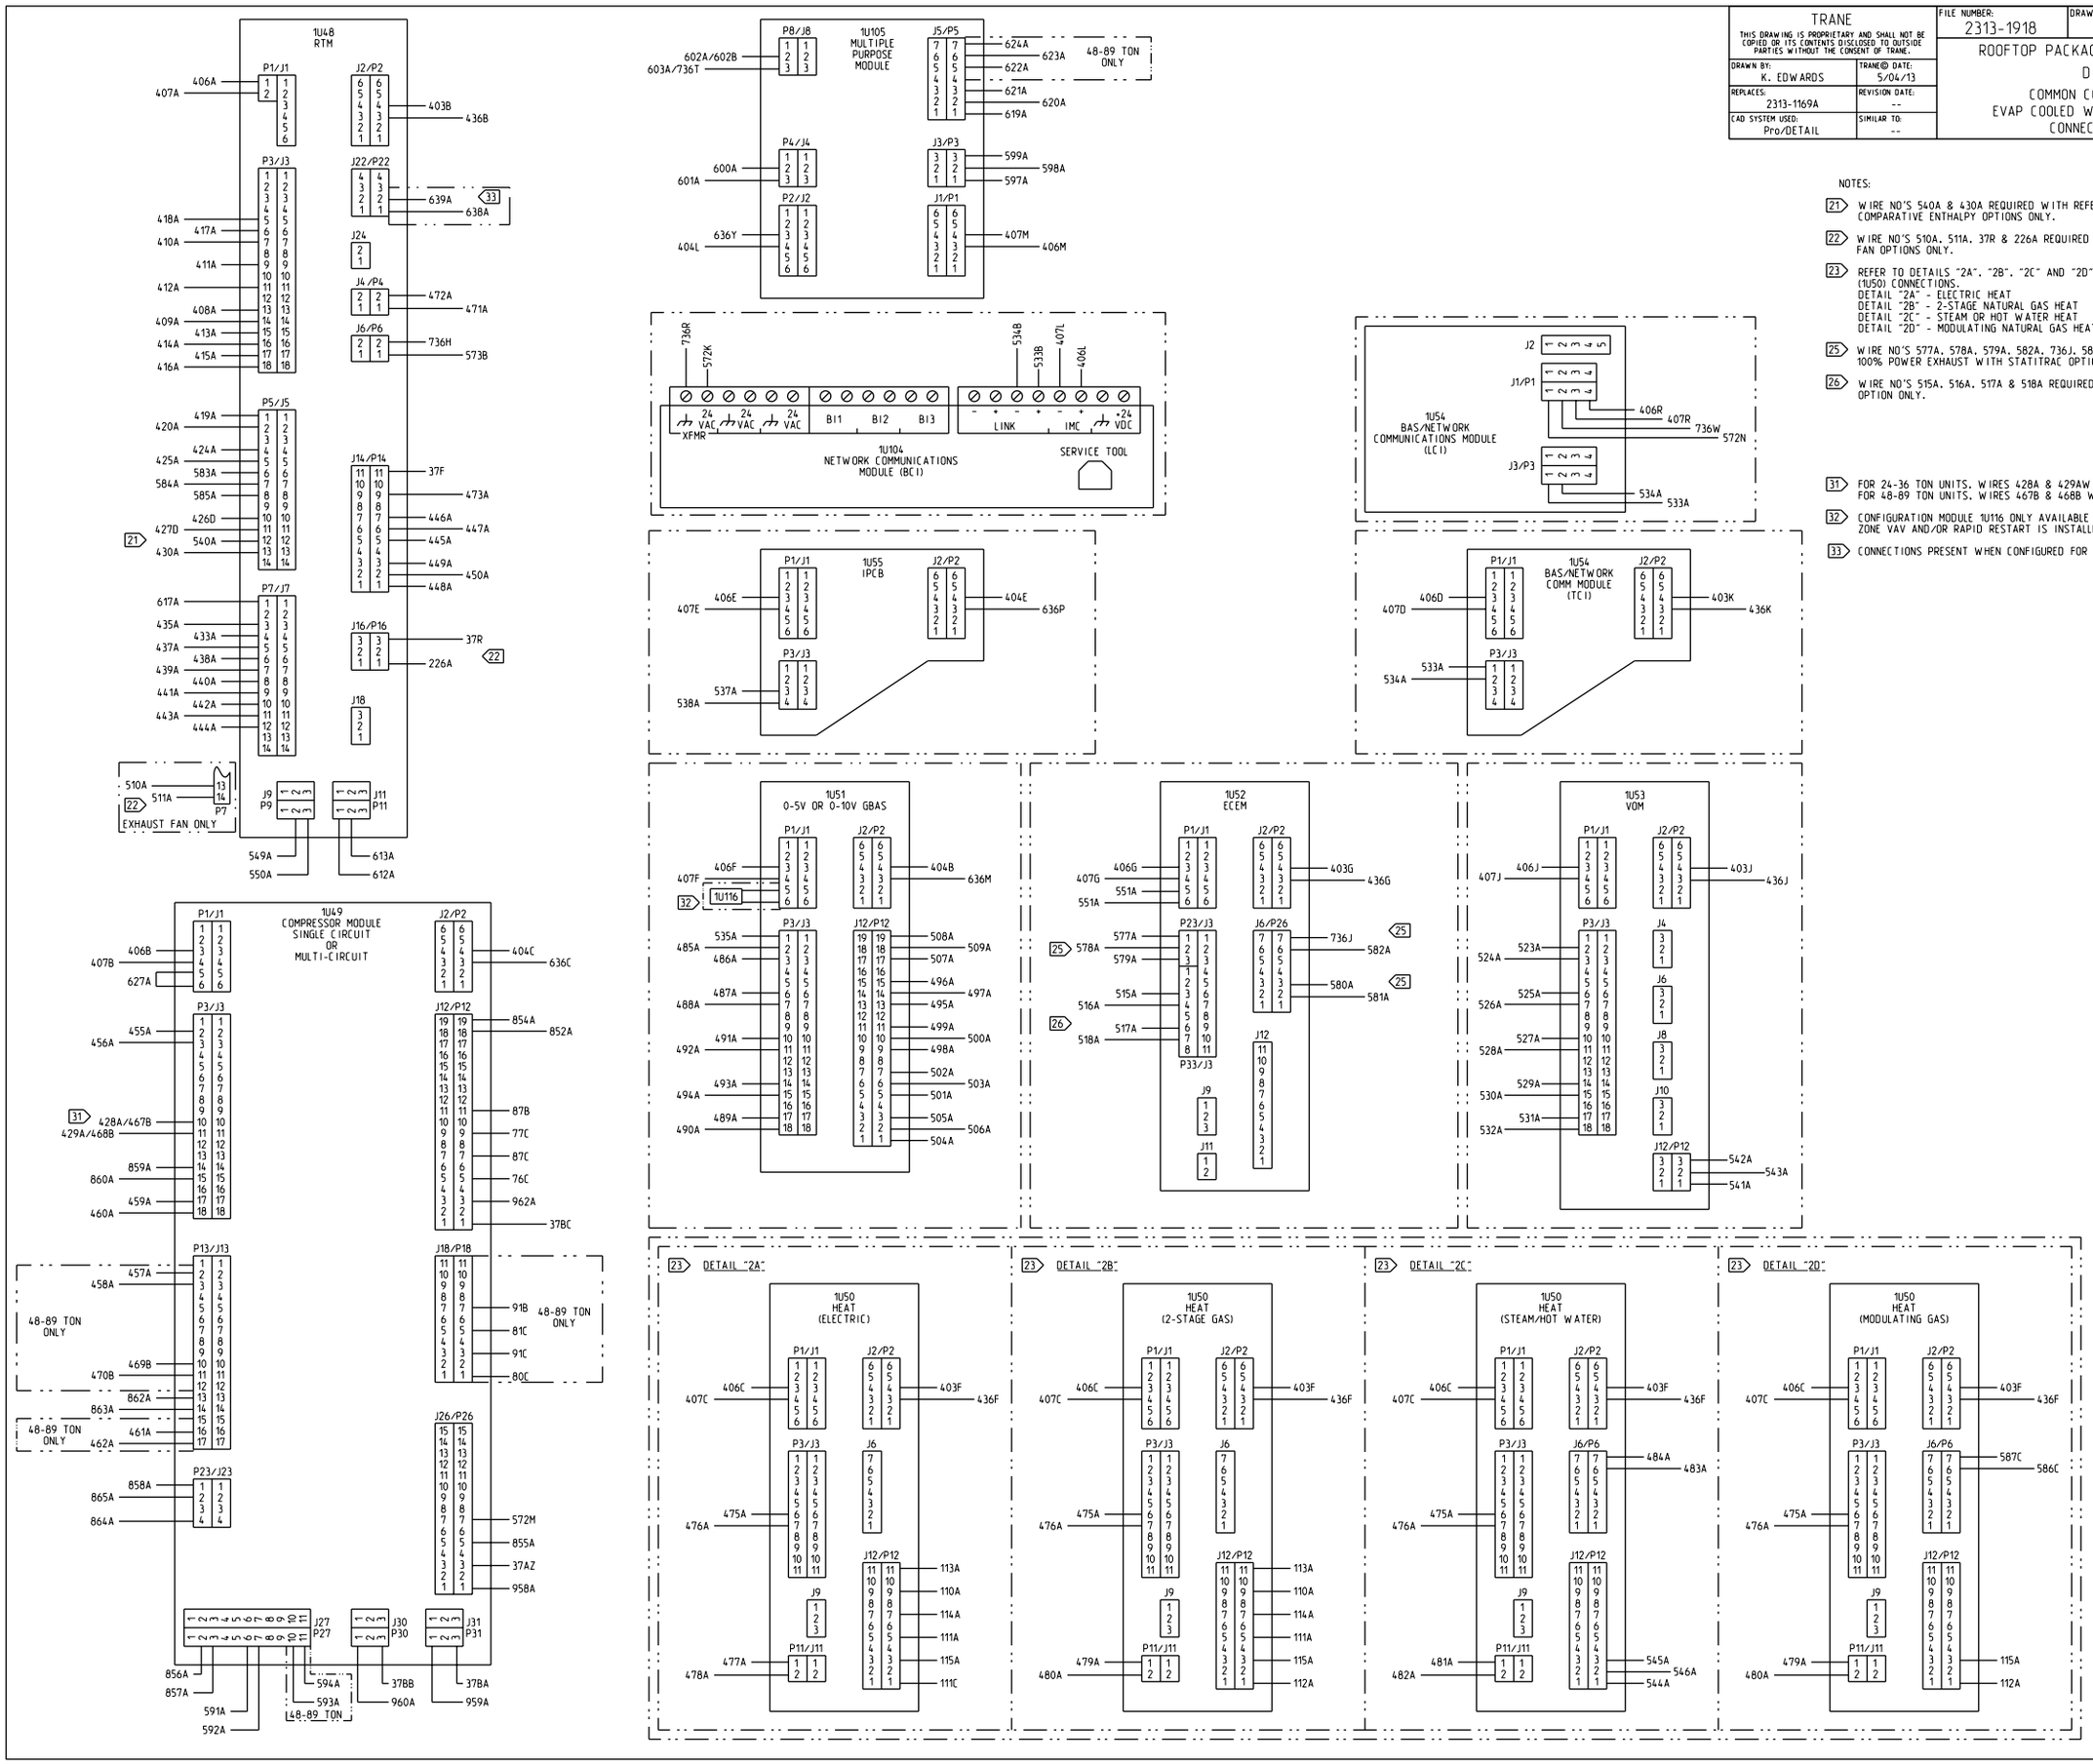

NOTES:

21 WIRE NO'S 540A & 430A REQUIRED WITH REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY OPTIONS ONLY.

22 WIRE NO'S 510A, 511A, 37R & 226A REQUIRED WITH ALL EXHAUST FAN OPTIONS ONLY.

23 REFER TO DETAILS "2A", "2B", "2C" AND "2D" FOR CORRECT HEAT MODULE (1U50) CONNECTIONS.
DETAIL "2A" - ELECTRIC HEAT
DETAIL "2B" - 2-STAGE NATURAL GAS HEAT
DETAIL "2C" - STEAM OR HOT WATER HEAT
DETAIL "2D" - MODULATING NATURAL GAS HEAT

25 WIRE NO'S 577A, 578A, 579A, 582A, 736J, 580A & 581A REQUIRED WITH 100% POWER EXHAUST WITH STATITRAC OPTION ONLY.

26 WIRE NO'S 515A, 516A, 517A & 518A REQUIRED WITH COMPARATIVE ENTHALPY OPTION ONLY.

31 FOR 24-36 TON UNITS, WIRES 428A & 429AWILL BE CONNECTED.
FOR 48-89 TON UNITS, WIRES 467B & 468B WILL BE CONNECTED.

32 CONFIGURATION MODULE 1U116 ONLY AVAILABLE ON GBAS 0-5V WHEN SINGLE ZONE VAV AND/OR RAPID RESTART IS INSTALLED.

33 CONNECTIONS PRESENT WHEN CONFIGURED FOR OPTIONAL FINAL FILTER ONLY.