TRANE	FILE NUMBER: 2313-1918	DRAWING NUMBER: 2313-1922	SHEET: 1 OF 1	REV A
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE CONSENT OF TRANE.	ROOFTOP PACKAGED AIR CONDITIONER DIAGRAM COMMON CONTROL MODULES EVAP COOLED W/ SUPPLY & EXH/RET FAN V.F.D. CONNECTION 2 OF 3			
DRAWN BY: K. EDWARDS	TRANE® DATE: 5/04/13			
REPLACES: 2313-1171A	REVISION DATE: --			
CAD SYSTEM USED: Pro/DETAIL	SIMILAR TO: --			

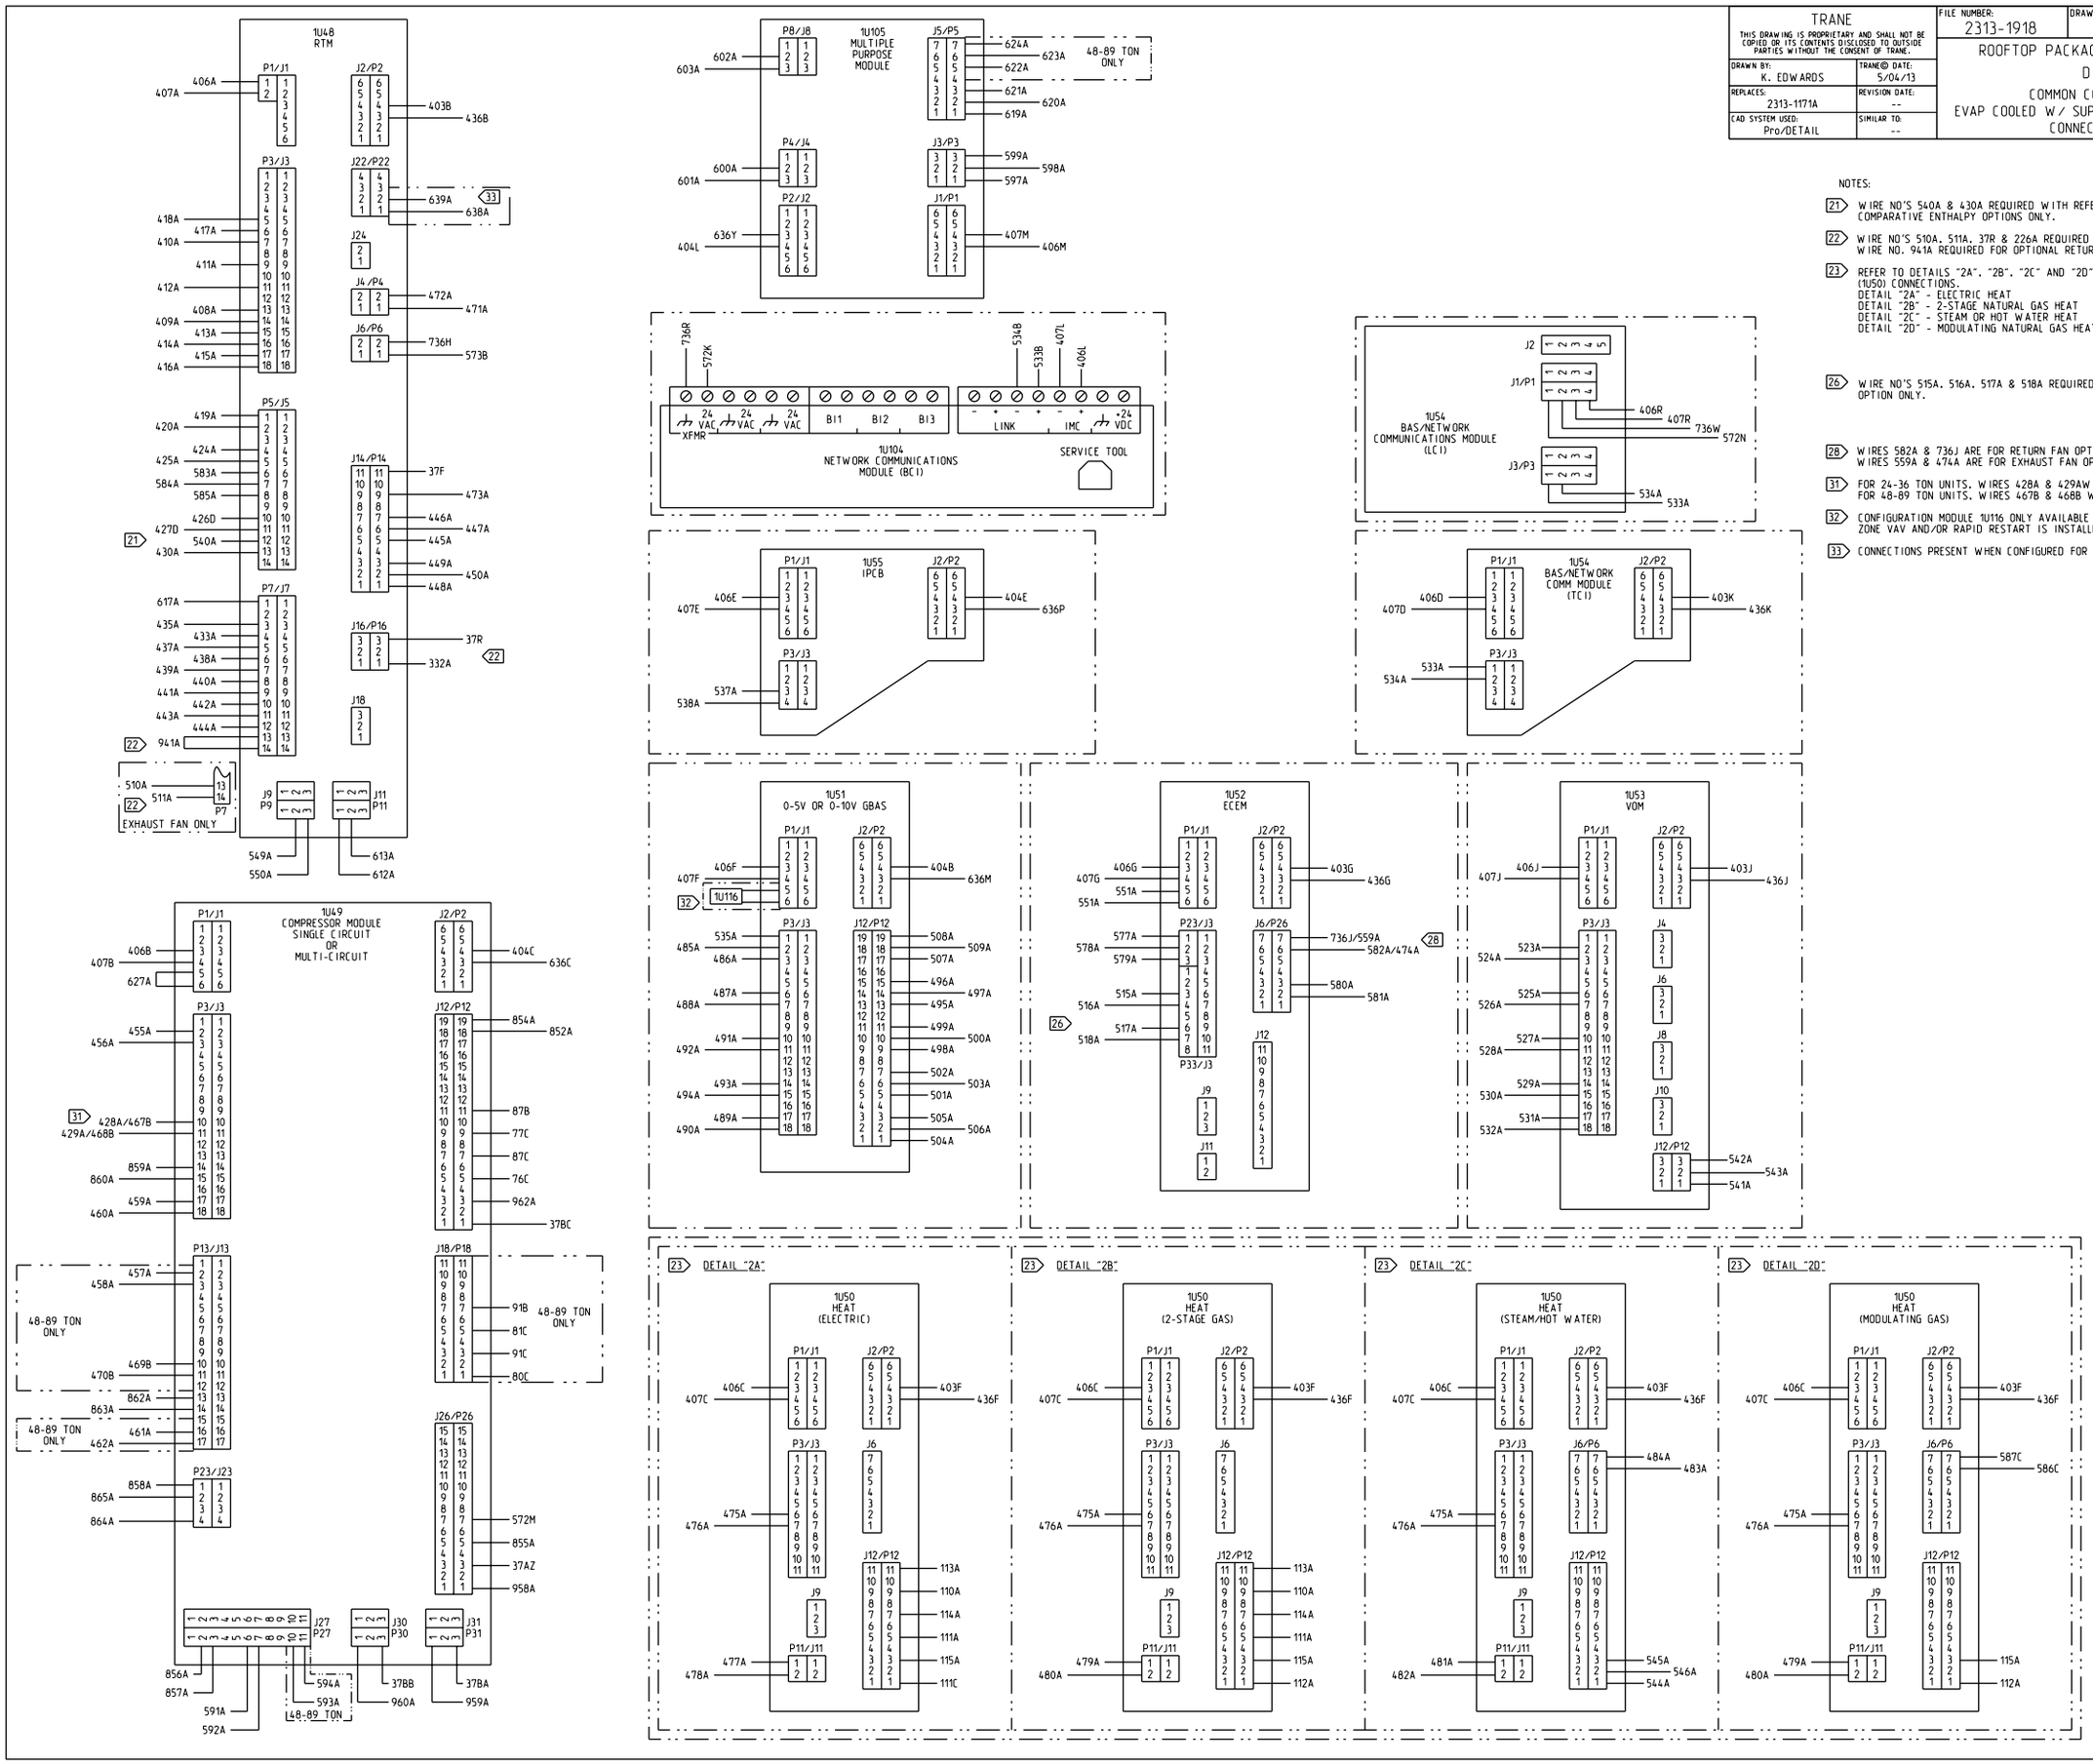

NOTES:

21. WIRE NO'S 540A & 430A REQUIRED WITH REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY OPTIONS ONLY.
22. WIRE NO'S 510A, 511A, 37R & 226A REQUIRED WITH OPTIONAL EXHAUST FAN. WIRE NO. 941A REQUIRED FOR OPTIONAL RETURN FAN ONLY.
23. REFER TO DETAILS "2A", "2B", "2C" AND "2D" FOR CORRECT HEAT MODULE (1U50) CONNECTIONS.
    DETAIL "2A" - ELECTRIC HEAT
    DETAIL "2B" - 2-STAGE NATURAL GAS HEAT
    DETAIL "2C" - STEAM OR HOT WATER HEAT
    DETAIL "2D" - MODULATING NATURAL GAS HEAT
26. WIRE NO'S 515A, 516A, 517A & 518A REQUIRED WITH COMPARATIVE ENTHALPY OPTION ONLY.
28. WIRES 582A & 736J ARE FOR RETURN FAN OPTION ONLY. WIRES 559A & 474A ARE FOR EXHAUST FAN OPTION ONLY.
31. FOR 24-36 TON UNITS, WIRES 428A & 429A WILL BE CONNECTED. FOR 48-89 TON UNITS, WIRES 467B & 468B WILL BE CONNECTED.
32. CONFIGURATION MODULE 1U116 ONLY AVAILABLE ON GBAS 0-5V WHEN SINGLE ZONE VAV AND/OR RAPID RESTART IS INSTALLED.
33. CONNECTIONS PRESENT WHEN CONFIGURED FOR OPTIONAL FINAL FILTER ONLY.